BEFORE THE CENTRAL ELECTRICITY REGULATORY COMMISSION, NEW DELHI

PETITION NO. ____ OF 2025

IN THE MATTER OF

Application under Section-14, 15, 79(1)(e) of the Electricity Act, 2003 read with Central Electricity Regulatory Commission (Procedure, Terms and Conditions for Grant of Transmission License and other related matters) Regulations, 2024 with respect to Grant of Transmission License to WRNES Talegaon Power Transmission Limited

AND IN THE MATTER OF

WRNES Talegaon Power Transmission Limited

....Petitioner

Versus

Central Transmission Utility of India Limited and Ors.

....Respondents



INDEX

SN.	Particulars	Page No		
1.	Memo of Parties	1-3		
1	Affidavit on Behalf of the Petitioner	4-5		
2	Petition / Application under Section 14, 15, 79 (1) (e) of the Electricity Act, 2003 for Grant of Transmission License			
3	Annexure A1 Copy of Government of India, Ministry of Power notification dated 21.08.2024	26-43		
4	Annexure A2 Copy of the Certificate of Registration dated 16.11.2024 of the Petitioner Company	44		
5	Annexure A3 Memorandum and Articles of Association dated 17.11.2024 of the Petitioner Company	45-77		
6	Annexure A4 Copy of the Global Invitation for Qualification dated 17.10.2024 & 18.10.2024 as published in the newspapers	78-82		
7	Annexure A5 Copy of the Certificate dated 28.03.2025 issued by Bid Evaluation Committee	83		
8	Annexure A6	84-91		



SN.	Particulars	Page No
	Copy of the Letter of Intent (LoI) dated 08.04.2025, along with the details of Annual Transmission Charges	
9	Annexure A7 Copy of the CPG dated 29.05.2025 & 31.05.2025	92-99
10	Annexure A8 Copy of the Share Purchase Agreement dated 30.05.2025	100-119
11	Annexure A9 Copy of Transmission Service Agreement (TSA) dated 30.05.2025	120-253
12	Annexure A10 Copy of duly filled Form-I	254-256
13	Annexure A11 Copy of Resolution Passed by the Board of Directors of WRNES Talegaon Power Transmission Limited	257



Place: Ahmedabad

Date: 05.06.2025

BEFORE THE CENTRAL ELECTRICITY REGULATORY COMMISSION, NEW DELHI

PETITION NO. ____ OF 2025

IN THE MATTER OF

Application under Section-14, 15, 79(1)(e) of the Electricity Act, 2003 read with Central Electricity Regulatory Commission (Procedure, Terms and Conditions for Grant of Transmission License and other related matters) Regulations, 2024 with respect to Grant of Transmission License to WRNES Talegaon Power Transmission Limited

AND IN THE MATTER OF

WRNES Talegaon Power Transmission Limited

.... Petitioner

Versus

Central Transmission Utility of India Limited and Ors.

.... Respondents

MEMO OF PARTIES

WRNES Talegaon Power Transmission Limited

Having its registered office at;

C-105, Anand Niketan,

New Delhi 110021

....Petitioner

Versus

1. Central Transmission Utility of India Limited

Saudamini, Plot No.2, Sector-29,

Gurgaon-122 001

2. REC Power Development and Consultancy Limited

Core-4, SCOPE Complex,

7, Lodhi Road,

New Delhi-110003

3. Madhya Pradesh Power Management

Company Limited (MPPMCL)

Block No. -11, Ground Floor,

Shakti Bhavan, Vidhyut Nagar, Rampur,

Jabalpur - 482 008, Madhya Pradesh

4. Chhattisgarh State Power Distribution

Company Limited (CSPDCL)

P.O. Sunder Nagar, Dangania,

Raipur - 492013, Chhattisgarh

5. Maharashtra state Electricity Distribution

Company Limited (MSEDCL)

Prakashgad, 4th Floor,

Bandra (East), Mumbai – 400051



6. Gujarat Urja Vikas Nigam Limited (GUVNL)

Vidhyut Bhavan,

Racecourse Road, Vadodara – 390007

7. Electricity Department, Government of Goa

Vidyut Bhavan, Near Mandvi Hotel,

Panaji, Goa - 403001

8. Dadra and Nagar Haveli and Daman

and Diu Power Distribution Corporation

Limited (DNHDDPDCL)


1st & 2nd Floor, Vidyut Bhavan, Silvassa,

DADRA & NAGAR HAVELI – 396230

.....Respondents

Petitioner

Place: Ahmedabad Date: 05.06.2025



BEFORE THE CENTRAL ELECTRICITY REGULATORY

COMMISSION, NEW DELHI

PETITION NO. _____ OF 2025

IN THE MATTER OF

Application under Section-14, 15, 79(1)(e) of the Electricity Act, 2003 read with Central Electricity Regulatory Commission (Procedure, Terms and Conditions for Grant of Transmission License and other related matters) Regulations, 2024 with respect to Grant of Transmission License to WRNES Talegaon Power Transmission Limited

AND IN THE MATTER OF

WRNES Talegaon Power Transmission Limited

....Petitioner

Versus

Central Transmission Utility of India Limited & Ors


....Respondents


AFFIDAVIT

I, Prashant Kumar, son of Sh. Jagdish Prasad aged about 48 years, R/o B-

101, Sanskar Apartments, Satellite, Ahmedabad do hereby solemnly affirm

and state on oath as under:





- That I am the Authorised Representative, of the Petitioner, WRNES
 Talegaon Power Transmission Limited, and I am fully conversant with
 the facts and circumstances of the case and I have been duly authorized
 and am, therefore, competent to affirm this affidavit.
- 2. That I have read the accompanying submissions being submitted on behalf of WRNES Talegaon Power Transmission Limited and have understood the contents thereof and that the contents therein are true and correct to the best of my knowledge and belief.

VERIFICATION

I, **Prashant Kumar**, the above named deponent do hereby verify that the contents of this affidavit are true and correct to the best of my knowledge and belief, no part of it is false and nothing material has been concealed therefrom.

Verified by me on this 3rd June, 2025 at Ahmedabad.





DEPONENT

SOLEMNLY AFFIRMED
BEFORE ME
VIJAY C. SHAH
NOTARY
GOVE OF INDIA

4 JUN 2025

BEFORE THE CENTRAL ELECTRICITY REGULATORY COMMISSION, NEW DELHI

PETITION NO. _____ OF 2025

IN THE MATTER OF

Application under Section-14, 15, 79(1)(e) of the Electricity Act, 2003 read with Central Electricity Regulatory Commission (Procedure, Terms and Conditions for Grant of Transmission License and other related matters) Regulations, 2024 with respect to Grant of Transmission License to WRNES Talegaon Power Transmission Limited

AND IN THE MATTER OF

WRNES Talegaon Power Transmission Limited

.... Petitioner

Versus

Central Transmission Utility of India Limited & Ors

.... Respondents



PETITION / APPLICATION UNDER SECTION 14, 15, 79 (1) (e) OF THE ELECTRICITY ACT, 2003 FOR GRANT OF TRANSMISSION LICENSE

MOST RESPECTFULLY SHOWETH:

1. It is most respectfully submitted that WRNES Talegaon Power Transmission Limited (herein after referred to as "Petitioner") is filing the present Application under Section-14 &15 of the Electricity Act, 2003 read with Central Electricity Regulatory Commission (Procedure, Terms and Conditions for Grant of Transmission License and other related matters) Regulations, 2024 (hereinafter referred to as "Transmission Licence Regulations") for grant of Transmission Licence to establish transmission project for "Network Expansion scheme in western Region to cater to Pumped storage potential near Talegaon (Pune)" on build, own, operate and transfer basis (hereinafter referred to as "the project") consisting of following elements:

	Name of the Transmission Element	Scheduled
		COD in
		months from
		Effective Date
1.	Establishment of 2x1500 MVA, 765/400 kV substation	
	near South of Kalamb with 2X330 MVAR, 420 kV bus	01.01.2028
	reactor and 2X125 MVAR, 420 kV bus reactor	



	Name of the Transmission Element	Scheduled
		COD in
		months from
		Effective Date
2.	LILO of Pune – III – Boisar -II 765 kV D/C line at	
	South Kalamb S/s with associated bays at South	
	Kalamb S/s	
3.	Installation of 1X240 MVAr switchable line reactor on	
	each ckt at South Kalamb end of Boisar - II South	
	Kalamb 765 kV D/C line (Formed after above LILO)	

9. It is most respectfully submitted that Ministry of Power, Government of India, vide Gazette Notification dated 21.08.2024 has notified REC Power Development and consultancy Limited (RECPDCL) to be the Bid Process Coordinator (Hereinafter referred as "BPC") for the purpose of selection of Bidder as Transmission Service Provider (Hereinafter referred as "TSP") to establish Transmission System for "Network Expansion scheme in western Region to cater to Pumped storage potential near Talegaon (Pune)" through tariff based competitive bidding process.

A copy of the Government of India, Ministry of Power's Gazette Notification is enclosed herewith and marked as *ANNEXURE A1*.

2. Further a Company under the Companies Act 2013 by the name "WRNES Talegaon Power Transmission Limited" having its registered office at C - 105, Anand Niketan, New Delhi - 110021 has been incorporated on 16.11.2024 by REC Power Development and consultancy Limited (Bid



Process Coordinator) as its 100% wholly owned subsidiary to initiate the activities for execution of the Project and subsequently to act as Transmission Service Provider after being acquired by the successful bidder selected through Tariff Based Competitive Bidding process. A copy of the Certificate of Registration of the Petitioner Company is enclosed herewith and marked as *ANNEXURE A2*, and a copy of the Memorandum of Association and Articles of Association of the Petitioner Company is enclosed herewith and marked as *ANNEXURE A3*.

- 3. It is further submitted that BPC had initiated the selection of successful bidder to acquire the TSP in accordance with the "Tariff Based Competitive Bidding Guidelines for Transmission Service" and "Guidelines for Encouraging Competition in Development of Transmission Projects" issued by Government of India, Ministry of Power under Section-63 of the Electricity Act, 2003. Copy of the Global Invitation for Qualification as published in the newspapers is enclosed herewith and marked as ANNEXURE A4.
- 4. It is most respectfully submitted that pursuant to the process of competitive bidding conducted by the BPC, M/s. Adani Energy Solutions Limited has been declared as the successful bidder. Copy of the Certificate by Bid



Evaluation Committee is enclosed herewith and marked as *ANNEXURE*A5.

- 5. Further, on 8th April, 2025 the BPC issued a Letter of Intent (hereinafter referred to as "LoP") to M/s Adani Energy Solutions Limited. A copy of the Letter of Intent (LoI) along with the details of Annual Transmission Charges is enclosed herewith and marked as ANNEXURE A6.
- 6. It is humbly submitted that in accordance with the LoI, Adani Energy Solutions Limited on 29.05.2025 & 31.05.2025 (Amendment to BG) has furnished the Contract Performance Guarantees (CPG) for an aggregate value of Rs. 31,00,00,000.00/- (Rupees thirty-one Crore Only) in favour of Central Transmission Utility of India Limited. Copy of the CPG dated 29.05.2025 & 31.05.2025 is enclosed herewith and marked as ANNEXURE A7.
- 7. M/s Adani Energy Solutions Limited has acquired WRNES Talegaon Power Transmission Limited on 30.05.2025 after execution of the Share Purchase Agreement and completing all procedural requirements as specified in the bid documents. A copy of the Share Purchase Agreement is enclosed herewith and marked as ANNEXURE A8.



- 8. Further the Transmission Service Agreement (TSA) dated 30.05.2025 was entered between the Central Transmission Utility of India Limited (Nodal Agency) and "WRNES Talegaon Power Transmission Limited" and is enclosed herewith and marked as *ANNEXURE A9*.
- 9. It is humbly submitted that as per the Clause 2.15.4 of Request for Proposal (RFP), the TSP/Petitioner is required to apply for Grant of Transmission Licence within 5 working days from the date of acquisition of SPV.
- 10. It is humbly submitted that Section-14 of the Electricity Act, 2003 provides that the Appropriate Commission may, on an application made under Section-15 of the Electricity Act, 2003, grant Licence to any person to transmit electricity as a transmission licensee in any area as may be specified in the Licence. The word 'person' has been defined in Section 2(49) of the Act to include any company or body corporate or association or body of individuals, whether incorporated or not, or artificial juridical person. Therefore, the Petitioner in accordance with the TSA and under Section 14 & 15 of the Electricity Act, 2003 is filing the present Petition/Application inter-alia seeking grant of Transmission Licence for the Project explained above.
- 11. Further, it is most respectfully submitted that Section 15(1) of the Act provides that every application under Section 14 shall be made in such manner and in such form as may be specified by the Appropriate

Commission and shall be accompanied with such fees as may be prescribed. Regulation 4 of Central Electricity Regulatory Commission (Procedure, Terms and Conditions for Grant of Transmission License and other related matters) Regulations, 2024 provides that a person selected through the process under the competitive bidding guidelines is eligible for grant of licence for which the Petitioner is constrained to approach this Commission.

- 12. That the Petitioner, WRNES Talegaon Power Transmission Limited, incorporated under the Companies Act, 2013 is a 100% wholly owned subsidiary of Adani Energy Solutions Limited who has been selected on the basis of the transparent process of Tariff Based Competitive Bidding as per the Tariff Based Bidding Guidelines for Transmission Service issued by the Government of India, Ministry of Power and thus eligible for issuance of transmission licence.
- 13. It is submitted that the grant of transmission license is a mandatory condition of Transmission Service Agreement and is also a requirement in law without which the Petitioner cannot proceed with the establishment of the Transmission System.
- The Hon'ble Commission in its CERC (Procedure, Terms & Conditions for grant of Transmission Licence and other related matters) Regulations, 2024



had prescribed the form of Application and also the amount of fee for making an Application for a Transmission Licence and the Petitioner is submitting herewith the Application in such prescribed format along with the fees as per Regulation 5(1) of the said Regulation. Copy of duly filled Form-I along with the Resolution passed by the Board of Directors of WRNES Talegaon Power Transmission Limited is enclosed herewith and marked as *ANNEXURE A11*.

- 15. It is most respectfully submitted that the copy of the Application for grant of Transmission Licence is being forwarded to each of the Respondents as per Regulation 5(3) of CERC (Procedure, Terms and Conditions of Transmission Licence and other related matters) Regulations, 2024.
- 16. It is further submitted that the Petitioner is submitting/furnishing a copy of the instant Application to Central Transmission Utility, as required under Section 15 (3) of the Act and Regulation 5(3) of CERC (Procedure, Terms and Conditions of Transmission Licence and other related matters) Regulations, 2024 for the recommendation, if any, in accordance with Section 15 (4) of the Act simultaneously along with submission of this petition to Hon'ble Commission.



- 17. The Petitioner has posted the Application for grant of Transmission Licence on its website www.adanienergysolutions.com in compliance to Regulation 5(4) of CERC (Procedure, Terms and Conditions of Transmission Licence and other related matters) Regulations, 2024 to facilitate the access to the Application by any person through internet. The petitioner shall publish a notice of its application in Form-II prescribed under Regulation 5(5) of CERC (Procedure, Terms and Conditions of Transmission Licence and other related matters) Regulations, 2024 for inviting comments from general public. This notice shall also be uploaded on website of petitioner.
- 18. Keeping in view the above, the Petitioner fulfils the eligibility criteria for grant of transmission licence as stipulated in Central Electricity Regulatory Commission (Procedure, Terms and Conditions for grant of Transmission Licence and other related matters) Regulations, 2024.
- 19. It is submitted that as per Request for Proposal ('RFP') under the bidding process the definition of "RFP Project Documents" shall mean the Transmission Service Agreement and the Share Purchase Agreement ('SPA'). It is submitted that the TSA has been executed between the Transmission Service Provider ('TSP') and Central Transmission Utility of India Limited (CTUIL) which is part of RFP Project Documents. The terms of the said TSA are binding on the parties to the said agreement. It is



- submitted that claims, if any, made by the applicant shall be in accordance with the provisions of the RFP project documents.
- 20. It is most respectfully submitted that the above right is without any prejudice to the rights of the Applicant/Transmission license as provided for in the Electricity Act, TSA including the laws governing the TSA and Regulations etc.
- 21. It is humbly submitted that the bidding process was governed by the Tariff Based Competitive Bidding Guidelines for the Transmission Services and Standard Bidding Documents issued by the Ministry of Power. The tariff quoted inter alia takes into consideration the rights and obligations of the developer including the provisions available to claim time and cost variations as allowed in the TSA.
- 22. The terms of the TSA are binding on the parties (TSP & CTUIL) to the said agreement and any claim for escalation of transmission charges or for extension of time in pursuance of such competitive bidding process need to be dealt with in accordance with the terms contained in the bidding documents including the TSA. Post selection of the successful bidder and the decision to award the project, there cannot be a review of the bidding terms including the scope of the implications of the clauses such as force majeure, change in law etc. stipulated in the TSA. Further there are provisions in law such as Section 56 of the Indian Contract Act, 1872,



which deals with the frustration of contract, impossibility of Performance etc. giving statutory remedies to the contracting parties. The Hon'ble Commission and other judicial forums have provided reliefs in the past in various cases as per the terms of the contract or as per the provisions of law where events occurrence during implementation are not attributable to the developers. Also, in terms of Section 28 of the Indian Contract Act, 1872, no restraint in taking legal proceedings in future can be validly placed.

23. It is further stated that in terms of the TSA the Applicant would implement the project as per the provisions of the Article 16.4 of the Transmission Service Agreement ('TSA'), which reads as under: -

"16.4 Parties to Perform Obligations:

Notwithstanding the existence of any Dispute and difference referred to Commission as provided in Article 16.3 and save as the Commission may otherwise direct by a final or interim order, the Parties hereto shall continue to perform their respective obligations/roles (which are not in dispute) under this Agreement"

24. It is submitted that in facts and circumstances mentioned hereinabove, it is humbly submitted that claims, if any, made by the Applicant shall be in accordance with the provisions of the RFP projects Documents.



- 25. With reference to ensure the compliance of the requirements stipulated in Article 5.1.1 and Article 5.4 of the TSA, the Petitioner is making the following submission in the subsequent paragraphs.
- 26. That according to the terms of the TSA, there are three external agencies viz. CEA, CTU and Independent Engineer, which monitor the quality of the construction of the Transmission Project being constructed by the Applicant. Further, the Applicant under the TSA is entrusted with the obligation of providing progress report on a monthly basis, a progress report to the Nodal Agency and Central Electricity Authority ("CEA"), with regard to the project and its execution, to enable them to monitor and coordinate the development of the Project. Further, it is most respectfully submitted that in terms of the TSA, the Nodal Agency shall appoint Independent Engineer for the purpose of inspecting the progress of the Project. In addition, the CEA may carry out random inspections during the Project execution, as and when deemed necessary by it. The relevant provisions of the TSA are extracted as below:

"Clause 4.1 (g) – TSP's obligation in development of the Project:

Subject to the terms and conditions of this Agreement, the TSP at its own cost and expenses shall observe, comply with, perform, undertake and be responsible:

(g) To provide the Nodal Agency and CEA, on a monthly basis, progress reports with regards to the Project and its execution (in accordance with



prescribed Form) to enable the CEA to monitor and co-ordinate the development of the Project matching with the Interconnection Facilities."

"Clause 5.5 – Progress Monitoring & Quality Assurance:

- 5.5.1 The Project Execution Plan submitted by the TSP in accordance with Article 3.1.3.c) shall comprise of detailed schedule of all the equipments/items/materials required for the Project, right from procurement of raw material till the dispatch from works and receipt at the site. Further, it should also include various stages of the construction schedule up to the commissioning of the Project.
- 5.5.2 Nodal Agency, CEA & Independent Engineer shall have access at all reasonable times to the Site and to the Manufacturer's works and to all such places where the Project is being executed.
- 5.5.3 Independent Engineer shall ensure conformity of the conductor specifications with the functional specifications specified in RFP.
- 5.5.4 The Independent Engineer shall monitor the following during construction of the Project:
- a) Quality of equipments, material, foundation, structures and workmanship etc. as laid down in Article 5.4 and 6.1.4 of the TSA. Specifically, quality of Sub-station equipments, transmission line material and workmanship etc. would be checked in accordance with the Article 5.4.
- b) Progress in the activities specified in Condition Subsequent
- c) Verification of readiness of the elements including the statutory clearances & completion of civil works, fixing of all components and finalisation of punch points (if any) prior to charging of the elements



d) Progress of construction of substation and Transmission Lines

5.5.5 The progress shall be reviewed by the Independent Engineer against the Project Execution Plan. The Independent Engineer shall prepare its report on monthly basis and submit the same to Nodal Agency highlighting the progress achieved till the end of respective month vis-A-vis milestone activities, areas of concern, if any, which may result in delay in the timely completion of the Project. Based on the progress, Nodal Agency and/ or CEA shall issue written instructions to the TSP to take corrective measures, as may be prudent for the timely completion of the Project. In case of any deficiency, the Nodal Agency would be at liberty to take action in accordance with the procedure of this Agreement.

5.5.6 For any delay in commissioning any critical Element(s), as identified in Schedule 1 & Schedule 2 of this Agreement, beyond a period of 45 days shall lead to a sequestration of 10% of the Contract Performance Guarantee."

"Clause 5.8 - Remedial Measures:

The TSP shall take all necessary actions for remedying the shortfall in achievement of timely progress in execution of the Project, if any, as intimated by the Independent Engineer and/ or CEA and/ or the Nodal Agency. However, such intimation by the Independent Engineer and/ or CEA and/ or the Nodal Agency and the subsequent effect of such remedial measures carried out by the TSP shall not relieve the TSP of its obligations in the Agreement. Independent Engineer and/ or CEA



and/ or the Nodal Agency may carry out random inspections during the Project execution, as and when deemed necessary by it. If the shortfalls as intimated to the TSP are not remedied to the satisfaction of the CEA and/ or the Nodal Agency, this Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement."

27. That the TSA further provides that the TSP i.e. the Applicant must ensure that the design and construction of the project is in accordance with Indian Standards and Codes issued by the Bureau of Indian Standards and in case they are not applicable, other equivalent internationally recognized Standards and Codes shall be followed. Further, in terms of the TSA the Applicant is also responsible for constructing and commissioning the Project in accordance with the norms prescribed in various Regulations issued by the CEA, Prudent Utility Practices and other applicable Laws. The relevant provisions of the TSA are extracted as below:

"Clause 5.1.1 of the TSA -TSP's Construction Responsibilities

The TSP, at its own cost and expense, shall be responsible for designing, constructing, erecting, testing and commissioning each Element of the Project by the Scheduled COD in accordance with the Regulations and other applicable Laws specified in Article 4.1 of this Agreement."

"Clause 5.4 of the TSA - Quality of Workmanship:



The TSP shall ensure that the Project is designed, built and completed in a good workmanship using sound engineering and construction practices, and using only materials and equipment that are new and manufactured as per the MQP and following approved FQP for erection, testing & commissioning and complying with Indian /International Standards such that, the useful life of the Project will be at least thirty five (35) years from the COD of the Project.

The TSP shall ensure that all major substation equipment / component (e.9. transformers, reactors, Circuit Breakers, Instrument Transformers (IT), Surge Arresters (SA), Protection relays, clamps & connectors etc.), equipment in terminal stations of HVDC installations including Thyristor/ IGBT valves, Converter Transformers, smoothing reactors, Transformer bushings and wall bushings, GIS bus ducts, towers and gantry structures and transmission towers or poles and line materials (conductors, earth wire, OPGW, insulator, accessories for conductors, OPGW & earth wires, hardware fittings for insulators, aviation lights etc.), facilities and system shall be designed, constructed and tested (Type test, Routine tests, Factory Acceptance Test (FAT)) in accordance with relevant CEA Regulations and Indian Standards. In case Indian Standards for any particular equipment/ system/ process is not available, IEC/ IEEE or equivalent International Standards and Codes shall be followed."

- 28. It is most respectfully submitted that in terms of the above quoted provisions of the TSA there are sufficient checks and balances, and the quality control mechanism is already available whereby, CEA, Nodal Agency and Independent Engineer will monitor the overall quality of construction of the Project by the Applicant to ensure that the Applicant is complying with Article 5.1.1 and 5.4 of the TSA.
- 29. In addition to the above the Applicant would also like to refer to the provisions of the RFP Document, which are stated as below:

"2.5.7.2 In their own interest, the Bidders are requested to familiarize themselves with all relevant laws of India, including without limitation, the Electricity Act 2003, the Income Tax Act 1961, the Companies Act, 1956 / Companies Act, 2013 (as the case may be), Environment Protection Act 1986 and Forest (Conservation) Act, 1980, the Customs Act, the Foreign Exchange Management Act, Land Acquisition Act, 1894, the Indian Telegraph Act 1885, Labour & Employment Laws of India, [Insurance Act] the regulations/standards framed by the Commissions and CEA, all other related acts, laws, rules and regulations prevalent in India, as amended from time to time.

In addition to the above, the Bidders are required to familiarize themselves with all relevant technical codes and standards, including but not limited to the Grid Code / State Grid Code, Central Electricity Authority (Installation and Operations of Meters) Regulations, 2006, Central Electricity Authority (Technical Standards for Connectivity to the Grid) Regulations, 2007, Central Electricity Regulatory



Commission Grant of Connectivity, Long-term Access and Medium - Term Open Access in Inter-State Transmission and related matters) Regulations, 2009, Central Electricity Authority (Technical Standards for construction of Electrical Plants and Electric Lines) Regulation, 2010, Central Electricity Authority (Technical Standards for Communication System in Power System Operation) Regulations, 2020, Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations, 2020 and other relevant Rules/ Regulations/ Guidelines issued by the Central Government, the CERC and the CEA and amendments thereof.

The BPC shall not entertain any request for clarifications from the Bidders regarding the above laws / acts / rules / regulations / standards. Non-awareness of the same shall not be a reason for the Bidder to request for extension in Bid Deadline. The Bidders undertake and agree that, before submission of their Bid, all such factors as generally brought out above, have been fully investigated and considered while submitting their Bids."

- 30. It is further submitted that the Applicant being an experienced entity will ensure that the project is constructed by following the required quality standard and prudent utility practices by putting in place the following: -
 - At the procurement stage, the Qualification Requirement for shortlisting's of a supplier/contractor is done on the basis of the technical specifications as mentioned on the TSA. The purchase



Order/contract mentions the technical standards and the testing requirements. Material dispatch is allowed after the conformance report is validated.

- ii. For tower material, a Manufacturing Quality Plan (MQP) in line with the applicable technical standards and the one followed by CTU is followed.
- iii. For ensuring construction quality, a Field Quality Plan (in line with the standards mentioned in TSA and that followed by CTU) is specified to the contractors in advance. The conformance report to the said document is also maintained at site.
- iv. The construction and material supply quality are also validated with respect to the TSA by the Lenders Independent Engineer during its quarterly construction review.
- 31. That the above statement is without any prejudice to the rights of the Applicant/Transmission License as provided in the Electricity Act, TSA and the Laws.
- 32. The Petitioner shall also comply with all the other requirements as provided in the Transmission License Regulations including publication of notices in newspapers, service on the beneficiaries of the Petitioner's Transmission System. The Petitioner shall place the compliance report on record before the Hon'ble Commission.

33. PRAYER

The Petitioner hereby humbly prays the Hon'ble Commission to:

a) Grant the Transmission License to the Applicant /Petitioner, WRNES

Talegaon Power Transmission Limited for establishing, operating and

maintaining the Inter-state Transmission System as provided for in the

Transmission Service Agreement;

b) Allow the "Network Expansion scheme in western Region to cater

to Pumped storage potential near Talegaon (Pune)" to be part of

PoC Pool as per CERC (Sharing of Inter-State Transmission Charges

and Losses) Regulations, 2020 and any other amendments thereon

issued from time to time by Hon'ble Commission.

c) Condone any inadvertent errors omissions/ errors / shortcomings and

permit the Petitioner to add/change/modify/alter these filings and

oower Tra

make further submissions as may be required at a future date.

d) Pass any such other order / orders, as may be deemed fit and proper in

the facts and circumstances of the case.

Petitioner

Place: Ahmedabad

Date: 05.06.2025

रजिस्ट्री सं. डी.एल.- 33004/99

REGD. No. D. L.-33004/99



सी.जी.-डी.एल.-अ.-22082024-256561 CG-DL-E-22082024-256561

असाधारण EXTRAORDINARY

भाग II—खण्ड 3—उप-खण्ड (ii) PART II—Section 3—Sub-section (ii)

प्राधिकार से प्रकाशित PUBLISHED BY AUTHORITY

सं. 3229]

नई दिल्ली, बुधवार, अगस्त 21, 2024/ श्रावण 30, 1946

No. 3229]

NEW DELHI, WEDNESDAY, AUGUST 21, 2024/ SHRAVANA 30, 1946

विद्युत मंत्रालय

अधिसूचना

नई दिल्ली, 20 अगस्त, 2024

का.आ. 3545(अ).—विद्युत अधिनियम, 2003 (2003 की सं. 36,) की धारा 63 के अंतर्गत परिचालित दिशा-निर्देशों के पैरा 3 के उप-पैरा 3.2 द्वारा प्रदत्त शक्तियों का प्रयोग करते हुए, केंद्र सरकार, राष्ट्रीय पारेषण समिति की 20वीं बैठक की सिफारिशों पर, संबंधित बोली-प्रक्रिया समन्वयकों (बीपीसी) के विवरण के साथ टीबीसीबी मोड के अंतर्गत निम्नलिखित पारेषण स्कीमों को अधिसूचित करती है:

क्र.सं.	पारे	षण	स्कीम का नाम और कार्यक्षेत्र			
1.	तलेगांव (पुणे) के निकट पम्प्ड भंडारण क्षमता को पूरा करने के लिए पश्चिमी क्षेत्र में नेटवर्क विस्तार स्कीम					
		संभावित कार्यान्वयन समय-सीमाः तिथि 01.01.2027 एसपीवी अंतरण से 24 माह की न्यूनतम कार्यान्वयन अनुसूची के अध्यधीन				
		बीपीसी: आरईसी विद्युत विकास एंड कंसल्टेंसी लिमिटेड				
	कार	र्य-क्षे	त्र:			
		新 .	पारेषण स्कीम का कार्यक्षेत्र क्षमता (एमवीए)/मार्ग लंबाई (किमी)			
		सं				
		1.	2x330 एमवीएआर, 765 केवी बस रिएक्टर 765/400 केवी, 1500 एमवीए आईसीटी – 2			
			और 2x125 एमवीएआर, 420 केवी बस (7x500 एमवीए एकल चरण यूनिटें जिसमें एक			

5319 GI/2024





रिएक्टर के साथ कलंब के दक्षिण के पास अतिरिक्त आईसीटी यूनिट शामिल है) 2x1500 एमवीए, 765/400 केवी सब-स्टेशन की संस्थापना

भविष्य के लिए प्रावधान (के लिए स्थान) :

- 765/400 केवी आईसीटी बे सहित- 10 | 765 केवी लाइन बे 4 (सेक्शन-। पर 2, सेक्शन-॥ में 4 और सेक्शन-॥ पर 4)
- स्विचेबल लाइन रिएक्टरों के साथ 765 केवी लाइन बे - 6 (सेक्शन-॥ पर 4 और सेक्शन-॥ पर 2)
- ▶ 765 केवी बस रिएक्टर बे सहित: 4 (सेक्शन-॥ पर 2 और सेक्शन-॥ पर 2)
- 765 केवी सेक्शनलाइजर: 2 सेट
- स्विचेबल लाइन रिएक्टरों के साथ 400 केवी लाइन बे - 20 (सेक्शन-। पर 6, सेक्शन-॥ पर 6 और सेक्शन-॥ पर 8)
- बे के साथ 400/220 केवी आईसीटी -4 लिए) (400 केवी सेक्शन-।।। पर: 220 केवी सेक्शन-। पर 2 और 220 केवी सेक्शन-॥ पर 2)
- 400 केवी बस रिएक्टर बे सहित: 4 (सेक्शन-॥ पर 2 और सेक्शन-॥ पर 2)
- 400 केवी सेक्शनलाइजेशन बे: 2- सेट
- 220 केवी लाइन बे: 8 (सेक्शन-I पर 4 और सेक्शन-॥ पर 4)
- 220 केवी सेक्शनलाइजेशन बे: 1 सेट
- 220 केवी बीसी और टीबीसी: 2
- ▶ 6000 मेगावाट, ± 800 केवी दक्षिण कलंब (एचवीडीसी) [एलसीसी] टर्मिनल स्टेशन (4x1500 मेगावाट) संस्थापना, साथ ही 400 केवी एचवीएसी स्विचयार्ड (400 केवी सेक्शन-। पर 2x1500 मेगावाट और 400 केवी सेक्शन-II पर 2x1500 मेगावाट) के साथ संबद्ध इंटरकनेक्शन और सभी संबद्ध उपकरण (फिल्टर सहित)/बस विस्तार आदि की संस्थापना।

765 केवी आईसीटी बे- 2

400 केवी आईसीटी बे - 2

330 एमवीएआर, 765 केवी बस रिएक्टर- 2 (7x110 एमवीएआर एकल चरण रिएक्टर जिसमें बस/लाइन रिएक्टर के लिए एक अतिरिक्त यूनिट शामिल है)

765 केवी बस रिएक्टर वे – 2

125 एमवीएआर, 420 केवी रिएक्टर - 2

400 केवी रिएक्टर बे - 2

400 केवी लाइन बे - 2 (पीएसपी के अंतर्संयोजन के



2.	दक्षिण कलंब एस/एस पर पुणे-॥। – बोईसर-॥ •	लीलो मार्ग की लंबाई: 40 किमी (160 किमी)
	765 केवी डी/सी लाइन का लीलो, दक्षिण कलंब •	पुणे-।।। – बोईसर-।। 765 केवी डी/सी लाइन
	एस/एस पर संबद्ध बे सहित	हेक्सा ज़ेबरा कॉन्फिगरेशन की है और लीलो भी
<u> </u>		इसी प्रकार के कंडक्टर कॉन्फिगरेशन की होगी
3.	बोइसर-II के दक्षिण कलंब छोर पर प्रत्येक •	1x240 एमवीएआर, 765 केवी स्विचेबल लाइन
	सर्किट पर 1x240 एमवीएआर स्विचेबल लाइन	रिएक्टर – 2
	रिएक्टर की संस्थापना - दक्षिण कलंब 765 •	765 केवी लाइन रिएक्टर के लिए स्विचिंग
	केवी डी/सी लाइन (उपर्युक्त लीलो के बाद	उपकरण – 2
	बनाई गई)	765/400 केवी दक्षिण कलंब एस/एस पर
		अतिरिक्त रिएक्टर (1-पीएच, 1x80 एमवीएआर)
		यूनिट

2. भुज-II पीएस में आईसीटी संवर्धन और बस रिएक्टर का प्रावधान

संभावित कार्यान्वयन समय-सीमा: एसपीवी अंतरण की तिथि से 24 माह

बीपीसी: पीएफसी कंसल्टिंग लिमिटेड

कार्य-क्षेत्र:

4/14-		
क्रम सं.	पारेषण स्कीम का कार्य-क्षेत्र	क्षमता (एमवीए)/मार्ग लंबाई (किमी)
1.	भुज-।। पीएस (जीआईएस) में 3x500 एमवीए	,500 एमवीए, 400/220 केवी आईसीटी: 3
	400/220 केवी आईसीटी (7वां, 8वां और 9वां)	
	द्वारा परिवर्तन क्षमता का विस्तार	400 केवी आईसीटी बे: 3 (व्यास पूर्णता के लिए
		अतिरिक्त 3 के साथ)
	1	
		220 केवी आईसीटी बे: 3
2.	भुज-॥ पीएस (जीआईएस) में 1x1500 एमवीए,	1500 एमवीए, 765/400 केवी आईसीटी: 1
	765/400 केवी आईसीटी द्वारा परिवर्तन क्षमता	
	का विस्तार (चौथा)	765 केवी आईसीटी बे: 1 (व्यास पूर्णता के लिए
		अतिरिक्त 1 के साथ)
		400 केवी आईसीटी बे: शून्य (1 को उपरोक्त क्रम सं. 1
	I .	पर विचार किया गया)
3.	1x330 एमवीएआर 765 केवी बस रिएक्टर	330 एमवीएआर, 765 केवी बस रिएक्टर: 1
	(द्वितीय) के साथ-साथ संबद्ध बे की संस्थापना	
		765 केवी बीआर बे: शून्य (1 को उपरोक्त क्रम सं. 2
		पर विचार किया गया)
4.	आदित्य बिड़ला रिन्यूएबल्स सब्सिडियरी	220 केवी लाइन बे – 1 (जीआईएस) (बस से व शन-II)
	लिमिटेड (एबीआरएसएल) के लिए भुज-II पीएस	
	पर 220 केवी जीआईएस लाइन बे का	
	कार्यान्वयन [आवेदन संख्या:	
	2200000321(362 मेगावाट)]	



	5. एसीएमई क्लीनटेक सॉल्यूशंस प्राइवेट लिमिटेड 220 केवी लाइन बे – 1 (जीआईएस) (बस सेक्शन-II)	7
	(एसीएसपीएल) के लिए भुज-।। पीएस पर 220	
	केवी जीआईएस लाइन बे का कार्यान्वयन	
	[आवेदन संख्या: 2200000382 (350	
	मेगावाट)]	
	. एसीएमई क्लीनटेक सॉल्यूशंस प्राइवेट लिमिटेड 220 केवी लाइन बे – 1 (जीआईएस) (बस सेक्शन-II)	7
- 1	(एसीएसपीएल) के लिए भुज-॥ पीएस पर 220	
	केवी जीआईएस लाइन बे का कार्यान्वयन	
	[आवेदन संख्या: 2200000431 (50 मेगावाट)]	
	. अवाडा एनर्जी प्राइवेट लिमिटेड (एईपीएल) के 220 केवी लाइन बे – 1 (जीआईएस) (बस सेक्शन-II)	1
	लिए भुज-॥ पीएस पर 220 केवी जीआईएस	
	लाइन वे का कार्यान्वयन [आवेदन संख्या:	
	2200000444(100 मेगावाट)]	
1	. अडानी ग्रीन एनर्जी थर्टी टू लिमिटेड 220 केवी लाइन बे – 1 (जीआईएस) (बस सेक्शन-II)	1
	(एजीई32एल) के लिए भुज-।। पीएस पर 220	
	केवी जीआईएस लाइन बे का कार्यान्वयन	
-	[आवेदन संख्या: 2200000514 (260.5	
	मेगावाट)]	
ç	. अडानी रिन्यूएबल एनर्जी एट लिमिटेड 220 केवी लाइन बे – 1 (जीआईएस) (बस सेक्शन-II)	1
	(एआरई8एल) के लिए भुज-॥ पीएस पर 220	
	केवी जीआईएस लाइन बे का कार्यान्वयन	
- 1	[आवेदन संख्या: 2200000545 (115	
	मेगावाट)]	
_		

3. मध्य प्रदेश में महान एनर्जेन लिमिटेड उत्पादन स्टेशन से विद्युत की निकासी के लिए पारेषण प्रणाली संभावित कार्यान्वयन समय-सीमा: एसपीवी अंतरण की तिथि से 24 माह बीपीसी: पीएफसी कंसल्टिंग लिमिटेड

कार्य-क्षेत्र:

क्रम सं.	पारेषण स्कीम का कार्य-क्षेत्र	क्षमता/किमी
1.	महान (मौजूदा बस) – रीवा पीएस (पीजी) 400 केवी डी/सी (क्वाड	110 किमी
	एसीएसआर/एएएसी/एएल 59 मूज़ समतुल्य) लाइन	
2.	महान (मौजूदा बस) की समाप्ति के लिए रीवा पीएस (पीजी) पर 2	400 केवी बे: 2
	400 केवी बे – रीवा पीएस (पीजी) 400 केवी डी/सी लाइन (क्वाड	
	एसीएसआर/एएएसी/एएल 59 मूज़ समतुल्य) लाइन	

नोट:

- एमईएल (मौजूदा) पर 2 400 केवी लाइन बे एमईएल के दायरे में होंगे।
- पावरग्रिड, क्रमांक 2 पर कार्य हेतु रीवा पीएस (पीजी) में स्थान उपलब्ध कराएगा।
- 4. गुजरात में 765/400 केवी लकड़िया एस/एस (डब्ल्यूआरएसएस XX I(ए) ट्रांसको लिमिटेड) में परिवर्तन क्षमता के विस्तार के लिए पारेषण प्रणाली - भाग बी

संभावित कार्यान्वयन समय-सीमा: विस्तृत कार्य-क्षेत्र के अनुसार

बीपीसी: आरईसी पावर डेवलपमेंट एंड कंसल्टेंसी लिमिटेड



क्रम	पारेषण स्कीम का कार्य-क्षेत्र	क्षमता/किमी	निर्धारित समय - सी
₹.			
1.	लकड़िया पीएस में संबंधित आईसीटी	1	कार्यान्वयन एजेंसी
	के साथ 2x500 एमबीए, 400/220 केव	ी एमवीए आईसीटी- 2	आवंटन की तिथि से
	आईसीटी (तीसरा और चौथा) र्व	• 400 केवी आईसीटी बे- 2	माह
	संस्थापना 	• 220 केवी आईसीटी बे -	
		(220 केवी बस सेक्शन-।)	
2.	टीईक्यू ग्रीन पावर XVII प्राइवेट लिमिटेः	• 220 केवी लाइन बे - 1	कार्यान्वयन एजेंसी
	(टीजीपीXVIIपीएल: 300 मेगावाट) वे	(220 केवी बस सेक्शन-।)	आवंटन की तिथि से
	लिए लकड़िया पीएस पर 220 केर्व	1 '	माह
	लाइन बे का कार्यान्वयन		
	आर्सेलर मित्तल निप्पॉन स्टील इंडिय	• 220 केवी लाइन बे – 1	कार्यान्वयन एजेंसी
1 1	लिमिटेड (एएमएनएसआईएल: 350	(220 991 98 89819-1)	आवंटन की तिथि से
1 1	मेगावाट) के लिए लकड़िया पीएस पर		माह
	220 केवी लाइन बे का कार्यान्वयन		
1 1	रिन्यू सोलर (शक्ति ऐट) प्राइवेट लिमिटेड	1 - 220 1141 (1121 4 - 1	दिनांक 30.09.20
1 1	(आरएस(एस8) पीएल: 200 मेगावाट) के	(८८० गमा भरा समराग-1)	(आवेदक द्वारा अनुरोरि
1 1	लिए लकड़िया पीएस पर 220 केवी 	•	आरंभ तिथि के अनुसार
	लाइन बे का कार्यान्वयन लकड़िया पीएस पर नए 220 केवी बस	200 2-0	कार्यान्वयन एजेंसी
1 1	तेषणङ्गा पाएस पर गए 220 कवा बस सेक्शन-II का निर्माण, साथ ही 220 केवी		आवंटन की तिथि से
1 1	त्रपरान-।। का ानमाण, साथ हा 220 कवा वस सेक्शन-। और सेक्शन-।। के बीच 220		माह
1	क्स सक्शन-। आर सक्शन-॥ क बाच 220 केवी सेक्शनलाइज़र व्यवस्था		
		• टीबीसी – 1	
	नकड़िया पीएस में 4x500 एमवीए, 400		
	′वां और 8वां) द्वारा परिवर्तन क्षमता का ः	विस्तार नए 220 केवी बस खंड-	
\vdash	। पर समाप्त		
1 1	2x500 एमवीए आईसीटी (5वां एवं		कार्यान्वयन एजेंसी
6	वां)	केवी आईसीटी: 2.	आवंटन की तिथि से 1 ——
		• 400 केवी आईसीटी बे: 2	माह
	•	•220 केवी आईसीटी बे: 2	
		(नए बस सेक्शन-II)	
6ख1	x500 एमवीए आईसीटी (7वां)	• 500 एमवीए, 400/220	31.12.2026
		केवी आईसीटी: 1	
		• 400 केवी आईसीटी बे: 1	
		• 220 केवी आईसीटी बे: 1	
	!		
		(नए बस सेक्शन-॥)	



केवी आईसीटी: 1 - 400 केवी आईसीटी वे: 1 - 220 केवी आईसीटी वे: 1 - 7. युनिपर ग्रीन एनर्जी प्राइवेट लिमिटेड (जेजीईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000376: 300 सेगावाट) 8. टीईक्यू ग्रीन पावर XVI प्राइवेट लिमिटेड (टीजीपीएकसवीआईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000398: 76 मेगावाट) 9. गर्नको सोलर प्राइवेट लिमिटेड (जीएसपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000398: 76 मेगावाट) 9. गर्नको सोलर प्राइवेट लिमिटेड (जीएसपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000458: 290 सेगावाट) 10. जुनिपर ग्रीन एनर्जी प्राइवेट लिमिटेड (जेजीईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000500: 150 मेगावाट) 11. सेरिटेक रिन्यूएवलम इंडिया प्राइवेट लिमिटेड (एसआरआईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000610: 200 मेगावाट) 12. आरडीएस सोलर पार्क प्राइवेट लिमिटेड (अरडीएएसएसपीगीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट) 13. पर्टेंट्य रिन्यूएवलम प्राइवेट लिमिटेड (पीजरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट) 13. पर्टेंट्य रिन्यूएवलम प्राइवेट लिमिटेड (पीजरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट) 14. रिन्यूएवलम प्राइवेट लिमिटेड (पीजरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट) 14. रिन्यूएवलम प्राइवेट लिमिटेड (पीजरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट) 14. रिन्यूएवलम प्राइवेट लिमिटेड (पीजरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट) 15. केवी लाइन वे का कार्यान्वयन (अवेदन संख्या 220000673: 148 मेगावाट) 16. केवी लाइन वे का कार्यान्वयन (अवेदन संख्या 220000673: 148 मेगावाट)					[171(11 500.5(11)
(जैजीईपीएल) के लिए लकडिया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000376: 300 मेगावाट) 8. गैर्डक्यू ग्रीन पावर XVI प्राइवेट लिमिटेड (टीजीपीएक्सवीआईपीएल) के लिए लकडिया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000398: 76 मेगावाट) 9. गनेको सोलर प्राइवेट लिमिटेड (जीएसपीएल) के लिए लकडिया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000458: 290 मेगावाट) 10. जुनिपर ग्रीन एनर्जी प्राइवेट लिमिटेड (अवेदिक द्वारा अनुरोधित आरंभ तिथि के अनुसार)* 11. वेरिनांक के लिए लकडिया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000500: 150 मेगावाट) 11. वेरिटेड रिन्यूएबल्स इंडिया प्राइवेट लिमिटेड (एसआरखाईपीएल) के लिए लकडिया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000610: 200 मेगावाट) 12. आरडीएस सोकर पार्क प्राइवेट लिमिटेड (आरडीएसएसपीपीएल) के लिए लकडिया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000610: 200 मेगावाट) 13. प्रतेष्ट पर्य प्राइवेट लिमिटेड (आरडीएसएसपीपीएल) के लिए लकडिया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट) 13. प्रतेष्ट पर्य प्राइवेट लिमिटेड (पीआरपीएल) के लिए लकडिया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट) 14. प्रतेष्ट रिन्यूएवल्स प्राइवेट किमिटेड (पीआरपीएल) के लिए लकडिया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट) 14. प्रतेष्ट रितीय) के साथ-साथ संबद्ध के केवी वस रिप्टर (दितीय) के साथ-साथ संबद्ध केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट)			The state water the state of th	400 केवी आईसीटी बे: 1 220 केवी आईसीटी बे: 1 (नए बस सेक्शन-II)	
(टीजीपीएक्सवीआईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000398: 76 मेगाबाट) 9. गनेको सोलर प्राइवेट लिमिटेड (जीएसपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000458: 290 मेगाबाट) 10. जुनिपर ग्रीन एनर्जी प्राइवेट लिमिटेड (जेजीईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000500: 150 मेगाबाट) 11. सेरिटिका रिन्यूएक्ल्स इंडिया प्राइवेट लिमिटेड (एसआरआईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000610: 200 मेगाबाट) 12. आरडीएस सोलर पार्क प्राइवेट लिमिटेड (आरडीएसएसपीपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000610: 200 मेगाबाट) 13. पर्सेटम रिन्यूएक्ल्स प्राइवेट लिमिटेड (पीआरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगाबाट) 13. पर्सेटम रिन्यूएक्ल्स प्राइवेट लिमिटेड (पीआरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगाबाट) 14. 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1		7.	(जेजीईपीएल) के लिए लकड़िया पीएस पर 220 केबी लाइन बे का कार्यान्वयन (आवेदन संख्या 2200000376: 300	(नए बस सेक्शन-II)	(आवेदक द्वारा अनुरोधित
(जीएसपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000458: 290 मेगावाट) 10. जुनिपर ग्रीन एनर्जी प्राइवेट लिमिटेड (जेजीईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000500: 150 मेगावाट) 11. सैरेंटिका रिन्यूएवल्स इंडिया प्राइवेट लिमिटेड (एसआरआईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000610: 200 मेगावाट) 12. आरडीएस सोलर पार्क ग्राइवेट लिमिटेड (आरडीएसएसपीपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट) 13. पर्सेंटम रिन्यूएवल्स प्राइवेट लिमिटेड (पीआरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट) 14. 1x330 एमवीएआर 765 केवी बस रिएक्टर (द्वितीय) के साथ-साथ संबद्ध वे की संस्थापना		8.	(टीजीपीएक्सवीआईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन बे का कार्यान्वयन (आवेदन संख्या	(नए बस सेक्शन-II)	(आवेदक द्वारा अनुरोधित
(जैजीईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000500: 150 मेगावाट) 11. सेरेंटिका रिन्यूएबल्स इंडिया प्राइवेट लिमिटेड (एसआरआईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000610: 200 मेगावाट) 12. आरडीएस सोलर पार्क प्राइवेट लिमिटेड (आरडीएसएमपीपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट) 13. पर्सेंटम रिन्यूएबल्स प्राइवेट लिमिटेड (पीआरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट) 14. 1x330 एमवीएआर 765 केवी बस रिएक्टर (द्वितीय) के साथ-साथ संबद्ध वे की संस्थापना 15. केवी बस रिएक्टर: 1 कार्यान्वयन एजेंसी को आवंटन की तिथि से 18 माह		9.	(जीएसपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन बे का कार्यान्वयन (आवेदन संख्या 2200000458: 290	(नए बस सेक्शन-II)	(आवेदक द्वारा अनुरोधित
लिमिटेड (एसआरआईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन बे का कार्यान्वयन (आवेदन संख्या 2200000610: 200 मेगावाट) 12. आरडीएस सोलर पार्क प्राइवेट लिमिटेड (आरडीएसएसपीपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट) 13. पर्सेंटम रिन्यूएवल्स प्राइवेट लिमिटेड (पीआरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे न 1 (नए बस सेक्शन-II) 13. पर्सेंटम रिन्यूएवल्स प्राइवेट लिमिटेड (पीआरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट) 14. 1x330 एमवीएआर 765 केवी बस रिएक्टर (द्वितीय) के साथ-साथ संबद्ध वे की संस्थापना 15. (नए बस सेक्शन-II) 16. (नए बस सेक्शन-II)		10.	(जेजीईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन बे का कार्यान्वयन (आवेदन संख्या 2200000500: 150		(आवेदक द्वारा अनुरोधित
(आरडीएसएसपीपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट) 13. पर्सेंटम रिन्यूएबल्स प्राइवेट लिमिटेड (पीआरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट) 14. 1x330 एमवीएआर 765 केवी बस रिएक्टर (द्वितीय) के साथ-साथ संबद्ध वे की संस्थापना (आरडीएसएसपीपीएल) के लिए लकड़िया (नए बस सेक्शन-II) (जेंग केवी लाइन वे — 1 (नए बस सेक्शन-II) (जेंग केवी लाइन वे — 1 (नए बस सेक्शन-II) (जेंग केवी लाइन वे — 1 (नए बस सेक्शन-II) (जेंग केवी लाइन वे — 1 (नए बस सेक्शन-II) (जेंग केवी लाइन वे — 1 (नए बस सेक्शन-II) (जेंग केवी लाइन वे — 1 (नए बस सेक्शन-II)			लिमिटेड (एसआरआईपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन बे का कार्यान्वयन (आवेदन संख्या 2200000610: 200 मेगावाट)	(नए बस सेक्शन-II)	
(पीआरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन बे का कार्यान्वयन (आवेदन संख्या 2200000673: 148 मेगावाट) 14. 1x330 एमवीएआर 765 केवी बस रिएक्टर (द्वितीय) के साथ-साथ संबद्ध बे की संस्थापना			(आरडीएसएसपीपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन वे का कार्यान्वयन (आवेदन संख्या 2200000639: 350 मेगावाट)	(नए बस सेक्शन-II)	
रिएक्टर (द्वितीय) के साथ-साथ संबद्ध बे केवी बस रिएक्टर: 1 आवंटन की तिथि से 18 की संस्थापना			(पीआरपीएल) के लिए लकड़िया पीएस पर 220 केवी लाइन बे का कार्यान्वयन (आवेदन संख्या 2200000673: 148	1	30.06.2026*
Net T.	1		रिएक्टर (द्वितीय) के साथ-साथ संबद्ध बे की संस्थापना	केवी बस रिएक्टर: 1	आवंटन की तिथि से 18

		• 765 केवी बीआर बे: 1	
15.	लकड़िया पीएस में 1x1500 एमवीए,	• 1500 एमवीएआर,	कार्यान्वयन एजेंसी को
	765/400 केवी आईसीटी द्वारा परिवर्तन	765/400 केवी आईसीटी: 1	आवंटन की तिथि से 18
	क्षमता का विस्तार (तीसरा)	• 400 केवी आईसीटी बे: 1	माह
		• 765 केवी आईसीटी बे: 1	

*कार्यान्वयन एजेंसी को आबंटन की तिथि से न्यूनतम 18 माह की समय-सीमा के अधीन।

नोट:

लकड़िया एस/एस की टीएसपी (डब्ल्यूआरएसएस **XXI(**ए) ट्रांस्को लिमिटेड) लकड़िया एस/एस में उपरोक्त संवर्धन कार्यों के लिए स्थान उपलब्ध कराएगी।

5. गुजरात के राघनेस्दा क्षेत्र से नवीकरणीय ऊर्जा की निकासी के लिए पारेषण प्रणाली – चरण-। के अंतर्गत 3 गीगावाट संभावित कार्यान्वयन की समय-सीमा: एसपीवी अंतरण से 30 माह बीपीसी: पीएफसी कंसल्टिंग लिमिटेड

क्रम सं.
1.



		सेक्शन पर 6)	
		220 केवी सेक्शनलाइजेशन बे: 1 सेट	
		220 केवी बीसी : 1	
		 400 केवी एचवीएसी स्विचयार्ड और सभी 	
		संबंधित उपकरण (फिल्टर सहित)/बस	
		विस्तार आदि के साथ संबद्ध इंटरकनेक्शन	
		सहित 6000 मेगावाट, ± 800 केवी	
		राघनेस्दा (एचवीडीसी) [एलसीसी]	
		टर्मिनल स्टेशन (4x1500 मेगावाट) की	
		संस्थापना।	
	2.	राघनेस्डा (जीआईएस) - बनासकांठा (पीजी) 765	95 किमी
		केवी डी/सी लाइन	
	3.	बनासकांठा (पीजी) एस/एस में 2 765 केबी लाइन	765 केवी लाइन बे – 2
		बे	
	नोट॰		

नोट:

 बनासकांठा एस/एस (पावरग्रिड) की टीएसपी उपरोक्त क्रमांक 3 पर कार्यक्षेत्र के लिए स्थान उपलब्ध कराएगी।.

6. रतले एचईपी (850 मेगावाट) और किरू एचईपी (624 मेगावाट) से विद्युत की निकासी के लिए पारेषण स्कीम: भाग-ए

संभावित कार्यान्वयन की समय-सीमा: एसपीवी अंतरण से 24 माह बीपीसी: आरईसी पावर डेवलपमेंट एंड कंसल्टेंसी लिमिटेड

कार्य-क्षेत्र:

क्रम सं.	पारेषण घटक का विवरण	कार्य-क्षेत्र
		(सबस्टेशन का प्रकार /कंडक्टर
		क्षमता/किमी/बे की संख्या आदि।)
1	किश्तवाड़ एस/एस पर संबद्ध वे सहित किश्तवाड़	लीलो की लंबाई – 3 किमी
	एस/एस पर 400 केवी किंशनपुर-दुलहस्ती लाइन	• 400 केवी किशनपुर-किश्तवाड़ (लीलो
	(ट्विन) का लीलो	सेक्शन) ट्विन एचटीएलएस (न्यूनतम
		2100 एमवीए क्षमता के साथ)
		कॉन्फिगिरेशन पर होगा
		• 400 केवी दुलहस्ती-किश्तवाड़ (लीलो
		सेक्शन) ट्विन ज़ेबरा कॉन्फिगिरेशन
		पर होगा
		• किश्तवाड़ में 400 केवी लाइन बे – 2
		(जीआईएस) (किश्तवाड़ एस/एस छोर
	<u>*</u>	पर लाइन बे को तदनुसार रेट किया
2	400 केवी किशनपुर-सांबा डी/सी लाइन (क्वाड)	जाएगा) लबाई - 36 किमी (क्वाड)
	(किशनपुर में केवल एक सर्किट को समाप्त किया	लबाइ - उठ किमा (क्याड)
	17 (7) (7) (7) (7) (7) (7) (7) (7) (7) (7	
	जाना है, जिसमें किशनूर एस/एस में 400 केवी खाली	
	लाइन बे में से एक का उपयोग किया जाएगा (जो	

	किशनपुर में 400 केवी किश्तवाड़-किशनपुर 400		
	केवी डी/सी लाइन (क्वाड) के एक सर्किट को बाईपास		
	करके बनाया गया है) जबकि दूसरा सर्किट 400 केवी	•	
	किश्तवाड़-किशनपुर लाइन (क्वाड) के बाईपास किए		
		_	
3			
		-	
	लाइन (क्वाड) के एक सर्किट से जोड़ना, इस प्रकार		
	400 केवी किश्तवाड़-सांबा (क्वाड) सीधी लाइन (एक		
	सर्किट) का निर्माण करना।		
4	400 केवी किश्तवाड़-सांबा 400 केवी लाइन-165	•	सांबा एस/एस छोर पर 420 केवी, 80
	किमी (क्वाड) के सांबा छोर पर 1x80 एमवीएआर		एमवीएआर स्विचेबल लाइन रिएक्टर
	स्विचेबल लाइन रिएक्टर [िकशनपुर में 400 केवी		- 1
	किश्तवाड़-किशनपुर लाइन (क्वाड) को बाईपास करने		सांबा एस/एस छोर पर 420 केवी, 80
	और इसे किशनपुर-सांबा 400 केवी डी/सी लाइन		एमवीएआर स्विचेबल लाइन रिएक्टरों
	(क्वाड) के सर्किट में से एक के साथ जोड़ने के बाद		के लिए स्विचिंग उपकरण – 1
	बनाया गया है]		
5	किशनपुर-जालंधर डी/सी सीधी लाइन - 171 किमी	•	जालंधर एस/एस छोर पर 420 केवी,
	(ट्विन) के जालंधर छोर पर प्रत्येक सर्किट पर 1x63		63 एमवीएआर स्विचेबल लाइन
	एमवीएआर स्विचेबल लाइन रिएक्टर (400 केवी		रिएक्टर - 2
	किशनपुर-सांबा डी/सी लाइन (ट्विन) और 400		जालंधर एस/एस छोर पर 420 केवी,
	केवी सांबा-जालंधर के दोनों सर्किट को बायपास		63 एमवीएआर स्विचेबल लाइन
	करने के बाद बनाया गया है) सांबा में डी/सी लाइन		रिएक्टरों के लिए स्विचिंग उपकरण –
	(र्दिवन) और उन्हें एक साथ जोड़कर किशनपुर-		2
6			.—
0	, ,	ला	इन की लंबाई - 145 किमी
	9		
			i
7			
′		•	सांबा एस/एस छोर पर 420 केवी, 80
			एमवीएआर स्विचेबल लाइन रिएक्टर
			-1
		•	सांबा एस/एस छोर पर 420 केवी, 80
			एमवीएआर स्विचेबल लाइन रिएक्टरों
			के लिए स्विचिंग उपकरण – 1
	ह, इस प्रकार साबा-नकादर लाइन (क्वाड) का निर्माण		
		केवी डी/सी लाइन (क्वाड) के एक सर्किट को बाईपास करके बनाया गया है) जबिक दूसरा सर्किट 400 केवी किश्तवाइ-िकशनपुर लाइन (क्वाड) के बाईपास किए गए सर्किट से जोड़ा जाएगा) 3 किशनपुर में 400 केवी किश्तवाइ-िकशनपुर 400 केवी डी/सी लाइन (क्वाड) के एक सर्किट को बाईपास करना तथा इसे किशनपुर-सांबा 400 केवी डी/सी लाइन (क्वाड) के एक सर्किट से जोड़ना, इस प्रकार 400 केवी किश्तवाइ-सांबा (क्वाड) सीधी लाइन (एक सर्किट) का निर्माण करना। 4 400 केवी किश्तवाइ-सांबा (क्वाड) सीधी लाइन (एक सर्किट) का निर्माण करना। 4 400 केवी किश्तवाइ-सांबा 400 केवी लाइन-165 किमी (क्वाड) के सांबा छोर पर 1x80 एमवीएआर स्विचेबल लाइन रिएक्टर [िकशनपुर में 400 केवी किश्तवाइ-िकशनपुर नाइन (क्वाड) को बाईपास करने और इसे किशनपुर-सांबा 400 केवी डी/सी लाइन (क्वाड) के सर्किट में से एक के साथ जोड़ने के बाद बनाया गया है] 5 किशनपुर-जालंधर डी/सी सीधी लाइन - 171 किमी (ट्विन) के जालंधर छोर पर प्रत्येक सर्किट पर 1x63 एमवीएआर स्विचेबल लाइन रिएक्टर (400 केवी किशनपुर-सांबा डी/सी लाइन (ट्विन) और 400 केवी सांबा-जालंधर के दोनों सर्किट को बायपास करने के बाद बनाया गया है) सांवा में डी/सी लाइन (ट्विन) और उन्हें एक साथ जोड़कर किशनपुर-जालंधर डी/सी सीधी लाइन (ट्विन) बनाई गई) 6 400 केवी साम्बा- जालंधर डी/सी लाइन (क्वाड) (जालंधर में केवल एक सर्किट को समाप्त किया जाना है, जिसके लिए जालंधर एस/एस में 400 केवी खाली लाइन बे में से एक का उपयोग किया जाएगा (जालंधर में 400 केवी जालंधर-नकोदर लाइन (क्वाड) को बाईपास करके बनाया गया है) जबिक दूसरा सर्किट जालंधर-नकोदर 400 केवी लाइन (क्वाड) के बाईपास करके बनाया गया है) जबिक दूसरा सर्किट जालंधर-नकोदर 400 केवी लाइन (क्वाड) के बाईपास करके बनाया गया है) जबिक दूसरा सर्किट जालंधर-नकोदर 400 केवी लाइन	किशनपुर में 400 केवी किश्तवाड़-किशनपुर 400 केवी डी/सी लाइन (क्वाड) के एक सर्किट को वाईपास करना तथा इसे किशनपुर-सांबा 400 केवी डी/सी लाइन (क्वाड) के एक सर्किट से जोड़ना, इस प्रकार 400 केवी किश्तवाड़-सांबा (क्वाड) सीधी लाइन (एक सर्किट) का निर्माण करना। 4



	हुआ है।	
8	जालंधर में 400 केवी जालंधर-नकोदर लाइन (क्वाड)	
	को बाईपास करना और इसे सांबा-जालंधर 400	
	केवी डी/सी लाइन (क्वाड मूज़) के सर्किट में से एक के	
	साथ जोड़ना, इस प्रकार 400 केवी सांबा-नकोदर	
	(क्वाड) सीधी लाइन बनाना	

नोट:

- मैसर्स स्टरलाइट किश्तवाड़ में 400 केवी लाइन बे (जीआईएस) में से 2 के लिए स्थान उपलब्ध कराएगा
- मैसर्स पावरग्रिड 400 केवी किश्तवाड़-सांबा 400 केवी लाइन के सांबा छोर पर 1 (एक) 80 एमवीएआर स्विचेवल लाइन रिएक्टर (स्विचिंग उपकरण सिहत) के लिए स्थान उपलब्ध कराएगा।
- मैसर्स पावरग्रिड किशनपुर-जालंधर डी/सी सीधी लाइन (प्रत्येक सर्किट पर) के जालंधर छोर पर 2 (दो)
 63 एमवीएआर स्विचेबल लाइन रिएक्टर (स्विचिंग उपकरण के साथ) के लिए स्थान उपलब्ध कराएगा।
- मैसर्स पावरग्रिङ सांबा-नकोदर सीधी लाइन के सांबा छोर पर 1 (एक) 80 एमवीएआर स्विचेबल लाइन रिएक्टर (स्विचिंग उपकरण के साथ) के लिए स्थान उपलब्ध कराएगा।

अतिरिक्त नवीकरणीय ऊर्जा उत्पादन परियोजनाओं के एकीकरण के लिए कुर्नूल-III पीएस में पारेषण प्रणाली को सुदृढ़ करना

संभावित कार्यान्वयन समय-सीमा:

- i. पैकेज ए 24 माह
- ii. पैकेज बी जून 2025 से दिसंबर 2027 तक क्रमिक रूप से
- iii. पैकेज सी 24 माह

बीपीसी: पीएफसी कंसल्टिंग लिमिटेड

कार्य-क्षेत्र:

पै	केज	पारेषण स्कीम का कार्य-क्षेत्र	क्षमता/किमी	अनुसूची
		,,	• 3x1500 एमवीए, 765/400 केवी	
		एमवीए, 765/400 केवी आईसीर्ट		
		द्वारा परिवर्तन क्षमता का विस्तार	 765 केवी आईसीटी बे – 3 	
			• 400 केवी आईसीटी बे – 3	
			• 400 केवी बस सेक्शनलाइज़र - 1 सेट	
		दोनों छोर पर 240 एमवीएआ	~ 260 किमी	
	- 1	स्विचेबल लाइन रिएक्टर के साथ	_ (3 %	
1	ए	कुर्नूल-III पीएस – चिलकलुरिपेट	पीएस पर)	24 माह
		765 केवी डी/सी लाइन	• 765 केवी लाइन बे – 2 (चिलकलुरिपेटा	
			पर)	
			• 765 केवी, 240 एमवीएआर	
			एसएलआर कुर्नूल-III पीएस-2 (6x80	
			एमवीएआर यूनिट)	
			• चिलकलुरिपेटा में 765 केवी, 240	
			एमवीएआर एसएलआर - टीई2 (6x80	



	एमवीएआर यूनिट)	
	मैसर्स अदानी रिन्यूएबल एनर्जी • 400 केवी लाइन बे – 2 फोर्टी टू लिमिटेड की समर्पित पारेषण लाइन की समाप्ति के लिए कुर्नूल-III पीएस में 2 (दो) 400 केवी लाइन बे	0.06.26
	मैसर्स इंडोसोल सोलर प्राइवेट • 400 केवी लाइन बे – 1	0.06.25
-4	लिमिटेड की समर्पित पारेषण • 400 केवी लाइन बे – 1 लाइनों की समाप्ति के लिए कुर्नूल-III	4 माह
٩	11 1140 6 4 4 4 4 4 4 4 4 4 4 4 4 4 4 4 4 4 4	1.03.27
	मेसर्स अदानी रिन्यूएबल एनर्जी • 400 केवी लाइन बे – 2 फिफ्टी वन लिमिटेड की समर्पित पारेषण लाइन की समाप्ति के लिए कुरनूल-III पीएस में 2 (दो) 400	1.12.27
	केवी लाइन बे	
	कुर्नूल-II पीएस पर 1x1500 • 1x1500 एमवीए, 765/400 केवी 24 एमवीए 765/400 केवी आईसीटी आईसीटी	1 माह
ग	(7वां) का विस्तार • 765 केवी आईसीटी बे – 1	
	 400 केवी आईसीटी बे – 1 	

2. बोली प्रक्रिया समन्वयक की नियुक्ति इस संबंध में विद्युत मंत्रालय द्वारा समय-समय पर संशोधित दिशानिर्देशों में निर्धारित शर्तों के अध्यधीन है।

[फा. सं. 15/3/2018-ट्रांस-पार्ट(4)]

नाओरेम इंद्रकुमार सिंह, अवर सचिव (पारेषण)

MINISTRY OF POWER NOTIFICATION

New Delhi, the 20th August, 2024

S.O. 3545(E).—In exercise of the powers conferred by sub-para 3.2 of Para 3 of the Guidelines circulated under Section 63 of the Electricity Act, 2003 (No. 36 of 2003), the Central Government, on the recommendations of 20th meeting of National Committee on Transmission, hereby notifies the following transmission schemes under TBCB mode, with details of respective Bid-Process Coordinators (BPCs): -

	Vame &	Scope of the Transmission Scheme	
N	Network Expansion scheme in Western Region to cater to Pumped storage potential near Talegaon (Pun		
T	entative	e implementation timeframe : 01.01.2027 subjet/transfer	ect to minimum implementation schedule of 24 mont
		EC Power Development and Consultancy Lin	nited
	cope:	EC Power Development and Consultancy Lin	Capacity (MVA) / Route Length (Km)



-			
Γ		Future provision (space for):	
		> 765/400 kV ICT along with bays-	10 400 kV ICT bays – 2 Nos.
١.		Nos. (2 Nos. on Sec-I, 4 Nos. in Sec-I	I &
1		4 Nos. on Sec-III)	765 kV Line bays – 4 Nos.
1		> 765 kV line bays along with switch	able
	- 1 1		I & 330 MVAr, 765 kV bus reactor- 2 Nos. (7x110
		2 Nos. on Sec-III)	MVAR single phase Reactors including one spare
	11	> 765 kV Bus Reactor along with bay	
	11	Nos. (2 Nos. on Sec-II & 2 No. on S	• • • • • • • • • • • • • • • • • • • •
	11	III)	765 kV Bus reactor bay – 2 Nos.
1		> 765 kV Sectionaliser: 2 -sets	
	11	> 400 kV line bays along with switch	
	11	line reactors- 20 Nos. (6 Nos. on Sec-	1, 6
1		Nos. on Sec- II & 8 Nos. on Sec-III)	400 kV Reactor bay- 2 Nos.
1		> 400/220 kV ICT along with bays -4 N	
			kV 400 kV line bays - 2 Nos. (for interconnection of
1		Sec-I & 2 Nos. on 220 kV Sec-II)	PSP)
		> 400 kV Bus Reactor along with bays	1
		Nos. (2 Nos. on Sec-II & 2 No. on S	1
		and the second s	
		III)	
1		> 400 kV Sectionalization bay: 2- set	
		> 220 kV line bays: 8 Nos. (4 Nos. on Se	C-I
1		& 4 Nos. on Sec-II)	1
		> 220 kV Sectionalization bay: 1 set	1
		> 220 kV BC and TBC: 2 Nos.	
		Establishment of 6000 MW, ± 800	kV
		South Kalamb (HVDC) [LCC] termi	nal
1		station (4x1500 MW) along w	ith
		associated interconnections with 400	kV
		HVAC Switchyard (2x1500 MW on 4	00
1	II	kV Sec-I & 2x1500 MW on 400 kV S	
		II) & all associated equipment (in	. 1
		filters)/bus extension, etc.	
	15	2. LILO of Pune-III – Boisar-II 765 kV D/c I	ne LILO Route length: 40 km (160 ckm.)
	1 [at South Kalamb S/s with associated bays	
	П	South Kalamb S/s with associated bays	The second control of
ĺ		South Kalanio 5/5	Hexa Zebra configuration and LILO shall be of
	1 -		similar conductor configuration
	3	Installation of 1x240 MVAr switchable li	,
		reactor on each ckt at South Kalamb end	
		Boisar-II – South Kalamb 765 kV D/c li	
	П	(formed after above LILO)	Nos.
			 Spare Reactor (1-ph, 1x80 MVAr) unit at 765/400
			kV South Kalamb S/s
2.	Pro	ovision of ICT Augmentation & Bus Reactor at I	Shuj-II PS
		ntative implementation timeframe: 21 months from	
		C: PFC Consulting Limited	
	Sco	_	
		No. Scope of the Transmission Scheme	Capacity (MVA)/ Route Length (Km)
	1.	Augmentation of transformation capacity a	
	l*.	Bhuj-II PS (GIS) by 3x500 MVA, 400/220 kV	
		ICT (7th, 8th & 9th)	V 2 2 V 1 1 2 V 1 1 2 V 1 1 2 V 1 1 2 V 1 1 2 V 1 1 2 V 1 2 V 1 1 2 V 1
		[C 1 (/til, otil & 7til)	400 kV ICT bays: 3 No. (with addl. 3 Nos. for dia
			completion)
			land Ly rom i a si
	_		220 kV ICT bays: 3 No
	2.	Augmentation of transformation capacity at	
		Bhuj-II PS (GIS) by 1x1500 MVA, 765/400	l
		kV ICT (4th)	765 kV ICT bay: 1 No. (with addl. 1 No. for dia
			completion)
1		1	1 1

		400 kV ICT bay: Nil. (1 No. considered at SI. No.1 above)
3.	Installation of 1x330 MVAr 765 kV Bus Reactor (2nd) along-with associated bay	
4.	Implementation of 220 kV GIS line bay at Bhuj-II PS for Aditya Birla Renewables Subsidiary Limited (ABRSL) [Appln No: 2200000321(362MW)]	
5.	Implementation of 220 kV GIS line bay at Bhuj-II PS for ACME Cleantech Solutions Private Limited (ACSPL) [Appln No: 2200000382(350 MW)]	
6.	Implementation of 220 kV GIS line bay at Bhuj-II PS for ACME Cleantech Solutions Private Limited (ACSPL) [Appln No: 2200000431(50 MW)]	
7.	Implementation of 220 kV GIS line bay at Bhuj-II PS for Avaada Energy Pvt Ltd. (AEPL) [Appl. No: 2200000444(100 MW)]	220 kV line bay – 1 No. (GIS) (Bus Sec-II)
8.	Implementation of 220 kV GIS line bays at Bhuj-II PS for Adani Green Energy Thirty-Two Ltd. (AGE32L) [Appl. No: 2200000514 (260.5MW)]	220 kV line bay – 1 No. (GIS) (Bus Sec-II)
),	Implementation of 220 kV GIS line bays at Bhuj-II PS for Adani Renewable Energy Eight Ltd. (ARE8L) [Appl. No: 2200000545 (115MW)]	220 kV line bay – 1 No. (GIS) (Bus Sec-II)

Transmission System for evacuation of power from Mahan Energen Limited Generating Station in Madhya Pradesh

Tentative Implementation Time: 30 months from SPV transfer

BPC: PFC Consulting Limited

Scope:

SI. No.	Scope of the Transmission Scheme	Capacity /km
3.	Mahan (existing bus) – Rewa PS (PG) 400 kV D/c (Quad ACSR/AAAC/AL59 moose equivalent)line	110 km.
	2 Nos. 400 kV bays at Rewa PS (PG) for termination of Mahan (existing bus) – Rewa PS (PG) 400 kV D/c line (Quad ACSR/AAAC/AL59 moose equivalent)line	400 kV bays: 2 Nos. *

Note:

- 2 Nos. 400 kV line bays at MEL (existing) shall be under the scope of MEL
- POWERGRID to provide space at Rewa PS (PG) for scope at Sl. 2
- Transmission system for Augmentation of transformation capacity at 765/400 kV Lakadia S/s (WRSS XXI(A) Transco Ltd) in Gujarat – Part B

Tentative Implementation Time: As per Detailed Scope

BPC: REC Power Development and Consultancy Limited

Scope:

SI. No.	Scope of the Transmission Scheme	Capacity /km	Time-frame
1.	Installation of 2x500 MVA, 400/220 kV	• 400/220 kV, 1x500 MVA	18 months from date of
	ICTs (3rd & 4th) at Lakadia PS along		allocation to
	with associated ICT bays	 400 kV ICT bay – 2 Nos. 	implementing agency



		• 220 kV ICT bay – 2 Nos (220 kV bus section-I)	
2.	Implementation of 220 kV line bay a Lakadia PS for TEQ Green Power XVII Private Limited (TGPXVIIPL: 300 MW)	(220 kV bus section-I)	allocation t implementing agency
3.	Implementation of 220 kV line bay at Lakadia PS for Arcelor Mittal Nippon Steel India Limited (AMNSIL: 350 MW)	(220 kV bus section-I)	allocation timplementing agency
4.	Implementation of 220 kV line bay at Lakadia PS for Renew Solar (Shakti Eight) Private Limited (RS(S8)PL: 200 MW)	(220 kV bus section-I)	30.09.2026 (as per star date requested b applicant)*
5.	Creation of New 220 kV Bus Section-II at Lakadia PS along with 220 kV Sectionaliser arrangement between 220 kV Bus sec-I & Sec-II	1 set • BC – 1 No. • TBC – 1 No.	allocation to implementing agency
6.	Augmentation of transformation capacity 400/220 kV ICTs (5 th 6 th , 7 th & 8 th) te Section-II	rminated on new 220 kV Bus	,
62	a2x500MVA ICTs (5 th & 6 th)	 500 MVA, 400/220 kV ICTs: 2 No. 400 kV ICT bays: 2 Nos. 220 kV ICT bays: 2 No. (New Bus Section-II) 	18 months from date of allocation to implementing agency
	lx500MVA ICT (7 th)	• 500 MVA, 400/220 kV ICT: 1 No. • 400 kV ICT bay: 1 No. • 220 kV ICT bays: 1 No. (New Bus Section-II)	31.12.2026
	1x500MVA ICT (8 th)	ICT: 1 No. • 400 kV ICT bay: 1 No. • 220 kV ICT bays: 1 No. (New Bus Section-II)	30.06.2027
	Implementation of 220 kV line bay at Lakadia PS for Juniper Green Energy Private Limited (JGEPL) (Appl. No. 2200000376: 300 MW)	• 220 kV line bay - 1 No. (New Bus Section-II)	30.06.2027 (as per start date requested by applicant)
	Implementation of 220 kV line bay at Lakadia PS for TEQ Green Power XVI Pvt. Ltd. (TGPXVIPL) (Appl. No. 2200000398: 76MW)	• 220 kV line bay - 1 No. (New Bus Section-II)	30.09.2026 (as per start date requested by applicant)*
	Implementation of 220 kV line bay at Lakadia PS for Ganeko Solar Pvt. Ltd. (GSPL) (Appl. No. 2200000458: 290 MW)	• 220 kV line bay - 1 No. (New Bus Section-II)	31.12.2026 (as per start date requested by applicant)*
0. I		(New Bus Section-II)	31.03.2027 (as per start date requested by applicant)
1. I I I	Implementation of 220 kV line bay at Lakadia PS for Serentica Renewables India Private Limited (SRIPL) (Appl. No. 2200000610: 200 MW)	• 220 kV line bay - 1 No. (New Bus Section-II)	30.06.2026*
2. I		• 220 kV line bay - 1 No. (New Bus Section-II)	30.06.2026*



	Limited (RDSSPPL) (Appl. No. 2200000639: 350 MW)		
13.	Implementation of 220 kV line bay at Lakadia PS for Percentum Renewables Private Limited (PRPL) (Appl. No. 2200000673: 148 MW)	(New Bus Section-II)	30.06.2026*
14.	Installation of 1x330 MVAr 765 kV Bus Reactor (2nd) along-with associated bay	Reactor: 1 No.	18 months from date of allocation to implementing agency
15.	Augmentation of transformation capacity at Lakadia PS by 1x1500 MVA, 765/400 kV ICTs (3rd)	• 1500 MVA, 765/400 kV ICT: 1 No.	18 months from date of allocation to implementing agency

Note:

TSP of Lakadia S/s (WRSS XXI(A) Transco Ltd.) shall provide space for above augmentation works at Lakadia S/s

5. Transmission system for evacuation of RE power from Raghanesda area of Gujarat – 3 GW under Phase-I

Tentative Implementation Time: 30 months from SPV transfer

BPC: PFC Consulting Limited

Scope

oe:		
SI.	Scope of the Transmission Scheme	Capacity /km
No.		2
1.	Establishment of 3x1500 MVA, 765/400 kV	
	Substation near Raghanesda (GIS) with 2x330	
	MVAR, 765 kV bus reactor and 2x125 MVAR,	including one spare ICT Unit)
	420 kV bus reactor	• 765 kV ICT bays – 3 Nos.
	Future provision (space for):	• 400 kV ICT bays – 3 Nos.
	> 765/400 kV ICT along with bays- 5 Nos. (1 No. in Sec-I & 4 Nos. on Sec-II)	• 765 kV Line bays – 2 Nos.
	> 765 kV line bays along with switchable	• 1x330 MVAr, 765 kV bus reactor- 2
	line reactors – 10 Nos. (4 Nos. on Sec-I	Nos. (7x110 MVAR single phase
	& 6 Nos. on Sec-II) > 765 kV Bus Reactor along with have 2	Reactors including one spare Unit for
	> 765 kV Bus Reactor along with bay: 2 Nos. (on Sec-II)	bus /line reactor)
	> 765 kV Sectionaliser: 1 -set	 765 kV Bus reactor bay – 2 Nos.
	> 400 kV line bays along with switchable	• 125 MVAr, 420 kV reactor- 2 Nos.
	line reactors—12 Nos. (4 Nos. on Sec-I &	
	8 Nos. on Sec-II)	 400 kV Reactor bay- 2 Nos.
	> 400/220 kV ICT along with bays - 8 Nos.	• 400 kV line bays - 4 Nos. (for
	(4 Nos. on each 400 kV Section)	interconnection of RE Projects)
	➤ 400 kV Bus Reactor along with bays: 2	
	Nos. (Sec-II)	
	➤ 400 kV Sectionalization bay: 1- set	
	> 220 kV line bays: 12 Nos. (6 Nos. on	
	each 220 kV Section)	
	> 220 kV Sectionalization bay: 1 set	
	> 220 kV BC: 1 No.	1
-	Establishment of 6000 MW, ± 800 kV	
	Raghanesda (HVDC) [LCC] terminal station (4x1500 MW) along with	
	station (4x1500 MW) along with	



		associated interconnections with 400 kV HVAC Switchyard & all associated equipment (incl. filters)/bus extension, etc.	
	2.	Raghanesda (GIS) - Banaskantha (PG) 765 kV D/c line	95 km
	3.	2 Nos. 765 kV line bays at Banaskantha (PG) S/s	765 kV line bays – 2 Nos.
l N	ote:		

- TSP of Banaskantha S/s (POWERGRID) shall provide space for scope at Sl. 3 above.
- 6. Transmission scheme for evacuation of power from Ratle HEP (850 MW) & Kiru HEP (624 MW): Part-A

Tentative Implementation Time: 24 months from SPV transfer

BPC: REC Power Development and Consultancy Limited

Scope:

16

	D it of the contract of the co	
SI. No.	Description of Transmission Element	Scope of work (Type of Substation/Conductor capacity/km/no. of bays etc.)
		on principly ration of Edge Cool)
1	LILO of 400 kV Kishenpur- Dulhasti line (Twin) at Kishtwar S/s along with associated bays at Kishtwar S/s	
		configuration •400 kV line bays at Kishtwar – 2 Nos. (GIS) (line bays at Kishtwar S/s end shall be rated accordingly)
2	400 kV Kishenpur-Samba D/c line (Quad)	Length -36 km (Quad)
	(only one circuit is to be terminated at Kishenpur utilizing 1 no. of 400 kV vacated line bay at	
	Kishenur S/s (formed with bypassing of one ckt of	
	400 kV Kishtwar – Kishenpur 400 kV D/c line	1
	(Quad) at Kishenpur) while second circuit would	
	be connected to bypassed circuit of 400 kV	
	Kishtwar – Kishenpur line (Quad))	
3	Bypassing of one ckt of 400 kV Kishtwar –	
	Kishenpur 400 kV D/c line (Quad) at Kishenpur	
	and connecting it with one of the circuit of Kishenpur-Samba 400 kV D/c line(Quad), thus	
	forming 400 kV Kishtwar - Samba (Quad) direct	
	line (one ckt)	
4	1x80 MVAr Switchable line reactor at Samba end	•420 kV 80 MVAr switchable line
	of 400 kV Kishtwar-Samba 400 kV line-165 km	reactors at Samba S/s end- 1 Nos.
	(Quad) [formed after bypassing of 400 kV	
		Switching equipment for 420 kV, 80
	and connecting it with one of the circuit of	MVAr switchable line reactors at Samba
	Kishenpur-Samba 400 kV D/c line(Quad))	S/s end – 1 no
5	1x63 MVAr Switchable line reactor on each ckt at	
	Jallandhar end of Kishenpur- Jalandhar D/c direct	reactors at Jallandhar S/s end-2 Nos.
	line -171km(Twin) (formed after bypassing both	
	ckts of 400 kV Kishenpur - Samba D/c line	•Switching equipment for 420 kV, 63

-	-		-	
			(Twin) & 400 kV Samba - Jalandhar D/c line	
			(Twin) at Samba and connecting them together to	Jallandhar S/s end – 2 no
1			form Kishenpur- Jalandhar D/c direct line (Twin))	
		6	400 kV Samba- Jalandhar D/c line(Quad)	Line Length -145 km
			(only one circuit is to be terminated at Jalandhar	
1	1		utilizing 1 no. of 400 kV vacated line bay at	
1			Jalandhar S/s (formed with bypassing of 400 kV	
1			Jalandhar - Nakodar line (Quad) at Jalandhar)	
1	1		while second circuit would be connected to	
			bypassed circuit of Jalandhar -Nakodar 400 kV	
			line (Quad))	
		7	1x80 MVAr Switchable line reactor at Samba end	•420 kV, 80 MVAr switchable line
1			of Samba -Nakodar direct line (Quad) (187km)	
			formed after bypassing of 400 kV Jalandhar -	
			Nakodar line (Quad) at Jalandhar and connecting it	
			with one of the circuit of Samba-Jalandhar 400 kV	S/s end – 1 no.
	1 1		D/c line(Quad Moose), thus forming Samba -	
			Nakodar line (Quad)	
		8	Bypassing 400 kV Jalandhar - Nakodar line	
			(Quad) at Jalandhar and connecting it with one of	
			the circuit of Samba-Jalandhar 400 kV D/c	
			line(Quad Moose), thus forming 400 kV Samba -	
			Nakodar (Quad) direct line	
	No.	ite:		

- M/s Sterlite shall provide space for 2 Nos. of 400 kV line bays (GIS) at Kishtwar S/s
- M/s POWERGRID shall provide space for 1 no. 80 MVAr Switchable line reactor (along with switching equipment) at Samba end of 400 kV Kishtwar-Samba 400 kV line
- M/s POWERGRID shall provide space for 2 Nos. 63 MVAr Switchable line reactor (along with switching equipment) at Jallandhar end of Kishenpur-Jalandhar D/c direct line (on each ckt)
- M/s POWERGRID shall provide space for 1 no. 80 MVAr Switchable line reactor (along with switching equipment) at Samba end of Samba -Nakodar direct line

Transmission system strengthening at Kurnool-III PS for integration of additional RE generation projects Tentative Implementation Time:

- i. Package A-24 months
- Package B progressively from June'25 to Dec'27 ii.
- Package C 24 months

BPC: PFC Consulting Limited

Scope:

Pack	Scope of the Transmission	Capacity /km	Schedule
age	Scheme		
A	Augmentation of transformation capacity by 3x1500 MVA, 765/400 kV ICTs at Kurnool-III PS Kurnool-III PS — Chilakaluripeta 765 kV D/c line with 240 MVAr switchable line reactors at both ends	 400 kV ICT bay – 3 Nos. 400 kV Bus Sectionaliser – 1 Set 260 km 765 kV line bays – 2 Nos. (at Kurnool-III PS) 	24 months
В	2 Nos. of 400 kV line bays at Kurnool-III PS for termination of dedicated transmission line of M/s	• 400 kV line bays – 2 Nos.	30.06.26



	Adani Renewable Energy Forty Two Ltd.		
	4 Nos. of 400 kV line bay at Kurnool-III PS for termination of	• 400 kV line bays – 1 Nos.	30.06.25
	dedicated transmission lines of M/s	• 400 kV line bays – 1 Nos.	24 months
	Indosol Solar Pvt. Ltd.	• 400 kV line bays – 2 Nos.	31.03.27
	2 Nos. of 400 kV line bays at Kurnool-III PS for termination of dedicated transmission line of M/s Adani Renewable Energy Fifty One Ltd.	• 400 kV line bays – 2 Nos.	31.12.27
c	Augmentation of 1x1500 MVA 765/400 kV ICT (7 th) at Kurnool-II	•	24 months
	PS	 400 kV ICT bay – 1 Nos. 	

2. The appointment of the Bid Process Coordinator is subject to the conditions laid down in the Guidelines issued by Ministry of Power in this regard, amended from time to time.

[F. No. 15/3/2018- Trans- Part(4)]

NAOREM INDRAKUMAR SINGH, Under Secy. (Transmission)



Annexure A2



GOVERNMENT OF INDIA MINISTRY OF CORPORATE AFFAIRS

Central Registration Centre

Certificate of Incorporation

[Pursuant to sub-section (2) of section 7 and sub-section (1) of section 8 of the Companies Act, 2013 (18 of 2013) and rule 18 of the Companies (Incorporation) Rules, 2014]

I hereby certify that WRNES TALEGAON POWER TRANSMISSION LIMITED is incorporated on this SIXTEENTH day of NOVEMBER TWO THOUSAND TWENTY FOUR under the Companies Act, 2013 (18 of 2013) and that the company is Company limited by shares

The Corporate Identity Number of the company is U42202DL2024GOI438750

The Permanent Account Number (PAN) of the company is AADCW9659F*

The Tax Deduction and Collection Account Number (TAN) of the company is DELW07420A*

Given under my hand at Manesar this SIXTEENTH day of NOVEMBER TWO THOUSAND TWENTY FOUR

Certification signature by DS MINISTRY OF CORPORATE AFFAIRS, CRC MANESAB - ROC CRC@MCA.GOV.IN: Validity Unknown

Digitally signed b DŠ MIŇISŤRY ORPORATE AFFAIRS, CROMANESAR 1 Date: 2024.11.18 08:20:59 IST

Balagangatharan Ramesh

Assistant Registrar of Companies/ Deputy Registrar of Companies/ Registrar of Companies

For and on behalf of the Jurisdictional Registrar of Companies

Registrar of Companies

Central Registration Centre

Disclaimer: This certificate only evidences incorporation of the company on the basis of documents and declarations of the applicant(s). This certificate is neither a license nor permission to conduct business or solicit deposits or funds from public. Permission of sector regulator is necessary wherever required. Registration status and other details of the company can be verified on mca.gov.in

Mailing Address as per record available in Registrar of Companies office:

WRNES TALEGAON POWER TRANSMISSION LIMITED

CORE-4, SCOPE COMPLEX, 7, LODHI ROAD, Lodi Road, New Delhi, South Delhi- 110003, Delhi

*as issued by Income tax Department



Annexure A3

Form No. INC-33

e-MOA (e-Memorandum of Association)

[Pursuant to Schedule I (see Sections 4 and 5) to the Companies Act, 2013)]



Form language

English

C Hindi

Refer instruction kit for filing the form

All fields marked in * are mandatory

* Table applicable to company as notified under schedule I of the Companies Act, 2013

- (A MEMORANDUM OF ASSOCIATION OF A COMPANY LIMITED BY SHARES
- B MEMORANDUM OF ASSOCIATION OF A COMPANY LIMITED BY GUARANTEE AND NOT HAVING A SHARE CAPITAL
- C MEMORANDUM OF ASSOCIATION OF A COMPANY LIMITED BY GUARANTEE AND HAVING A SHARE CAPITAL
- D MEMORANDUM OF ASSOCIATION OF AN UNLIMITED COMPANY AND NOT HAVING SHARE CAPITAL
- E MEMORANDUM OF ASSOCIATION OF AN UNLIMITED COMPANY AND HAVING SHARE CAPITAL)

Table A/B/C/D/E

- 1 The name of the company is
- 2 The registered office of the company will be situated in the State of
- 3 (a) The objects to be pursued by the company on its incorporation are:

A - MEMORANDUM OF ASSOCIATION OF A COMPANY LIMITED BY SHARES

WRNES TALEGAON POWER TRANSMISSION LIMITED

Delhi

1.To plan, promote and develop an integrated and efficient power transmission system network in all its aspects including planning, investigation, research, design and engineering, preparation of preliminary, feasibility and definite project reports, construction, operation and maintenance of transmission lines, sub-stations, load dispatch stations and communication facilities and appurtenant works, coordination of integrated operation of regional and national grid system, execution of turn-key jobs for other utilities/organizations and wheeling of power in accordance with the policies, guidelines and objectives laid down by the Central Government from time to time.

2. To study, investigate, collect information and data, review operation, plan, research, design and prepare Report, diagnose operational difficulties and weaknesses and advise on the



remedial measures to improve, undertake development of new and innovative product connected with business of the Company as well as modernize existing EHV, HV lines and SubStations.

3.To act as consultants, technical advisors, surveyors and providers of technical and other services to Public or Private Sector enterprises engaged in the planning, investigation, research, design and preparations of preliminary, feasibility and definite project reports. manufacture of power plant and equipment, construction. generation, operation and maintenance of power transmission system from power generating stations and projects. transmission and distribution of

4. To plan, promote, develop, erect and maintain, operate and otherwise deal in Telecommunication networks and services in all its aspects including planning, investigation, research, design and engineering, preparation of preliminary, feasibility and definite project reports: to purchase, sell, import, export, assemble, manufacture, install, commission, maintain, operate commercially whether on own or along with other, on lease or otherwise. These networks and for such purposes to set up and/ or install all requisite communications facilities and other facilities including fibre optic links, digital microwave links, communication cables, other telecommunication means, telephone and other exchanges, co-axial stations, microwave stations, repeater stations, security system databases, billing systems, subscriber management systems and other communication systems whether consisting of sound, visual impulse, or otherwise, existing or that may be developed or invented in the future and to



manufacture, purchase, sell, import, export, assemble, take or give on lease/rental/subscription basis or by similar means or otherwise deal in all components and other support and ancillary hardware and software systems, accessories, parts and equipments etc. used in or in connection with the operation of the above communication systems and networks including to deal with telecommunication operations or directly with the general public, commercial companies or otherwise.

1.To obtain license, approvals and authorization from Governmental Statutory and Regulatory Authorities, as may be necessary to carry out and achieve the Objects of the Company and connected matters which may seem expedient to develop the business interests of the Company in India and abroad.

2.To enter into any arrangement with the Government of India or with any State Government or with other authorities/ commissions, local bodies or public sector or private sector undertakings, Power Utilities, Financial Institutions, Banks, International Funding Agencies and obtain such charters, subsidies, loans, advances or other money, grants, contracts, rights, sanctions, privileges, licenses or concessions whatsoever (whether statutory

otherwise) which the Company may think it desirable to obtain for carrying its activities in furthering the interests of the Company or its members. 3.To enter into any agreement, contract or any arrangement for the implementation of the power generation, evacuation, transmission and distribution system and network with Power/ Transmission Utilities, State Electricity Boards, Vidhyut Boards, Transmission

(b) *Matters which are necessary for furtherance of the objects specified in clause 3(a) are



Companies, Generation Companies, Licensees, Statutory bodies, other organizations (whether in Private, Public or Joint Sector Undertaking) and bulk consumers of power etc. 4.To secure the payments of money, receivables on transmission and distribution of electricity and sale of fuel, as the case may be, to the State Electricity Boards, Vidyut Boards, Transmission Utilities, Generating Companies, Transmission Companies, Distribution Companies, State Governments, Licensees, statutory bodies, other organizations (whether in Private, Public or Joint Sector Undertaking) and bulk consumers of power etc. through Letter of Credits/ESCROW and other security documents. 5.To coordinate with the Central Transmission Utility of electricity generated by it under the relevant provisions of Electricity Act 2003 and any amendments thereto. 6.Subject to provisions of Sections 73, 74, 179, 180 & 186 and other applicable provisions of the Companies Act, 2013 and rules made thereunder and subject to other laws or directives, if any, of SEBI/RBI, to borrow money in Indian rupees or foreign currencies and obtain foreign lines of credits/ grants/ aids etc. or to receive money or deposits from public for the purpose of the Company's business in such manner and on such terms and with such rights, privileges and obligations as the Company may think fit. The Company may issue bonds/ debentures whether secured or unsecured; bills of exchange, promissory notes or other securities, mortgage or charge on all or any of the immovable and movable properties, present or future and all or any of the uncalled capital for the time being of the Company as the



Company may deem fit and To repay, redeem or pay off any such securities or charges. 7.To lend money on property or on mortgage of immovable properties or against Bank guarantee and to make advances of money against future supply of goods and services on such terms as the Directors may consider necessary and to invest money of the Company in such manner as the Directors may think fit and to sell, transfer or to deal with the same. 8.To own, possess, acquire by purchase, lease or otherwise rights, title and interests in and to, exchange or hire real estate, equipment, Transmission lines, lands, buildings, apartments, plants, equipment, machinery, fuel blocks and hereditaments of any tenure or descriptions situated in India or abroad or any estate or interest therein and any right over or connected with land so situated and turn the same to account in any manner as may seem necessary or convenient for the purpose of business of the Company and to hold, improve, exploit, reorganize, manage, lease, sell, exchange or otherwise dispose of the whole or any part thereof. 9.Subject to applicable provisions of Companies Act, 2013, to subscribe for, underwrite, or otherwise acquire, hold, dispose of and deal with the shares, stocks, debentures or other securities and titles of indebtedness or the right to participate in profits or other similar documents issued by any Government authority, Corporation or body or by any company or body of persons and any option or right in respect thereof. 10.To create any depreciation fund, reserve fund, sinking fund, insurance fund, gratuity, provident fund or any other



fund, for depreciation or for repairing, improving extendingor

maintaining any of the properties of the Company or for any other purposes whatsoever conducive to the interests of the Company.

11.To acquire shares, stocks, debentures or securities of any company carrying on any business which this Company is entitled to carry on or acquisition of undertaking itself which may seem likely or calculated to promote or advance the interests of the Company and to sell or dispose of or transfer any such shares, stocks or securities and the acquired undertaking. 12.To enter into partnership or into any agreement for joint working, sharing or pooling profits, joint venture, amalgamation, union of interests, co-operation, reciprocal concessions or otherwise or amalgamate with any person or company carrying on or engaged in or about to carry on or engaged in any business or transaction in India or abroad which the Company is authorized to carry on or engage in any business undertaking having objects identical or similar to, as are being carried on by this Company. 13.To establish and maintain

agencies, branch offices and local agencies, to procure business in any part of India and world and to take such steps as may be necessary to give the Company such rights and privileges in any part of the world as deemed proper in the interest of the Company.

14.To promote and undertake the formation of any institution or Company or subsidiary company or for any aforesaid objects intended to benefit the Company directly or indirectly and to coordinate, control and guide their activities.

15(a).To negotiate and enter into agreements and contracts with domestic and foreign companies,



persons or other organizations, banks and financial institutions, in relation to the business of the Company including that of technical know-how, import, export, purchase or sale of plant. machinery, equipment, tools, accessories and consumables, financial assistance and for carrying out all or any of the objects of the Company. 15(b). To negotiate and enter agreements and contracts for execution of turnkey jobs, works, supplies and export of plant, machinery, tools and accessories 16. Upon and for the purpose of any issue of shares, debentures or any other securities of the Company, to enter into agreement with intermediaries including brokers, managers of issue/commission agents and underwriters and to provide for the remuneration of such persons for their services by way of payment in cash or issue of shares, debentures or other securities of the Company or by granting options to take the same or in any other manner as permissible under the law. 17.To enter into contracts of indemnity and get guarantee and allocations for the business of the Company. 18.To make arrangements for training of all categories of employees and to employ or otherwise engage experts, advisors, consultants etc. in the interest of achieving the Company's objects. 19. To promote conservation and protection of electricity from theft, safety of life and to protect environments including air, land and water etc. 20. To pay and provide for the remuneration, amelioration and welfare of persons employed or formerly employed by the Company and their families providing for pension, allowances, bonuses, other



payments or by creating for the

purpose from time to time the Provident Fund, Gratuity and other Funds or Trusts. Further to undertake building or contributing to the building or houses, dwellings or chawls by grants of money, or by helping persons employed by the Company to effect or maintain insurance on their lives by contributing to the payment of premium or otherwise and by providing or subscribing or contributing towards educational institutions, recreation, hospitals and dispensaries, medical and other assistance as the Company may deem fit. 21.To ensure any rights, properties, undertakings, contracts, guarantees or obligations or profits of the Company of every nature and kind in any manner with any person, firm, association, institution or company. 22.To distribute among members of the Company dividend including bonus shares out of profits, accumulated profits or funds and resources of the Company in any manner permissible under law. 23.To institute, conduct, defend, compound or abandon any legal proceedings by or against the Company or its officers or otherwise concerning the affairs of the Company and also to compound and to allow time for payment or satisfaction of any debts or recovery due, claims or demands by or against the Company and to refer any claims or demands by or against the Company or any differences arising in execution of contracts to conciliation and arbitration and to observe, comply with and/or challenge any awards preliminary, interim or final made in any such arbitration. 24.To pay out of the funds of the Company all costs, charges, expenses and preliminary and



incidental to the promotion, formation, establishment and registration of the Company or other expenses incurred in this regard.

25. Subject to provisions of Sections 181, 182 & 183 of Companies Act, 2013 to contribute money or otherwise assist to charitable, benevolent, religious, scientific national, defense, public or other institutions or objects or purposes.

26.To open an account or accounts with any individual, firm or company or with any bank bankers or shroofs and to pay into and withdraw money from such account or accounts. 27.To accept gifts, bequests, devises and donations from members and others and to make gifts to members and others of money, assets and properties of any kind. 28. To carry out all or any of the objects of the company and do all or any of the above things in any part of the world and either as principal, agent, contractor or trustee or otherwise and either alone or in conjunction with others.

29.To negotiate and/or enter into agreement and contract with individuals, companies, corporations, foreign or Indian, for obtaining or providing technical, financial or any other assistance for carrying on all or any of the objects of the Company and also for the purpose of activating, research, development of projects on the basis of know-how and/or financial participation and for technical collaboration, and to acquire or provide necessary formulate and patent rights for furthering the objects of the company.

30.To aid peculiarly or otherwise, any association, body or movement having for its object the solution, settlement or surmounting of industrial or labour problems or trouble or



the promotion of industry or trade. 31. Subject to the provisions of Companies Act, 2013 or any amendment or re-enactment thereof in the event of winding up to distribute among the members in specie any property of the Company or any proceeds of sale on disposal of any property in accordance with the provisions of the Act. 32. To do all such other things as may be deemed incidental or conducive to the attainment of the above Objects or any of them and to carry on any business which may seem to the Company capable of being conveniently carried in connection with any of the Company's Objects or calculated directly or indirectly to enhance the value of or render profitable any of the Company's property or rights. 33.To establish, provide, maintain and conduct or otherwise subsidies research laboratories and experimental workshops for scientific. technical or researches. experiments and to undertake and carry on directly or in collaboration with other agencies scientific and technical research experiments and tests of all kinds and to process, improve and invent new products and their techniques of manufacture and to promote, encourage, reward in every manner studies and research, scientific and technical investigations and inventions of any kind that may be considered likely to assist, encourage and promote rapid advances in technology, economies, import substitution or any business which the Company is authorized to carry on. 34. Subject to provisions of the Companies Act, 2013, to evolve scheme for restructuring or arrangement, to amalgamate or merge or to enter into partnership or into any consortium or arrangement for



sharing of profits, union of interests, co-operation, joint venture with any Person or Persons, partnership firm/firms, or company or companies carrying on or engaged in any operation capable of being conducted so conveniently in cooperation with the business of the Company or to benefit the Company or to the activities for which the Company has been established. 35. To apply for purchase, or otherwise acquire any trade marks, patents, brevets, inventions, licenses, concessions and the like, conferring any exclusive or nonexclusive or limited rights to use, or any secret or other information as to any invention which may be capable of being used for any of the purposes of the Company, or the acquisition of which may benefit the Company and to use, exercise, develop or grant licenses in respect of or otherwise turn to account the property, rights or information so acquired. 36.To sell, dispose or hive off an undertaking of the Company or any part thereof for such consideration as the Company may think fit and in particular for shares, debentures or securities of any other association, corporation or company. 37.To sell, improve, manage, develop, exchange, loan, lease or let, under-lease, sub - let, mortgage, dispose of, deal with in any manner, turn to account otherwise deal with any rights or property of the Company.

4 The liability of the member(s) is limited, and this liability is limited to the amount unpaid if any, on the shares held by them.

5 Every member of the company undertakes to contribute:



	be a member, for	he company in the every payment of the debte he ceases to be a market	s and liabilities of the co	up while he is a mpany or of su	member, or within o och debts and liabilitie	56 ne year after he ceases to s as may have been
(i) to the costs, cha	rges and expenses of	winding up (and for the	adjustment of	the rights of the cont	ributories among
th	emselves), such ar	mount as may be req	uired, not exceeding *			rupees.
(iii) The share capita	l of the company is	500000		rupees, divided into	
	50000	Equity Share	Shares of	10	Rupees each	
6 ✓	We, the several of this memorar against our resp	ndum of association,	es and address are subso and we respectively agre	cribed, are desi se to take the r	rous of being formed umber of shares in th	into a company in pursuance le capital of the company set
	I, whose name a and agree to tak	nd address is given been all the shares in the	elow, am desirous of for e capital of the company	ming a compai :	ny in pursuance of this	s memorandum of association
	We, the several of this memoran	persons, whose name dum of association:	es and addresses are sub	oscribed, are de	esirous of being forme	ed into a company in pursuance
				power Transmission	A	

\neg	
~	_/
J	-

		Subscriber	Details		
S. No.	*Name, Address, Description and Occupation	DIN / PAN / Passport number	No. of shares taken	DSC	Dated
1	MUKUL AGARWAL S/O SHRI RAJES KUMAR NOMINEE OF REC POWER DEVELOPMENT AND CONSULTANCY LIMITED R/O HOUSE NO. 767, SECOND FLOOR, ANSAL C-2 BLOCK, NEAR WATER TANK ANSAL PLAZA, SECTOR-3 PALAM VIHAR, GURGAON- 122017, HARYANA OCCUPATION-SERVICE	1*3*2*8*	1 Equity,0 Preference		15/11/2024
2	REC POWER DEVELOPMENT AND CONSULTANCY LIMITED, CORE-4, SCOPE COMPLEX, 7, LODHI ROAD, NEW DELHI-110003, THROUGH ITS CEO THANGARAJAN SUBASH CHANDIRA BOSH S/O SITHAN THANGARAJAN R/O APARTMENT NO S-2, MIDDLE PORTION 2-B, JANGPURA, MATHURA ROAD, NEW DELHI-110014, OCCUPATION-SERVICE	0*7*2*1*	49994 Equity,0 Preferenc		15/11/2024
3	SATYABAN SAHOO S/O MAHENDRA NATH SAHOO NOMINEE OF REC POWER DEVELOPMENT AND CONSULTANCY LIMITED R/O FLAT NO. B235 VASANT APPARTMENT GURGAON HARYANA-122001 OCCUPATION-SERVICE	A*K*S*0*9*	1 Equity,0 Preference		15/11/2024
ı	ANIL KUMAR PERALA S/O VENKATESHAM NOMINEE OF REC POWER DEVELOPMENT AND CONSULTANCY LIMITED R/O A302 TARIKA APPARTMENT, SECTOR-43 GURGAON HARYANA-122001 OCCUPATION-SERVICE	B*V*P*1*2*	1 Equity,0 Preference		15/11/2024
1	CHILAKAMARRI VENKATA LAKSHAMANA CHARYULU S/O SHRIMANNARAYAN CHARYULU CHILKAMARRI NOMINEE OF REC POWER DEVELOPMENT AND CONSULTANCY LIMITED R/O PLOT NO.1, NORTHSTAR AIRPORT BOULEVARD, TUKKAGUDA, MAHESHRAM MANDAL, RANGAREDDY DISTRICT, ANDRA PRADESH-501359, OCCUPATION- SERVICE	1*7*2*3*	1 Equity,0 Preference		15/11/2024

							58
6	NOMINEE AND CONSULTA VATIKA AP	JMAR S/O NAND KIS OF REC POWER DEVI NCY LIMITED R/O T4 ARTMENT, SECTOR-6 D - 121004, OCCUPA	ELOPMENT I-8A, SAI 53,	1*3*2*3*	1 Equity,0 Pref	erence	15/11/2024
JASPAL SINGH KUSHWAHA S/O MITHAI LAL KUSHWAHA NOMINEE OF REC POWER DEVELOPMENT AND CONSULTANCY LIMITED R/O C-64/FIRST FLOOR, JVTS GARDEN CHATTARPUR EXTENSION South West Delhi 110074 OCCUPATION-SERVICE		1*3*2*3*	1 Equity,0 Pref	erence	15/11/2024		
		Total shares to	aken		50000 Equity,0	Preference	
				Signed	before me		
of the	ership type witness /ACS/FCS/AC /FCMA)	*Name of the witness		Description cupation	DIN / PAN / Passport number / Membership number	DSC	Dated
·CA		VINAY KUMAR	A-805, NX NX ONE, TI IV, GREATE WEST -201318	ECH ZONE -	4*2*9*		15/11/2024
Shri / S	imt				Of		resident of
			aged	year	s shall be the nomine	ee in the event of death	of the sole member



For office use only:	59
eForm Service request number(SRN)	AB1637253
eForm filing date(DD/MM/YYYY)	16/11/2024
Name of the authorizing officer	B RAMESH
This e-Form is hereby approved	Cartification signature by DS MINISTRY OF CORPORATE AFFAIRS. CRE MANESAR 1 < ROC CSC BMCATCASTAN Validity Unknown Digitality signed by DS MINISTRY OF CORPORATE AFFAIRS , CRC MANESAR 1 Date: 2024 11.17
This e-Form is hereby rejected	
Date of Signing (DD/MM/YYYY)	17/11/2024



Form No. INC-34

e-AOA (e-Articles of Association)

[Pursuant to Section 5 of the Companies Act, 2013 and rules made thereunder read with Schedule I]



Form language

Hind	П
	HINC

Refer instruction kit for filing the form

All fields marked in * are mandatory

Table applicable to company as notified under schedule I of the Companies Act, 2013 (F, G, H)

Table F / G / H (basis on the selection of above-mentioned field) as notified under schedule I of the companies Act, 2013 is applicable to

(F - a company limited by shares

G- a company limited by guarantee and having a share capital

H – a company limited by guarantee and not having share capital)

The name of the company is

F			

F - A COMPANY LIMITED BY SHARES

WRNES TALEGAON POWER TRANSMISSION LIMITED

Check if not applicable	Check if altered	Article No.	Description
			Interpretation
		I	(1) In these regulations- (a)the Act means the Companies Act2013 (b) the sealmeans the common seal of the company. (2)Unless the context otherwise requireswords or expressions contained in these regulations shall bear the same meaningas in the Act or any statutory modification thereof in force at the date atwhich these regulations become binding on the company. (3)Public companymeans a company which-(a) is not a private company(b) has a minimum paid-upshare capital as maybe prescribed Provided that a company which is asubsidiary of a company not being a private company shall be deemed to bepublic company for the purposes of this Act even where such subsidiary companycontinues to be a private company inits articles.
		-	Share Capital and Variation of rights
		II 1	Subject to the provisions of the Act and these Articles the shares in the capital of the company shall be under the control of the Directors who may issue allot or otherwise dispose of the same or any of them to such persons in such proportion and on such terms and conditions and either at a premium or at par and at such time as they may from time to time think fit.
Nove STAIR OF STAIR STAI	KL Signature	2	Every person whose name is entered as a member in the register of members shall be entitled to receive within two months after incorporation in case of subscribers to the memorandum or after allotment or within one month after the application for the registration of transfer or transmission or within such other period as the conditions of issue shall be provided one certificate for all his shares without payment of any charges or several certificateseach for one or more of his sharesupon payment of twenty rupees for each certificate after the first. Every certificate shall be under the seal and shall specify the shares to which it relates and the amount paid - up thereon. In respect of any share or shares held

	jointly by several persons the company shall not be bound to issue more than one certificate and delivery of a certificate for a share to one of several joint holders shall be sufficient delivery to all such holders
3	If any share certificate be worn out defaced mutilated or torn or if there be no further space on the back for endorsement of transfer then upon production and surrender thereof to the company a new certificate may be issued in lieu thereof and if any certificate is lost or destroyed then upon proof thereof to the satisfaction of the company and on execution of such indemnity as the company deem adequate a new certificate in lieu thereof shall be given. Every certificate under this Article shall be issued on payment of twenty rupees for each certificate. The provisions of Articles(2) and(3) shall mutatis mutandis apply to debentures of the company.
4	Except as required by law no person shall be recognised by the company as holding any share upon any trust and the company shall not be bound by or be compelled in any way to recognise (even when having notice thereof) any equitable contingent future or partial interest in any share or any interest in any fractional part of a share or (except only as by these regulations or by law otherwise provided) any other rights in respect of any share except an absolute right to the entirety thereof in the registered holder.
5	The company may exercise the powers of paying commissions conferred by sub-section (6) of section 40 provided that the rate per cent or the amount of the commission paid or agreed to be paid shall be disclosed in the manner required by that section and rules made thereunder. The rate or amount of the commission shall not exceed the rate or amount prescribed in rules made under sub-section (6) of section 40. The commission may be satisfied by the payment of cash or the allotment of fully or partly paid shares or partly in the one way and partly in the other.
6	If at any time the share capital is divided into different classes of shares the rights attached to any class (unless otherwise provided by the terms of issue of the shares of that class) may subject to the provisions of section 48 and whether or not the company is being wound up be varied with the consent in writing of the holders of three-fourths of the issued shares of that class or with the sanction of a special resolution passed at a separate meeting of the holders of the shares of that class. To every such separate meeting the provisions of these regulations relating to general meetings shall mutatis mutandis apply but so that the necessary quorum shall be at least two persons holding at least one-third of the issued shares of the class in question.
7	The rights conferred upon the holders of the shares of any class issued with preferred or other rights shall not unless otherwise expressly provided by the terms of issue of the shares of that class be deemed to be varied by the creation or issue of further shares ranking pari passu therewith.
	Subject to the provisions of section 55 any preference shares may with the sanction of an ordinary resolution
	360 albert

	8	
		be issued on the terms that they are to be redeemed on such terms and in such manner as the company before the issue of the shares may by special resolution determine.
		Lien
	9	 The company shall have a first and paramount lienon every share (not being a fully paid share) for all monies (whether presently payable or not) called or payable at a fixed time in respect of that share and on all shares (not being fully paid shares) standing registered in the name of a single person for all monies presently payable by him or his estate to the companyProvided that the Board of directors may at any time declare any share to be wholly or in part exempt from the provisions of this clause. The companys lien if any on a share shall extend to all dividends payable and bonuses declared from time to time in respect of such shares.
	10	 The company may sell in such manner as the Board thinks fit any shares on which the company has a lienProvided that no sale shall be madea unless a sum in respect of which the lien exists is presently payable or b until the expiration of fourteen days after a notice in writing stating and demanding payment of such part of the amount in respect of which the lien exists as is presently payable has been given to the registered holder for the time being of the share or the person entitled thereto by reason of his death or insolvency.
	11	 To give effect to any such sale the Board may authorise some person to transfer the shares sold to the purchaser thereof The purchaser shall be registered as the holder of the shares comprised in any such transfer. The purchaser shall not be bound to see to the application of the purchase money nor shall his title to the shares be affected by any irregularity or invalidity in the proceedings in reference to the sale.
	12	 The proceeds of the sale shall be received by the company and applied in payment of such part of the amount in respect of which the lien exists as is presently payable. The residue if any shall subject to a like lien for sums not presently payable as existed upon the shares before the sale be paid to the person entitled to the shares at the date of the sale.
		Calls on shares
The standard of the standard o	13	• The Board may from time to time make calls upon the members in respect of any monies unpaid on their shares (whether on account of the nominal value of the shares or by way of premium) and not by the conditions of allotment thereof made payable at fixed timesProvided that no call shall exceed one-fourth of the nominal value of the share or be payable at less than one month from the date fixed for the payment of the last preceding call. Each member shall subject to receiving at least fourteen days notice specifying the time or times and place of payment pay to the company at the time or times and place so specified the amount called on his shares. A call may be revoked or postponed at the discretion of the Board.

	14	 A call shall be deemed to have been made at the time when the resolution of the Board authorizing the call was passed and may be required to be paid by instalments.
	15	The joint holders of a share shall be jointly and severally liable to pay all calls in respect thereof.
	16	If a sum called in respect of a share is not paid before or on the day appointed for payment thereof the person from whom the sum is due shall pay interest thereon from the day appointed for payment thereof to the time of actual payment at ten per cent per annum or at such lower rate if any as the Board may determine. The Board shall be at liberty to waive payment of any such interest wholly or in part.
	17	Any sum which by the terms of issue of a share becomes payable on allotment or at any fixed date whether on account of the nominal value of the share or by way of premium shall for the purposes of these regulations be deemed to be a call duly made and payable on the date on which by the terms of issue such sum becomes payable. In case of non-payment of such sum all the relevant provisions of these regulations as to payment of interest and expenses forfeiture or otherwise shall apply as if such sum had become payable by virtue of a call duly made and notified.
	18	The Board - a. may if it thinks fit receive from any member willing to advance the same all or any part of the monies uncalled and unpaid upon any shares held by him andb. upon all or any of the monies so advanced may (until the same would but for such advance become presently payable) pay interest at such rate not exceeding unless the company in general meeting shall otherwise direct twelve per cent per annum as may be agreed upon between the Board and the member paying the sum in advance.
		Transfer of shares
	19	The instrument of transfer of any share in the company shall be executed by or on behalf of both the transferor and transferee. The transferor shall be deemed to remain a holder of the share until the name of the transferee is entered in the register of members in respect thereof.
	20	The Board may subject to the right of appeal conferred by section 58 decline to register the transfer of a share not being a fully paid share to a person of whom they do not approve or any transfer of shares on which the company has a lien.
D D D D D D D D D D D D D D D D D D D	21	 The Board may decline to recognise any instrument of transfer unlessa, the instrument of transfer is in the form as prescribed in rules made under sub-section (1) of section 56b, the instrument of transfer is accompanied by the certificate of the shares to which it relates and such other evidence as the Board may reasonably require to show the right of the transferor to make the transfer andc, the instrument of transfer is in respect of only one class of shares.
		 On giving not less than seven days previous notice in accordance with section 91 and rules made thereunder the registration of transfers may be suspended at such

	22	
		times and for such periods as the Board may from time to time determineProvided that such registration shall not be suspended for more than thirty days at any one time or for more than forty-five days in the aggregate in any year.
		Transmission of shares
	23	On the death of a member the survivor or survivors where the member was a joint holder and his nominee or nominees or legal representatives where he was a sole holder shall be the only persons recognised by the company as having any title to his interest in the shares Nothing in clause (i) shall release the estate of a deceased joint holder from any liability in respect of any share which had been jointly held by him with other persons.
	24	Any person becoming entitled to a share in consequence of the death or insolvency of a member may upon such evidence being produced as may from time to time properly be required by the Board and subject as hereinafter provided elect either to be registered himself as holder of the share or to make such transfer of the share as the deceased or insolvent member could have made. The Board shall in either case have the same right to decline or suspend registration as it would have had if the deceased or insolvent member had transferred the share before his death or insolvency.
	25	If the person so becoming entitled shall elect to be registered as holder of the share himself he shall deliver or send to the company a notice in writing signed by him stating that he so elects. If the person aforesaid shall elect to transfer the share he shall testify his election by executing a transfer of the share. All the limitations restrictions and provisions of these regulations relating to the right to transfer and the registration of transfers of shares shall be applicable to any such notice or transfer as aforesaid as if the death or insolvency of the member had not occurred and the notice or transfer were a transfer signed by that member.
	26	• A person becoming entitled to a share by reason of the death or insolvency of the holder shall be entitled to the same dividends and other advantages to which he would be entitled if he were the registered holder of the share except that he shall not before being registered as a member in respect of the share be entitled in respect of it to exercise any right conferred by membership in relation to meetings of the company Provided that the Board may at any time give notice requiring any such person to elect either to be registered himself or to transfer the share and if the notice is not complied with within ninety days the Board may thereafter withhold payment of all dividends bonuses or other monies payable in respect of the share until the requirements of the notice have been complied with.
Popower Transman	27	In case of a One Person Company on the death of the sole member the person nominated by such member shall be the person recognised by the company as having title to all the shares of the member the nominee on becoming entitled to such shares in case of the members death shall be informed of such event by the
		Page 5 of 17

		Board of the company such nominee shall be entitled to the same dividends and other rights and liabilities to which such sole member of the company was entitled or liable on becoming member such nominee shall nominate any other person with the prior written consent of such person who shall in the event of the death of the member become the member of the company.
		Forfeiture of shares
	28	 If a member fails to pay any call or instalment of a call on the day appointed for payment thereof the Board may at any time thereafter during such time as any part of the call or instalment remains unpaid serve a notice on him requiring payment of so much of the call or instalment as is unpaid together with any interest which may have accrued.
	29	The notice aforesaid shall name a further day (not being earlier than the expiry of fourteen days from the date of service of the notice) on or before which the payment required by the notice is to be made and state that in the event of non-payment on or before the day so named the shares in respect of which the call was made shall be liable to be forfeited.
	30	If the requirements of any such notice as aforesaid are not complied with any share in respect of which the notice has been given may at any time thereafter before the payment required by the notice has been made be forfeited by a resolution of the Board to that effect.
	31	A forfeited share may be sold or otherwise disposed of on such terms and in such manner as the Board thinks fit.At any time before a sale or disposal as aforesaid the Board may cancel the forfeiture on such terms as it thinks fit.
	32	 A person whose shares have been forfeited shall cease to be a member in respect of the forfeited shares but shall notwithstanding the forfeiture remain liable to pay to the company all monies which at the date of forfeiture were presently payable by him to the company in respect of the shares. The liability of such person shall cease if and when the company shall have received payment in full of all such monies in respect of the shares.
Den Transmission Links on Link	33	• A duly verified declaration in writing that the declarant is a director the manager or the secretary of the company and that a share in the company has been duly forfeited on a date stated in the declaration shall be conclusive evidence of the facts therein stated as against all persons claiming to be entitled to the share The company may receive the consideration if any given for the share on any sale or disposal thereof and may execute a transfer of the share in favour of the person to whom the share is sold or disposed of The transferee shall thereupon be registered as the holder of the share and The transferee shall not be bound to see to the application of the purchase money if any nor shall his title to the share be affected by any irregularity or invalidity in the proceedings in reference to the forfeiture sale or disposal of the share.
		The provisions of these regulations as to forfeiture shall apply in the case of non-payment of any sum which by

*	34	
		the terms of issue of a share becomes payable at a fixed time whether on account of the nominal value of the share or by way of premium as if the same had been payable by virtue of a call duly made and notified.
		Alteration of capital
	35	The company may from time to time by ordinary resolution increase the share capital by such sum to be divided into shares of such amount as may be specified in the resolution.
	36	Subject to the provisions of section 61 the company may by ordinary resolution consolidate and divide all or any of its share capital into shares of larger amount than its existing shares convert all or any of its fully paid-up shares into stock and reconvert that stock into fully paid-up shares of any denomination sub-divide its existing shares or any of them into shares of smaller amount than is fixed by the memorandum cancel any shares which at the date of the passing of the resolution have not been taken or agreed to be taken by any person.
	37	Where shares are converted into stock the holders of stock may transfer the same or any part thereof in the same manner as and subject to the same regulations under which the shares from which the stock arose might before the conversion have been transferred or as near thereto as circumstances admit Provided that the Board may from time to time fix the minimum amount of stock transferable so however that such minimum shall not exceed the nominal amount of the shares from which the stock arose. the holders of stock shall according to the amount of stock held by them have the same rights privileges and advantages as regards dividends voting at meetings of the companyand other matters as if they held the shares from which the stock arose but no such privilege or advantage (except participation in the dividends and profits of the company and in the assets on winding up) shall be conferred by an amount of stock which would not if existing in shares have conferred that privilege or advantage. such of the regulations of the company as are applicable to paid-up shares shall apply to stock and the words share and shareholder in those regulations shall include stock and stock-holder respectively.
	38	The company may by special resolution reduce in any manner and with and subject to any incident authorised and consent required by law it share capital any capital redemption reserve account or any share premium account.
		Capitalisation of profits
Doomer Transmission Linux	g.	 The company in general meeting may upon the recommendation of the Board resolve that it is desirable to capitalise any part of the amount for the time being standing to the credit of any of the companys reserve accounts or to the credit of the profit and loss accountor otherwise available for distribution and that such sum be accordingly set free for distribution in the manner specified in clause (ii) amongst the members who would have been entitled thereto if distributed by way of dividend and in the same proportions. The sum aforesaid shall not be paid in cash but shall be applied subject to

	39	
		the provision contained in clause (iii) either in or towards paying up any amounts for the time being unpaid on any shares held by such members respectively paying up in full unissued shares of the company to be allotted and distributed credited as fully paid-up to and amongst such members in the proportions aforesaid partly in the way specified in sub-clause (A) and partly in that specified in sub-clause (B) A securities premium account and a capital redemption reserve account may for the purposes of this regulation be applied in the paying up of unissued shares to be issued to members of the company as fully paid bonus shares The Board shall give effect to the resolution passed by the company in pursuance of this regulation.
	40	Whenever such a resolution as aforesaid shall have been passed the Board shall make all appropriations and applications of the undivided profits resolved to be capitalised thereby and all allotments and issues of fully paid shares if any and generally do all acts and things required to give effect thereto. The Board shall have power to make such provisions by the issue of fractional certificates or by payment in cash or otherwise as it thinks fit for the case of shares becoming distributable in fractions and to authorise any person to enter on behalf of all the members entitled thereto into an agreement with the company providing for the allotment to them respectively credited as fully paid-up of any further shares to which they may be entitled upon such capitalisation or as the case may require for the payment by the company on their behalf by the application thereto of their respective proportions of profits resolved to be capitalised of the amount or any part of the amounts remaining unpaid on their existing shares Any agreement made under such authority shall be effective and binding on such members
		Buy-back of shares
	41	Notwithstanding anything contained in these articles but subject to the provisions of sections 68 to 70 and any other applicable provision of the Act or any other law for the time being in force the company may purchase its own shares or other specified securities.
		General meetings
	42	All general meetings other than annual general meeting shall be called extraordinary general meeting.
	43	The Board may whenever it thinks fit call an extraordinary general meeting. If at any time directors capable of acting who are sufficient in number to form a quorum are not within India any director or any two members of the company may call an extraordinary general meeting in the same manner as nearly as possible as that in which such a meeting may be called by the Board.
		Proceedings at general meetings
	44	No business shall be transacted at any general meeting unless a quorum of members is present at the time when the meeting proceeds to business. Save as otherwise provided herein the quorum for the general meetings shall be as provided in section 103.
Power Tra		
	211	D 0 (47

		-	
		45	 The chairperson if any of the Board shall preside as Chairperson at every general meeting of the company.
		46	If there is no such Chairperson or if he is not present within fifteen minutes after the time appointed for holding the meeting or is unwilling to act as chairperson of the meeting the directors present shall elect one of their members to be Chairperson of the meeting.
		47	If at any meeting no director is willing to act as Chairperson or if no director is present within fifteen minutes after the time appointed for holding the meeting the members present shall choose one of their members to be Chairperson of the meeting.
7		48	In case of a One Person Company the resolution required to be passed at the general meetings of the company shall be deemed to have been passed if the resolution is agreed upon by the sole member and communicated to the company and entered in the minutes book maintained under section 118 such minutes book shall be signed and dated by the member the resolution shall become effective from the date of signing such minutes by the sole member.
			Adjournment of meeting
		49	The Chairperson may with the consent of any meeting at which a quorum is present and shall if so directed by the meeting adjourn the meeting from time to time and from place to place. No business shall be transacted at any adjourned meeting other than the business left unfinished at the meeting from which the adjournment took place. When a meeting is adjourned for thirty days or more notice of the adjourned meeting shall be given as in the case of an original meeting. Save as aforesaid and as provided in section 103 of the Act it shall not be necessary to give any notice of an adjournment or of the business to be transacted at an adjourned meeting.
			Voting rights
		50	Subject to any rights or restrictions for the time being attached to any class or classes of shares on a show of hands every member present in person shall have one vote and on a poll the voting rights of members shall be in proportion to his share in the paid-up equity share capital of the company.
		51	A member may exercise his vote at a meeting by electronic means in accordance with section 108 and shall vote only once.
		52	 In the case of joint holders the vote of the senior who tenders a vote whether in person or by proxy shall be accepted to the exclusion of the votes of the other joint holders. For this purpose seniority shall be determined by the order in which the names stand in the register of members.
		53	A member of unsound mind or in respect of whom an order has been made by any court having jurisdiction in lunacy may vote whether on a show of hands or on a poll by his committee or other legal guardian and any such committee or guardian may on a poll vote by proxy.
	Power Lias		

15		Any business other than that upon which a poll has been
	54	demanded maybe proceeded with pending the taking of the poll.
	55	No member shall be entitled to vote at any general meeting unless all calls or other sums presently payable by him in respect of shares in the company have been paid
	56	No objection shall be raised to the qualification of any voter except at the meeting or adjourned meeting at which the vote objected to is given or tendered and every vote not disallowed at such meeting shall be valid for all purposes. Any such objection made in due time shall be referred to the Chairperson of the meeting whose decision shall be final and conclusive.
		Proxy
	57	The instrument appointing a proxy and the power-of- attorney or other authority if any under which it is signed or a notarised copy of that power or authority shall be deposited at the registered office of the company not less than 48 hours before the time for holding the meeting or adjourned meeting at which the person named in the instrument proposes to vote or in the case of a poll not less than 24 hours before the time appointed for the taking of the poll and in default the instrument of proxy shall not be treated as valid.
	- 58	 An instrument appointing a proxy shall be in the form as prescribed in the rules made under section 105
	59	A vote given in accordance with the terms of an instrument of proxy shall be valid notwithstanding the previous death or insanity of the principal or the revocation of the proxy or of the authority under which the proxy was executed or the transfer of the shares in respect of which the proxy is givenProvided that no intimation in writing of such death insanity revocation or transfer shall have been received by the company at its office before the commencement of the meeting or adjourned meeting at which the proxy is used.
		Board of Directors
		The day to day management of the business of the CompanyShall be vested with the Board of Directors of the Company or Such persons asmay be authorized by the Board from time to time The Board may exercise allsuch powers of the Company and do all such acts deeds and things as are notprohibited by the Act or any other law for the time being in force or by theMemorandum of Association of a Company and without prejudice to the foregoingshall be responsible for all policy matters and the supervision direction andcontrol of the conduct of the business affairs and operations of the CompanyThe first Directors of the Company shall be 1. ALOKSINGH 2. MUKUL AGARWAL 3. NEERAJKUMAR VIJAY SHARMA ii at every annualgeneral meeting One third of such of the directors for the time being as areliable to retire by rotation or if their number nearest to one third shall retire from Office Thedirectors to retire by rotation at every annual general Meeting shall be thosewho have been longest in office since their Last

		60	appointment but as betweenpersons who became directors on the same day those who are to retire shall indefault of and subject to any subject to any agreement among themselves be dateremined by loti at annual general meeting at which a director retires as aforesaid the company may fill up the vacancy by appointing their tiring director orsome other person there to The Board of Directors of the Company shall consistof not less than but not more than Directors The appointment of Directorsincluding the Chairman Managing Director Whole Time Director Part time Directorshall be done in the General Meetings in accordance with the provisions of the Holding the Companies Act and Rules made there under and shall be eligible for appointmentHowever till the Company is a Government Company REC Power Development andConsultancy Limited RECPDCL the holding company shall have the full powers to recommendnominate the name of any Directors to be appointed on the Board of the CompanyFurther RECPDCL shall also have the right to fillany vacancies in the office of director caused by removal resignation death or otherwiseSubject to provisions of the Act the Company may bypassing their solution inGeneral Meeting increased crease the maximum number of Directors and may altertheir qualification Further the Company may bypassing their solution inGeneral Meeting increased crease the maximum number of Directors and may altertheir qualification Further the Company may subject to the provisions of the Act tremove any Director before the expiration of his period of office and appointanother person in place of him The Board may appoint any person to act asalternate director for a Director during the later's absence for a period ofnot less than three months from India and such appointment shall have effectand such appointee whilst he holds office as an alternate director shall beentitled to notice of meeting of the Board and to attend and vote there ataccordingly but he shall not require any qualification and shall pso factovacate office if and w
		61	consists of a monthly payment be deemed to accrue from day-to-day. In addition to the remuneration payable to them in pursuance of the Act the directors may be paid all travelling hotel and other expenses properly incurred by them in attending and returning from meetings of the Board of Directors or any committee thereof or general meetings of the company or in connection with the business of the company.
		62	The Board may pay all expenses incurred in getting up and registering the company.
_	 	118	Page 11 of 17

		The company may exercise the powers conferred on it by
	63	section 88 with regard to the keeping of a foreign register and the Board may (subject to the provisions of that section) make and vary such regulations as it may think fit respecting the keeping of any such register.
	64	All cheques promissory notes drafts hundis bills of exchange and other negotiable instruments and all receipts for monies paid to the company shall be signed drawn accepted endorsed or otherwise executed as the case may be by such person and in such manner as the Board shall from time to time by resolution determine
	65	 Every director present at any meeting of the Board or of a committee thereof shall sign his name in a book to be kept for that purpose.
	66	Subject to the provisions of section 149 the Board shall have power at any time and from time to time to appoint a person as an additional director provided the number of the directors and additional directors together shall not at any time exceed the maximum strength fixed for the Board by the articles. Such person shall hold office only up to the date of the next annual general meeting of the company but shall be eligible for appointment by the company as a director at that meeting subject to the provisions of the Act.
		Proceedings of the Board
	67	The Board of Directors may meet for the conduct of business adjourn and otherwise regulate its meetings as it thinks fit. A director may and the manager or secretary on the requisition of a director shall at any time summon a meeting of the Board.
	68	Save as otherwise expressly provided in the Act questions arising at any meeting of the Board shall be decided by a majority of votes. In case of an equality of votes the Chairperson of the Board if any shall have a second or casting vote.
	69	The continuing directors may act notwithstanding any vacancy in the Board but if and so long as their number is reduced below the quorum fixed by the Act for a meeting of the Board the continuing directors or director may act for the purpose of increasing the number of directors to that fixed for the quorum or of summoning a general meeting of the company but for no other purpose.
	70	The Board may elect a Chairperson of its meetings and determine the period for which he is to hold office. If no such Chairperson is elected or if at any meeting the Chairperson is not present within five minutes after the time appointed for holding the meeting the directors present may choose one of their number to be Chairperson of the meeting.
	71	The Board may subject to the provisions of the Act delegate any of its powers to committees consisting of such member or members of its body as it thinks fit. Any committee so formed shall in the exercise of the powers so delegated conform to any regulations that may be imposed on it by the Board.

1			
		72	 A committee may elect a Chairperson of its meetings. If no such Chairperson is elected or if at any meeting the Chairperson is not present within five minutes after the time appointed for holding the meeting the memberspresent may choose one of their members to be Chairperson of the meeting.
		73	 A committee may meet and adjourn as it thinks fit. Questions arising at any meeting of a committee shall be determined by a majority of votes of the members present and in case of an equality of votes the Chairperson shall have a second or casting vote.
		74	All acts done in any meeting of the Board or of a committee thereof or by any person acting as a director shall notwithstanding that it may be afterwards discovered that there was some defect in the appointment of any one or more of such directors or of any person acting as aforesaid or that they or any of them were disqualified be as valid as if every such director or such person had been duly appointed and was qualified to be a director.
		75	Save as otherwise expressly provided in the Act a resolution in writing signed by all the members of the Board or of a committee thereof for the time being entitled to receive notice of a meeting of the Board or committee shall be valid and effective as if it had been passed at a meeting of the Board or committee duly convened and held.
7		76	In case of a One Person Company where the company is having only one director all the businesses to be transacted at the meeting of the Board shall be entered into minutes book maintained under section 118 such minutes book shall be signed and dated by the director the resolution shall become effective from the date of signing such minutes by the director.
	-		Chief Executive Officer, Manager, Company Secretary or Chief Financial Officer
		77	Subject to the provisions of the Act A chief executive officer manager company secretary or chief financial officer may be appointed by the Board for such term at such remuneration and upon such conditions as it may think fit and any chief executive officer manager company secretary or chief financial officer so appointed may be removed by means of a resolution of the Board A director may be appointed as chief executive officer manager company secretary or chief financial officer
		78	 A provision of the Act or these regulations requiring or authorising a thing to be done by or to a director and chief executive officer manager company secretary or chief financial officer shall not be satisfied by its being done by or to the same person acting both as director and as or in place of chief executive officer manager company secretary or chief financial officer.
			The Seal
			 The Board shall provide for the safe custody of the seal. The seal of the company shall not be affixed to any instrument except by the authority of a resolution of the Board or of a committee of the Board authorised by it in

		79	
			that behalf and except in the presence of at least two directors and of the secretary or such other person as the Board may appoint for the purpose and those two directors and the secretary or other person aforesaid shall sign every instrument to which the seal of the company is so affixed in their presence.
			Dividends and Reserve
П	Īn		The company in general meeting may declare dividends
		80	but no dividend shall exceed the amount recommended by the Board.
П			Subject to the provisions of section 123 the Board may
		81	from time to time pay to the members such interim dividends as appear to it to be justified by the profits of the company.
			The Board may before recommending any dividend set
		82	aside out of the profits of the company such sums as it thinks fit as a reserve or reserves which shall at the discretion of the Board be applicable for any purpose to which the profits of the company may be properly applied including provision for meeting contingencies or for equalizing dividends and pending such application may at the like discretion either be employed in the business of the company or be invested in such investments (other than shares of the company) as the Board may from time to time thinks fit. The Board may also carry forward any profits which it may consider necessary not to divide without setting them aside as a reserve
		83	Subject to the rights of persons if any entitled to shares with special rights as to dividends all dividends shall be declared and paid according to the amounts paid or credited as paid on the shares in respect whereof the dividend is paid but if and so long as nothing is paid upon any of the shares in the company dividends may be declared and paid according to the amounts of the shares. No amount paid or credited as paid on a share in advance of calls shall be treated for the purposes of this regulation as paid on the share. All dividends shall be apportioned and paid proportionately to the amounts paid or credited as paid on the shares during any portion or portions of the period in respect of which the dividend is paid but if any share is issued on terms providing that it shall rank for dividend as from a particular date such share shall rank for dividend accordingly.
		84	The Board may deduct from any dividend payable to any member all sums of money if any presently payable by him to the company on account of calls or otherwise in relation to the shares of the company.
		85	Any dividend interest or other monies payable in cash in respect of shares may be paid by cheque or warrant sent through the post directed to the registered address of the holder or in the case of joint holders to the registered address of that one of the joint holders who is first named on the register of members or to such person and to such address as the holder or joint holders may in writing direct. Every such cheque or warrant shall be made payable to the order of the person to whom it is sent.
		Somer Les	
		18/ 1/2	Page 14 of 1

	86	 Any one of two or more joint holders of a share may give effective receipts for any dividends bonuses or other monies payable in respect of such share.
	87	Notice of any dividend that may have been declared shall be given to the persons entitled to share therein in the manner mentioned in the Act.
	88	No dividend shall bear interest against the company.
		Accounts
	89	The Board shall from time to time determine whether and to what extent and at what times and places and under what conditions or regulations the accounts and books of the company or any of them shall be open to the inspection of members not being directors. No member (not being a director) shall have any right of inspecting any account or book or document of the company except as conferred by law or authorised by the Board or by the company in general meeting.
		Winding up
	90	Subject to the provisions of Chapter XX of the Act and rules made thereunder If the company shall be wound up the liquidator may with the sanction of a special resolution of the company and any other sanction required by the Act divide amongst the members in specie or kind the whole or any part of the assets of the company whether they shall consist of property of the same kind or not. For the purpose aforesaid the liquidator may set such value as he deems fair upon any property to be divided as aforesaid and may determine how such division shall be carried out as between the members or different classes of members. The liquidator may with the like sanction vest the whole or any part of such assets in trustees upon such trusts for the benefit of the contributories if he considers necessary but so that no member shall be compelled to accept any shares or other securities whereon there is any liability.
		Indemnity
	91	Every officer of the company shall be indemnified out of the assets of the company against any liability incurred by him in defending any proceedings whether civil or criminal in which judgment is given in his favour or in which he is acquitted or in which relief is granted to him by the court or the Tribunal.
		Others
	92	•

Subscriber Details

S. No.		Subscriber Details						
	*Name, Address, Description and Occupation	DIN / PAN / Passport number	*Place	DSC	Dated			
1	REC POWER DEVELOPMEN T AND CONSULTANCY LIMI	0*7*2*1*	NEW DELHI		15/11/2024			



	TED, CORE-4, SCOPE COMP LEX, 7, LODHI ROAD, NEW D				75
	ELHI- 110003, THROUGH IT				
	S CEO THANGARAJAN SUB ASH CHANDIRA BOSH S/O				
	SITHAN THANGARAJAN R/				
	O APARTMENT NO S-2, MID				
	DLE PORTION 2-B, JANGPU				
	RA, MATHURA ROAD, NEW				
	DELHI-110014, OCCUPATIO				
	N-SERVICE	-			
	SATYABAN SAHOO S/O MA HENDRA NATH SAHOO NO				
	MINEE OF REC POWER DEV				
_	FLORMENT AND CONSULTA				
2	NCY LIMITED R/O FLAT NO.	A*K*S*0*9*	NEW DELHI		15/11/2024
	B235 VASANT APPARTMEN				
	T GURGAON HARYANA-122				
	001 OCCUPATION-SERVICE				
	ANIL KUMAR PERALA S/O V ENKATESHAM NOMINEE O				
	F REC POWER DEVELOPME				
_	NT AND CONSULTANCY LIM				
3	ITED R/O A302 TARIKA APP	B*V*P*1*2*	NEW DELHI		15/11/2024
	ARTMENT, SECTOR-43 GUR				
	GAON HARYANA-122001 O				
	CCUPATION-SERVICE CHILAKAMARRI VENKATA L				
	AKSHAMANA CHARYULU				
	S/O SHRIMANNARAYAN CH				
	ARYULU CHILKAMARRI NO				
	MINEE OF REC POWER DEV				
	ELOPMENT AND CONSULTA				
4	NCY LIMITED R/O PLOT NO.	1*7*2*3*	NEW DELHI		15/11/2024
	1, NORTHSTAR AIRPORT BO ULEVARD, TUKKAGUDA, MA				
	HESHRAM MANDAL, RANG				
	AREDDY DISTRICT, ANDRA				
	PRADESH-501359, OCCUPA				
	TION-SERVICE				
	ARVIND KUMAR S/O NAND KISHOR SINGH NOMINEE O				
	F REC POWER DEVELOPME				
_	NT AND CONSULTANCY LIM				
5	ITED R/O T4-8A, SAI VATIKA	1*3*2*3*	NEW DELHI		15/11/2024
	APARTMENT, SECTOR-63, F		1		
	ARIDABAD - 121004, OCCU		1		
	PATION-SERVICE JASPAL SINGH KUSHWAHA				
	S/O MITHAI LAL KUSHWAHA				
	A NOMINEE OF REC POWER				
	DEVELOPMENT AND CONS				
6	ULTANCY LIMITED R/O C-6	1*3*2*3*	NEW DELHI		15/11/2024
	4/FIRST FLOOR, JVTS GARD				
	EN CHATTARPUR EXTENSI ON South West Delhi 11007				
	4 OCCUPATION-SERVICE				
7	MUKUL AGARWAL S/O SHRI	1*3*2*8*	NEW DELHI		15/11/2024
	RAJESH KUMAR NOMINEE	, as all to			. 0, , 2024
	OF REC POWER DEVELOPM				
	ENT AND CONSULTANCY LI				
	MITED R/O HOUSE NO. 767,			1	



	SECOND FLOOR, ANSAL C-2	70
1	BLOCK, NEAR WATER TANK	76
	ANSAL PLAZA, SECTOR-3 P	
- 1	ALAM VIHAR, GURGAON- 1	
	22017, HARYANA OCCUPAT	
	ION-SERVICE	

Signed before me						
Name Prefix (ACA/FCA/ACS/ FCS/ACMA/ FCMA)	*Name of the witness	*Address, Description and Occupation	*DIN / PAN / Passport number / Membership	*Place	DSC	Dated
FCA	VINAY KUM AR	A-805, NX BYTE T-3, NX ONE, TE CH ZONE - IV, G REATER NOIDA WEST -201318	4*2*9*	NEW DELH		15/11/2024



For office use only:	77
eForm Service request number(SRN)	AB1637253
eForm filing date(DD/MM/YYYY)	16/11/2024
Name of the authorizing officer	B RAMESH
This e-Form is hereby approved	Carification agniture by DS MINISTRY OF CORPORATE AFFAIRS. CRC MANESAR 1-ROC.CRE-MICA Development validaty Unitropy Digitally signed by DS MINISTRY OF CORPORATE AFFAIRS, CRC MANESAR 1 Date: 2024 11.17 10:14:02 IST
This e-Form is hereby rejected	
Date of Signing (DD/MM/YYYY)	17/11/2024



Annexure A4

यूपी ने 67 रनों के लक्ष्य को दो विकेट खोकर प्राप्त िया मुकाबला दिल्ली से

बदलावों को सहने में सक्षम पादपों की पहचान करनी होगी। ऐसे पादमें के में लाकर उन्हें जलवायु परिवर्तन से जीन्स चिह्नित कर जरुरी फसल पादपों लड़ने के लिए विकसित करना होगा। लेह जहां कोई फूल-फल नहीं होते

वहां ट्यूलिप के फूल खिल रहे हैं। सीसीएसयू कैंपस में इंडियन जैविक जिज्ञासाएं तथा कार्यकारी के पीधे को भारत में उनाने में सफलता है। इसी तरह से नीदरलैंड का र्बोटनीकल सोसाइटी द्वारा 'जलवार् वैविध्य' विषय पर अंतरराष्ट्रीय सिम्मोजियम में डेबत बात एएसआरबी उनके अनुसार अफगानिस्तान के हींग परिवर्तन काल में वानस्पतिक जगत है के अध्यक्ष ग्री.संजय कुमार ने कही।

कुलपति ग्रो.संगीता शुक्ला ने जीवक जिज्ञासाओं को लक्षित कर भविष्य में देश में ही तनावरोधी किस्मों को पहचानने और उन्हें विस्रकित करने पर ओर दिया। ग्री.शुक्ला ने छात्रों को लगन के साथ भारत को उन्नित के शिखर पर रहंचाने की अपील की। सिम्मोजियम को लाइफ टाइम अचीवमेंट अवार्ड से सम्पानित किया गया। सात अन्य विरिष्ठ वैज्ञानिक और सोसाइटी के 10 वरिष्ठ प्रो.एसके सोपोरी एवं प्रो. पीके गुप्ता सदस्य भी पुरस्कृत किए गए। संयोजक प्रो.जितेंद्र सिंह, प्रो.सेसु लवानिया, भो.यूसी लवानिया, प्रो.वर्षा नाथन विमला, पंकज सिंह आदि रहे। श्रीवास्तव डॉ.आलोक

से स्तन कैसर जागरूकता कैंप का आयोजन किया गया। ● हिन्दुरतान डन बातों पर दिया जोर आईएमए मेरठ। मदर झीन केसर गजपुर उत्तराख्लों की सीबीने हिस्सा निशनल ताइक्वीएनएल प्रतियोगिता में १ कि जीता। कटेड वे सशक्त कान किया एकडमी के लान केवल शेच अंकुर सिंहै, बल्कि आने पर उन्हें पार स्वस्थ करण माहेश्वरी विशेषज्ञ किया। इस दौरा। है। 是特位 पाईववा न क्लाक

और मनीचिकित्सक डॉ. राशि डॉ. उमंग पितल, डॉ. अमन रस्तोगी अग्रवाल ने वीडियो प्रेजेंटेशन के माध्यम से रतन कैसर की जिटलताओं और प्रांतियों के बारे में बताया। हेल्घ केयर इमेजिंग सेंटर की ओर से

संत्रिलंत आहार, नियमित व्यायाम कैंसर के जोखिम को कम करते हैं। असिं - दे अधिक महिलाओं को स्तन कैसर के बारे में जागरूक करें। 40 की उम्र के बाद नियमित मैमोग्राम टेस्ट कराएं

गांठ, सुजन या त्वचा में बदलाव दिखने पर डॉक्टर से संपर्क करें।

नियमित रूप से स्तनों की स्व-जांच, करें।

निशुह्क मेमीग्राफी परीक्षण किया गया। डॉ. नीलिमा अग्रवाल, डॉ. रेन गोयल आदिरही। सहोदय के प्रेसिडेंट मात, डॉ. रेनू कांबोज, डॉ. निशि राहुल केसरवानी और जाइंट सेक्रेटरी डॉ. रश्मि मिश्रा का भी योगदान रहा।

Flipkart

UO2

सकते हैं। इसके अतिरिक्त, बोलीकर्ता CO, की ग्रंड (खाध/ओद्योगिक) तथा अतिम उपयोग MARROVE YOUR POSTURE

अगिरायि की अभिव्यक्ति के सम्पूर्ण दस्तावंज के विवरण के लिए बोलीकर्ता कृपया गेल की निविदा वेबसाइट https://gailtenders.in/ का संदर्भ लें।

बोलीकर्ताओं द्वारा अभिरुचि की अभिव्यक्ति प्रस्तुत करने की नियत तारीख और समय 08/11/2024 को 17:00 बजे (आईएसटी) (dd.mm.yyyy, hinhhirs, Indian Standard Time) है।

पंजीकृत कार्यातयः १६, भीकाएजी कामा पैलेख, आए.के. पुरम, नई दिल्ही-110066 (कॉपीरेट पहचान संख्या: L40200DL1984GO1018976)

Follow us on O O O

आरईसी पावर डेवलपमेंट एंड कंसल्टेंसी लिमिटेड

आरक्षी पाना केवलगार एक मंसल्टीकी क्रिमिट्ट, वह किल्सी, भारत (आर्मिकी हिमिट्ट) के पूर्व प्रतास को अस्तर की अस्ति एक मामान केविया सक्वितक उन्हाम भी को अस्तिमिक्त एकिम परियोजनाओं की स्वापनों की स्वापनों की दी, वी, र्सी के अनित मिमा, एक्सिट, अस्तिए के अस्ति के अस्ति एक्टि के नामार पाना करित कोव्या परियोजनाओं की स्वापनी हिम्मिक्त मिक्स मिस्ति करित मिस्ति के अस्ति मिस्ति के अस्ति मिस्ति मिस्ति के अस्ति मिस्ति मिस्ति

कारणायां दरमावेज सभी कार्य दिवसों में 10.30 ज्ये (गा.मा.स) से 16.00 ज्ये (मा.मा.स) के बीज (17.10.2024 जान बाप कार्य की शिर्ष से एक दिन पहले तका हमारी बेबासाट्स फ्राफ्प प्रटाणींता माहं मा और फ्राफ्प एकप्रदीत मा प् किस संबंधिता परियोजनाओं के आएफ्सी दरमोबच में दिए गए जिवसण के अनुसार प्रत्येक रारेग्ण असियोजनाओं के लिए गिर-अग्पती गोण्य सुरक्त (च.५,00,000/- (पांच लाख रूपए केवल) या \$7000 (सूर्स डाला सात हजार केवल) + 18%

लिए अप्रतिदेव में स्वापती योग्य गुरूक (क.) 60,000-(पांच हात्रा एए) केवहा) या 37000 (युष्प द्वारत सात हवात केवा 18%, बीएएटी) का अहपा से भूगतान काने पा ही आएएमी के उत्तर में प्रस्ताव ज्या कर कर्का है। यह पित्रे एक आएएमी तावेजा के एम्टीकरण करी बीलीदाताओं को बारी किया बाएगा, किन्हीं, अपित्रम शुरूक का भूगतान करके आपरूपी स्तानिक करारी वेमसमद्देश <u>प्रथम मार्थामीन मार्थ मा</u>र्थमा प्रथम <u>मार्थमान में भी काउनसोड किया या संस्ता</u> स्थिम मार्थने रोडकुक प्रमारी सेनेबित <u>मार्थमी संस्तानिक मिर्ग मार्थिक के अनुस्ता मान्येक प्रोपण परियोक्ताओं</u> स्थिय में स्थापी सीम मार्ज्य स्ट. 50 Mont. त्याच साम काम में मार्था स्थाप

> पालंद में इन्ह invited for the engagement of Guest Faculty on contractual basis लेकर तैया Agriculture Engineering, Ara (Bhojpur) Dumiaon campus and

Walk-in-Interview

पाल्ट्र 829

cultural University, Sabour Bhagalpur- 813210

Office of Dean (Agriculture)

इस बार करवाचा थपर लंब

है। फेशिय niversity, Sabour, Bhagaipur. Eligible candidates may apply with

शुरु हो म containing name, father's name, permanent and correspondence

मेरठ, वरिष्ठ संवाददाता। करवाचीश का पर्व नजदीक है। सुहागिनों की तैयारी लगभग पुरी है, लेकिन अंगार और पार्लर में सजने संवरने का काम अभी बाकी है। इस बार बालों को संदर बनाने के लिए स्पेशल लंबी चोटी और जूड़ा पिन से लेकर स्टीन, पलावर पिन चलन में है। इंडियन लुक में दिखने के लिए पार्लर भी तैयार होने की बुकिंग शुरू हो चुकी

करवाचीश

वहीं सेहा. Business Management (CABM), Sabour under Bihar

शुक्रवार, क date of birth, academic qualifications, experiences, etc. to the पार्लर में हे an (Ag.), BAU, Sabour and personally appear in the interview to be करवाचीथ् । र 11.2024 at 9.00 am for CoAE, Ara (Bhojpur) and 2:00 pm for

पर बुकिमात, Business Mule, gement (CABM), Sabour with all original स्पश्न और ase visit university's website i.e.. www.bausabour.ac.in for प्केज दिय्मost, eligibility criteria, category and emoluments for aforesaid

tre for	LE	Te	7
आरएकपी प्रस्ताव खोलने का विवरण	20.12.2024 को 15:30 बजे (भा.मा.स)	20.12.2024 को 16:30 बजे (भा.मा.स)	
असर्वज्ञी के उत्तर में प्रस्ताव ज्ञान की अतिम निवि	20.12.2024, 15:00 बजे तक (भा.मा.स)	20.12.2024, 16:00 बजे तक (भा.मा.स)	
स्पष्टीकरण मगवाने की अतिम तिथि	06.11.2024	06.11.2024	4
परियोक्तना का नाम		त्तीकोरिन क्षेत्र में प्रस्तावित ग्रीन हाड्डोजन / ग्रीने अमीनिया परिकोजनाओं कि तिए परिषण प्रणाती	बोली में मधी अधिमान अमन्तेम भंगांभार करा
n ni	-	7	बोली
	-		-

वास्त्री में क्षामी कुद्धारा, उनस्था, संबोधन, समय बढ़ाना आदि हमापी वेबसाइट्स <u>भूभभ recinda nic in</u> तथा <u>भूभभ republi in ए होस्ट बिरोजाणी नुवीनतम बानकारी के लिए हमारी वेबसाइट का निवासित करा से अवलोजन कराते हो</u> मुख्य कार्यपालक आपिकारी ट एंड कंसाल्टेसी लिपिटेड नोटः अर्र्धसीपाडीसीएत के पास बिना कोई काण बताए तथा बिना किसी बाच्यता केबोली प्रक्रिया को रह वा संगोधित करने का असिकार सुरक्षित हो वह कोई पेशक्श नहीं है।

REC NoverDevelopment बोली प्रक्रिया समन्ययम

By order of the Hon'ble Vice-Chancellor

Dean (Agriculture)

Man trains

, नई दिल्ली - 110003, भारत

आर्ड्सी पावर डेकलपसेट एंड कंसल्टेसी लिमिटेड

सांकेतिक करणा सूचना (अवज सम्मित्ति हेत्)

कोई लंबी चोटी को तवज्जों दे रही है। ऋषम और आईटीआई ने जीते मैच

कार्यालय अधि विभाग,प्रखण्ड-भेरेंडे। आ ने

शामिल है। 350 राप्ट नियं तक

को अलग लुक देना चाहती हैं। कोई स्टाइलिश कृटिंग के साथ खुले बाल, तो

कि वैसे तो सभी महिलाएं इंडियन लुक ब्युटीशियन एक्सपर्ट स्टैफी ने बताया

में ही दिखना चाहती हैं, लेकिन हेच्स्

Doner do A Canara Bank

सिक्पीरिटांजाडानेशन एवं रिकसारक्षान औष प्रास्तेष्ठियान अयोज्य गण्ड रमारीसीय और प्राम्नोतिन इंजीन नकत नकत नकत न

B E G C Collo www.livehindustan

आयकर विमाग ई-फाइलिंग पोर्टल 3.0 लॉन काम

दाखिल कर पाएंगे करने की प्रक्रिया को एस्तार मिलेगी।

दो महीने की गिरावट के बाद

जियातम् 0.5% को बिद्रत इस योजना की घोषणा की थी, जिसका उद्देश्य

प्रह्णाद जोशी ने कहा कि जलवायु परिवर्तन से निषटने के वैश्विक प्रवासों में भारत खुद को िष्रलाड़ी के रूप में स्थापित कर रहा मंह क्रो

1

साना नए सवव

सेंसेक्समें 319

छतों पर सीर उपकरण लगाकर एक करोड़ घरों की रोशान करना और हर महीने 300 यूनिट तक मुफ्त बिजाली उपलब्ध कराना है।

आरईसी पात्रर डेबलपमेट एंड कंसल्टेसी लिमिटेड

एक महारत बेंद्रीय सार्वकीक उसका) नीचे वींस्तरित प्रारंप परिवासनाकों की स्थापनों हेंद्र टी. वी. सी. सी. के अरात निर्माण, स्वानित्व, प्रचालन और स्थानांतरण (बृट्ड) के आधार पर प्रत्याव की अरात्रेय (आएफाण) एक चरण वे लिकाके बाली प्रक्रिया के तत्र प्रत्याव आपीत करात है। इच्चुक बीलीसता कृष्ण मिगों वेलसाइट्रा प्रणाप प्रप्राचाता का आधार प्रा मेर एड कंसल्टेंसी लिमिटेड, गई विल्ली, भारत (आरड्डी लिमिटेड के पूर्ण स्वामित्व की सहायक कंपनी

से नियासीणाइड

78, विज्ञापन

0

78,250天 तेजी की क

न भी से बावाह तार्थ कार्यक्रात्त्री

विक्रेताओं की सतत लिवाली के नई दिल्ली, एजेंसी। आमूषण

कारण बुधवार को राष्ट्रीय राजधानी के सर्गका बाजार में सोने की की मत 250 रुपये की तेजी के साथ 78,900 रुपये प्रति 10 ग्राम के नए सर्वकालिक उच्चस्तर पर पहुंच गई। मंगलवार को पिछले सत्र में सोना 78,650 रुपये ग्रति

उच्चस्तर परपहुना

मुंबई, एजेंसी। विदेशी कोषों की लगातार निकासी और वैश्विक बाजारों

अंक की गिरावट

लितिता, असएष्ट्रधी बत्तावेच सभी कार्य दिससी में 10.30 बने (मा.मा.स) से 16,00 बने (मा.मा.स) के बोन् (17.10.2024 अस्तान काग बदने की मिलि से एक दिन पहले तक) हमारी वेनसम्द्रम <u>अभ्यूप, म्हतातींग माह, गा और भूपप, म्हतातीं, मा</u>र अस्तान बनावें की परिवेचनाओं के असएपुनी दस्तावेंन में दिए गए विवासण के अनुसार प्रतेष्क पारेष्ण परियोजनाओं के निम मिलियों के पुनावेंन पर प्राप्त कर फरके हैं।

गरएकरी दराबेज हाती वेजसाइन्द्र <u>प्रथप recindla ग्रांट मा</u> कर्या <u>प्रथप्य स्टाबंदा में</u> में में इस्लगेड निया जा सकता मार्थणी, ऐसे मार्स में इस्कृत पर्टी संसीत आरफ्स दराबेज में गिर्ए गर्ए किया के अनुसार प्रजेश परिशेजनाओं में सिर्फ आपितियों पर सामग्री या मुक्त (१८ २०, 2000). एता मार्थ पर्य अनेत में 2000 (एता करार साम कर्या क्या करा १४% जीएसटी का असम में गुराबान करों पर में आरफ्सी के अपने में प्रत्याव प्रमाव प्रमाव करा करा है। को शिर्फ प्रमाप

आरएकपी प्रस्ताव खोलने का विवर्ण	20.12.2024 को 15:30 बजे (मा.मा.स)	20.12.2024 को 16:30 बजे (मा.मा.स)
आरएकपी के उत्तर में प्रस्ताव जगा की	20.12.2024, 15:00 बचे तक (भा.मा.स)	20.12.2024, 16:00 बजे तक (भा.मा.स)
स्पर्दीकरण मंगवाने की अंतिम तिहि	06.11.2024	06.11.2024
परियोजना का नाम	तरोगांन (पुणे) के निकट पम्यड पंडाएण हमता को पूरा करने के लिए पश्चिमी क्षेत्र में नेटवर्क विस्तार स्कीम	त्तिक्रिसिन क्षेत्र में अस्तावित ग्रीन हाड्डोक्न/ ग्रीन अमीनिया परियोजनाओं कि लिए परिषण प्रणाली
調が	-:	4

बोहों में सभी शुद्धिया, अनुरोप, देशोफन, समय बहुमा आदि हमारी नेबवाहरूस <u>www.recindia.nic.in</u> तथा www.recodol.in पर होस्ट किए बाएगी नवीनतम बानकाती के लिए हमारी नेबहाइट का निवीमा रूप ने अवस्तीकन कराते रहे। गेट. आरहीमीयोहफोएल के पाम निया कोई कारण बताए तथा निमा किसी बाज्यता केबोली ग्रांतियां को एड एर इसोसिय का अपिकार सुरक्षित हो यह काई पेशकर गहीं है। मुख्य कार्यपालक अधिकारी अमर्डली पावर डेबलस्तार गृंड कंत्रफ्टेंसी विनीमेड कोर - 4, स्कोप कीप्लोक्स, सोधी रोड, गई दिल्ली - 110003, भारत

नपक कर

क्रॉमेक्य सो बढ़कर 76, ग्राम हो गया

बढ़कार 2,6

10 ग्राम के नए रिकॉर्ड स्तर पर

रुपये उछलकर 78,500 दमये ग्रति

औस हो गया

UTTARAKHAND GIVIL AVIAT

डिलिवरी वा

268 रुपये

गई। मंगलवार को यह 92,500

93,500 रुपये प्रति किलोग्राम हो

चांदी भी 1,000 रुपये उछलक्त

99.5% शुद्धता वाला सोना 250

रुपये प्रति किलोग्राम पर बंद हुई थी

बताया। मल्ट

विक्रेताओं

औद्योगिक इकाइयों और सिक्का निर्माताओं की लिवाली के कारण

10 ग्राम पर बंद हुआ था।

के वायदा

आप्रेंसी पाचर डेबलपमेंट एंड संसल्टेंसी लिमिटेड REC Power Development बोली प्रक्रिया समन्यक

Unite House

कंडीय वियुत्त प्राधिकरण

언니저

भारत प्रसिद्ध

निगम 715 विभाग

विठ्यमित / जनमी / 2024-25

दिनांक-16.10.2024

के कमजोर रुख के बीच बुधवार को वाहन क्षेत्र के शेवरों में किकवाली का जोर रहने से स्थानीय बाजारों में गिरावट सूचना प्रौद्योगिकी (आईटी) और रही। मानक सूचकांक सेंसेक्स 319 अंक दूट गया जबकि निपदी 25,000 अंक के स्तर से नीचे आ गया। सेंसेक्स लगातार दूसरे दिन गिरावट पर रहा और 318.76 अंक फिसलकर कारोबार के दौरान एक समय यह 461.86 अंक गिरकर 81,358.26 अंक पर आगया था। निपटी भी 86.05 अंक की गिरावट के साथ 81,501.36 अंक पर बंद हुआ। वित वर्ष 2024-25 में कंपनियों की आय कम होने की आशंका के कारण बाजार में नकारात्मक रुझान के इससे प्रीमियम मूल्यांकन की स्थिरता साथ सीमित दावरे में कारोबार हुआ। 24,971.30 अंक पर बंद हुआ। प्रमावित हो सकती है।

रहेंच गया, जबकि पिछला बंद भाव श्रतिपूर्ति उपकर जीएसटी में शामिल करने पर चच

नई दिल्ली, विशेष संवादवाता। जीएसटी में चौचरी की अध्यक्षता में जीएसटी क्षतिपूर्ति उपकर शतिपूर्ति उपकर को शामिल किया जा सकता है। इसको लेकर बुधवार को वित्त राज्यमंत्री पंकज

REQUEST FOR PROPOSAL REP TUBROLET FOR THE MOVEMEN UTTARKHAND AND OF HER MISS Govt. of Ultarakhand and other miss Government of Ultarakhand and othermiss Sate of downloading tender document at

2. Date of Pre-bid meeting 3. Last Date for cniline submission of Tender

Hindustan Times

OCTOBER 18, 2024 **NEW DELHI**

> GAIL (India) Limited invites "Expression of Interest" (EOI) for direct sale of Liquefied CO2 from GAIL's Pata (Uttar Pradesh) and Vijaipur (Madhya of liquefied CO2, Tentative price and preferable location (Vijaipur or Pata or Pradesh) plant ex-works. Interested bidders can specify the desired Quantity both) for offitake of Liquefied CO2. Further, the bidders may also specify the grade (Food/industrial) and end use of CO2

For details of complete document of Eol, Bidders may please refer GAIL's Tender Website https://gailtenders.in/

Due Date & Time for submission of EOI by bidder is 08/11/2024 at 17:00 Hrs (IST) (dd.mm.yyyy, hhhhhrs, Indian Standard Time).

tered Office: 16, Bhikaji Cama Patace, R.K. Puram, New Delhi- 110066 (Corporate Identification Number: L40200DL1984GOI018976)

Fellow us on CO CO CO

REC POWER DEVELOPMENT AND CONSULTANCY LIMITED

SS ON BUILD, OWN, OPERATE AND TRANSFER FOR SELECTION OF TRANSMISSION SERVICE PROVIDER THROUGH TARIFF BASED
COMPETITIVE BIDDING TRANS DECORES AND ASSESSED.

d. a Meharstine Central Prints. Sector Understeinting Invites proposal for setting up of the balance of a metabase proposal for setting up of the balance of a manuscription process on Build, Own, Operated and Transler (BOO) following strige stage live envelope process of "Request for Proposal (RPP)", inlarested before process of "Request for Proposal (RPP) professed (RPP) included in Carbon Comments and RPP documents a reliable on our verbasia comments a reliable on our verbasia comments. velopment and Consultancy Limited, New Delhi, India (a wholly

voiders may obtain the RTP documents on all working days between 1030 hours (IST) to 1600 hours. In from 17-10.2024 to one day prince to bid submission date on payment of non-refundable fee of fas 50.0004-fundese Five Lath (Only) or US\$ 7000, USD paless Seven Thousand Only) + 18% GST for each smission project as per details provided in the respective RFP documents available on the website.

The Request for Proposal (RFP) documents can also be downloaded from our websites www.recpdd.in Rewinderdia.fl.c.i. however, in such cases interested parties can submit Response to RFP only on submission of non-teluridable see of Rs. 5,00,000-(Rupees Five Lath Only) or USS 7000 (US Delars Seven Thousand Only) + 18% GST for each transmission project as per detals provided in the respective RFP document. The survey report & defilications to RFP documents shall be issued to those bidders. ow. Us I for each transmission project as per details provided in the respective by report & clarifications to RFP documents shall be issued to those bidders, issed RFP documents by paying requisite fee. The important timelines in this

g of to RFP	24 at (IST)	24 at (IST)	rebsites
Details of Opening of Response to RFP	20.12.2024 at 15:30 Hrs (IST)	20.12.2024 at 16:30 Hrs (IST)	ted on our w
Last Date for Seeking Submission of clarifications Response to RFP	20.12.2024 up to 15.00 Hrs (IST)	20.12.2024 up to 16:00 Hrs (IST)	the RFP will be hos
Seeking clarifications	06.11.2024	06.11.2024	densions, etc. to
Name of Project	Network Expansion scheme in Western Region to cater to Pumped storage potential near Talagaon (Pune)	Transmission system for proposed 06.11.2024 20.12.2024 up to Green Hydrogen / Green Ammonia projects in Tuticorin area	All corrigenda, addenda, amendments, time extensions, etc. to the RFP will be hosted on our websites
No.	-	ci	All C

numeracement or mynetical institution, andders should regularly visit our websiles to keep themselves updated. Who second is the right to cancel or modify the process without assigning any reason and without any liability. This is not an offer. Executive Officer

Core-4, SCOPE Complex, 7, Lodni Road.

Sid Process Coordinator

REC Power Development and Consultancy Limited REC PowerDevelopment

Ministry of Power lovernment of India

dons in India, serves over one crore candidates annually. To tion experience, the agency has and ensure a smoother examinabeen transitioning most of its address the growing demand exams to an online format.

ODIs at an average of 16.34 besides a plenty of wickets in the Uttar Pradesh, with its 156 state polytechnic institutes, is well-positioned to accommodate the new NTA centres. The Technical Education Council has inicials to finalise the locations and operational procedures for these centres. Annyi Dinesh, special Government of UP, confirmed tiated discussions with NTA offisecretary, Technical Education, that at least five centres will be ated and managed entirely by will be given priority for these centres, and the Technical Edudetails from government-level NTA. Government polytechnics cation Council secretary, Ajit Kumar Mishra, has requested established in each district, operinstitutes.

ing in remote areas, by providing didates, particularly those resid-This initiative aims to alleviate the difficulties faced by canmore accessible and convenient examination centres.

ers. David is the second woman induction of Diana Edulji in 2023 and it should come as no surprise given the mark she has than 100 appearances for her made in her country both on and country, David is the secondoff the field. THE AGENCY PLANS TO ESTABLISH FIVE NODAL CENTRES IN EACH DISTRICT OF JITTAR PRADESH EXAMINATIONS JKE NEET, JEE, TO CONDUCT AND CUET MAJOR





sharad.deep@htlive.com

Sharad Deep

Neetu David

scalps and was also the first female player from India to women's ODI cricket with 141 claim 100 ODI wickets.

remained a threat for everyone career, David, famous for her

41 wickets in 10 Tests at an aver-

Thereafter in her 13 years' double braided hairstyle, with her left-arm spin and took age of 18.90 and 141 wickets in 97

rests and ODIs.

told about this ICC Hall of Fame Only this afternoon, I was just and I feel honoured too as my along with two great world name is inducted into the list "I didn't imagine this ever. cricketers," David told HT.

domestic cricket before calling it

a day in 2008.

David once again hogged the limelight on Wednesday as she Fame, along with England great

Almost after a gap of 16 years,

was inducted into the ICC Hall of

dynamic

Alastair Cook and

South African batter AB de Villifrom India to make it to the ICC

"I am thrilled to be part of this exclusive club. I would like to thank the ICC for the recognition, as well as all the BCCI, my friends those were a constant team-mates, coaches, family and source of support throughout ever, said it was a big surprise to her. "It came as a big surprise as my career," she added. She, howjay Silvester, Giriraj Bhatnagar etc not convinced my father to ust a fielder in the boys' cricket nere in Kanpur. I would not have become a cricketer had my sendidn't even imagine to play cricket ever in my life as I was iors like Tillu bhai, Sanjeev, San-

of Fame following the



Samajwadi Party chief Akhilesh Yadav


MAHARASHTRA ON WANTED THE INDIA **CWO-DAY VISIT TO** WILL EMBARK ON THE SP CHIEF, W FRIDAY, SAID HE BLOC TO WIN. POLL-BOUND

Maharashtra, where we had two MLAs, we will get more with full might. In U.P. also, seats and contest the elections seat-sharing will be finalised with the Congress soon."

written by him, continues to He also said, "I want to con-The Ramayana, which was lustice, there can be no Ram gratulate everyone on the occasion of Valmiki Jayanti today, nspire us to end the disparity in the society. Without social

**

NewDelhi



A prolific spinner with more









Kindustan Times

UTTARAKHANI

NEW DELHI FRIDAY OCTOBER 18, 2024

> When a group comes out then another group is allowed to enter," said Bhandari. "Since it is an ASI-protected of Ilquefied CO2, Tentative price and preferable location (Vijaipur or Pata or both) for offtake of Liquefied CO2. Further, the bidders may also specify the request post to the works into the contracts server grade (Food/industrial) and end use of CO2.

For details of complete document of EoI, Bidders may please refer GAIL's

Due Date & Time for submission of EOI by bidder is 08/11/2024 at 17:00 Hrs Tender Website https://gailtenders.in/

(IST) (dd.mm.yyyy, hinhhrs, Indian Standard Time). Registered Office: 16, Bhikaji Cama Palace, R.K. Puram, New Delhi-110066 (Corporate Identification Number: L40200DL1984GOI018976)

not permit entry to elderly peo-ple, persons with high blood pressure, acute diabetes and children below 5 years", said

to follow all norms issued by the

site, the temple committee had ASI. The temple committee will

Follow as on (1) (1)

REC POWER DEVELOPMENT AND CONSULTANCY LIMITED

GLOBAL INVITATION (Through e-bidding only)
FOR SELECTION OF TRANSMISSION SERVICE PROVIDER THROUGH TARIFF BASED
COMPETITIVE BIDDING (TRGS) PROCESS ON BUILD, OWN, OPERATE AND TRANSFER

a UP police constable in the Transit camp area of the district to settle disputes and extort police arrested a 23-year-old man for allegedly impersonating money from people, said offi-RUDRAPUR: Udham Singh Nagar

"Police have arrested a man Such acts tarnish the image of posing as a police constable.

Bhandari

uniform fre According to officials, some about a person's suspicious tion, when police arrived at the people informed local police activities in the Transit camp area in Rudrapur on Wednesday spot, they found the man wearing UP police uniform and when questioned about his work, he evening. Acting on the informafailed to reply satisfactorily.

policeman. Fitto extort mo settle the di SIDCUL, and get into an alt Police rec' disputes, said

booked him 'e 204 and 205,'e

"We started an investigation Lonani said.

report also confirmed rape of "Police arrested all of them after a complaint was filed by the minor girl," the circle officer the minor's father. The medical

and presented them in the court, from where they were sent to jail," he added.

MUSSOORIE MUNICIPAL BOARD IDENTIFIES STRUCTURE AS 'DILAPIDATED'

Forum objects to civic body's notiemolition THE FOR NOTTICE CHURCH DISREGE memorandum addressed to the Dehradun district magistrate sildar Kamai Rathore at the Savin Bansal through naib tehoffice of SDM Mussoorie. They demanded the municipal board **MUSSOORIE:** After the Mussetters@hindustantimes.com

HT Correspondent

REC Power Development and Consultancy Limited, New Delhi, India (a wholly owned subsidiary of REC India (a Adharatina Central Public Sector Undertholing) Invites proposal for spining up of the below menhorsel transmission projects frough TBC9 process on Build, Own, Operate and Transfer (BOOT) basis following single stiga two envelope process or Tsequest for Proposal (RFP). Interested bidders may refer to the Tsequest for Proposal (RFP) notifications and RFP documents available on our websites www.tcspcd.fd.ib & sww.tcahridia.ib.lib. vs. 1. 77:10.2028.

rs may obtain the RFP documents on all working days between 1030 hours (IST) to 1600 hours 17.10.2024 to one day prior to bld submission date on payment of non-refundable else of Rs. (Rbpose First Lakh Chity) or USS 7000 (US Dollars Seven Thousand Only) + 18% GST for each fon project as per dealist provided in the respective RFP obcuments available on the websites and

squest for Proposal (RFP) documents can also be downloaded from our websites <u>www.respdcl.in</u> Lestrida_Lie_Lih nowever, in such cases literasted parties can schmit Response to RFD only on sison of non-refundable fee of Rs. 5,0,0,000/-(Rupees Five Lalth Chity) or US\$ 7000 (US Dollars Thousand Chity) • 10% GST for each transmission project as a per details provided in the respective

% GST for each transmission project as per detalfs provided in the respective report & clarifications to RFP documents shall be issued to those bidders and RFP documents by paying requisite fee. The important timelines in this

oorie Municipal Board issued a Bazaar by citing the historic building as "dilapidated", the toric Christian Movement Save Forum have raised objections Church near near Library members of the Mussoorie Hisagainst the civic body's decision, people familiar with the matter demolition notice to the Christ

Details of Opening of PRESponse to RFP 20.12.2024 at 15:30 Hrs (IST)

Last Date for submission of Response to RFP F 20.12.2024 up to 15:00 Hrs (IST)

said on Thursday. The forum has accused the decree under the influence of municipality of issuing the land mafia without considering the community's religious senti-

All configenda, addenda, amendments, time extensions, etc. to the RFP will be hosted on our websites <u>vervecocida</u> in awww.rechrida.nic.b. Biddens.should.regularly visit our websites bi beep themselves updated. Mole: RECPDC, reserves the right to cancel or modify the process without assigning any reason and findout any palish. This should and offer.

06.11.2024 20.12.2024 up to 20.12.2024 at 16:00 Hrs (IST) 16:30 Hrs (IST)

nsmission system for proposed en Hydrogen / Green Ammonia ects in Tuticorin area

work Expansion scheme in Western Jion to cater to Pumped storage

Name of Project

REC Power Development and Consultancy Ltd. Core-4, SCOPE Complex, 7, Lodhi Road, New Delhi-110003, India

An Initiative of

REC Power Development and Consultancy Limited

REC PowerDevelopment Bid Process Coordinator

Chief Executive Officer

Mussoorie Traders Association Rajat Agarwal, they submitted a The members of the forum staged a protest on Wednesday evening. Led by president of the ments, they added

building and remove the "dilapiish the historical Christ Church to withdraw the notice to demoldated" tag from the buildings.

are conspiring against the church and are making an effort to demolish the ancient church by categorising it as dilapidated, Agarwal said, "Some people even though it is not."

heritage still in use by the Christian community for its prayer lighted the fact that the Christ Church in Mussoorie was built and it is a significant religious "The memorandum highin 1830, during the British rule, services," said executive mem-

The forum claimed that the ber of the forum Prem Singh.

importance 185
The munory
duct a pro ppadministra to decision to res he added. ici-Rohit Pra

ished on Wednesday evening."

HT PHOTO The Christ Church in Mussoorie.

church's historical and religious demolition notice disregards the

buildings in the survey of ducted by the Central Building Research Institute (CBRI) two months ago. Out of them, two vated their property, eight such owners in the list have demolished the dilapidated structures and three such structures at Radha Bhawan, Bata Gad and Landour Bazaar were demolproperties owners have renowere identified as dilapide RELIGICA Dal **HISTOR**by MPORT

has also enlisted the church ing. On objection being raised by are in a dilapidated condition Naithani while speaking on the issue of the demolition of the Christ Church building said, The survey conducted by CBRI property as a dilapidated buildthe Christian community, the municipal authorities will survey the area again to earmark which portions of the property out

and then take further action." a sensitive pal Christian C. measures reclem as per municipalines oorie, said,















अपना पडास

Eogedio www.livehindustan.com

वाल्मीकि जयंती से पूर्व दून में जगह-जगह हुए कार्यक्रम, झांकियों में महर्षि वाल्मीकि के प्रसंगों को प्रमुखता से दि

यूजेवीएज लिमिटेड

पत्राक: 947

दि0: 16.10.202 ई-निविदा नोटिस

कार्यात्य अधिशासी अभियन्ता (जानपद-हितीय), तखवाड बहुउददेशीय परियोजना, लखवाड भ में में हाकपत्थर द्वारा इच्छुक निविदादाताओं से ऑनलाईन निविदा आमंत्रित करता है। नि. प्रैका सक्षित्व विवरण निन्नवत् है

कार्य का माम— डाकपत्थर, देहरादून में रिथत लखवाड़ परियोजना के फील्ड हॉरप्टल और अधिकारी खेल परिसर की वार्षिक साफ संकाई, रखरखाव, बागवानी का कार्य (वर्ष 2024—25)। कार्य की अनुमानित लागतः Rs. 4083497.00 (जी०एस०टी० छोड़कर) निविदा स0 03/EE(Civil-II)/LMP/2024-25

वैबसाइट पर निविदा की उपलब्धता की तिथि एवं समय: 18.10.2024 सुबह 10.00 बजे से वेक्साईट www.ujvni.com एवं ई-प्रोक्योश्मेटपोर्टल'^http://uktenders.gov.in से ली वैक्साइट पर निविदा जमा करने की अन्तिम तिथि एवं समयः ०७.१1,2024 सांय १७.०० बजे तक निविदा सम्बन्धित परिशिष्ट, शुद्धि पत्र अथवा निरस्तीकरण के विवरण की जानकारी निगम जा सकती है।

अधिशासी अभियन्ता (जानपद-॥) विज्ञाली के दुरुपयोग से

उत्तराखण्ड लोक सेवा आयोग

संख्याः - 223 / 06 / प्रणसहात (विविवित) / G-2 / 2024-26 दिनांक: 16 अक्टूबर, 2024

विज्ञापित

प्रयोगशाला सहायक, विधि विज्ञान प्रयोगशाला (समूह 'ग') परीक्षा-2023

(वस्तुनिष्ट) परीक्षा के आधार पर अमिलेख सत्यापन सूची दिनांक 16,08,2024 को निर्गत की गयी। अभिलेखों के सत्यारान के पश्चात अई अभ्यार्थियां की प्रवीणता एतद्दारा सूचित किया जाता है कि विज्ञापन संख्याः A-11DR/S-3/2023-24 दिनांक प्रीक्षा-2023 के लिए रिक्तियां प्रकाशित की गयी थी, जिसके क्रम में दिनांक 26 मई 2024 को लिखित (वस्तुनिष्ट) परीक्षा आयोजित की गयी। लिखित सूची के क्रम में विज्ञापित रिक्तियों के सापंक्ष प्रयोगस्थाला सहायक, विधि विज्ञान प्रयोगशाला (समूह मा) परीक्षा-2023 का चयन परिणाम दिनांक 16,10,2024 को धोषित कर दिया गया है। अभ्यथियों के शूचनार्थ चयन परिणाम, कट आँफ 28.06.2023 द्वारा प्रयोगशाला सहायक, विधि विज्ञान प्रयोगशाला (समृह 'ग') मावस् एवं परीक्षा में सम्मिलित अभ्यार्थियां के प्राप्तांक आयोग की वेबसाईट

आरईसी पावर डेवलपसेंट एंड कंसल्टेसी लिपिटेड

(कॉपॉ१ट पड़चान संख्या: L40200DL1984GOI018976)

Follow are en 🕕 🔘 🕕 **FrergizingPossibilities**

वर का वारम संमावस् सहमानुर गई था। हर साम कराब सात

ror more befaits, piesse visif Antenders Autarakhand Civil Aviation Development Autiv पर होता हम दौरान देखा तो घर के दरवाजे का लॉक टूटा P.O.-Kulhan, Dehiadun, Uttarakhand 248013 चोर सोने के गहने और कीमती सामन ले गए।

विभाग निर्माण (गोपेश्वर) वेकास चमोली कायालय आमाण

mail.com

दिनांक 16.10.2024

ण सूचना पत्रांक 1652/दो-लेखा/एस०पी०ए०,

महामहिम राज्यपाल महोदय उत्तरार ग्रामीण निर्माण विभागो/ निगमों एवं उत्तराखण्ड में 23.10.2024 को अपरान्ह 12:00 हिन अपरान्ह 12.30 वजे उपस्थित ठेकेदारों अथवा उनके अधिकृत प्रतिनिधियों के समक्ष अधोहम ऑनलाईन इस कार्यालय में खोली जायेंगी। निविद्य के MMDA/HRDA/DLDA में पंजीक्षरी द्वारा निम्म कायों की ई-निविद्या ऑन-लाईन दिनांक सम्बन्ध में सभी सूचनाएँ/शतें http:/ 18.10.2024 से उपलब्ध रहेंगी।

्ड —्उपन (आएएप) दस्तावेज हमी कार्य दिखतां में 10.50ज्ञ (या.मा.स) हो 16.00 ज्यं (मा.मा.स) का आएएपो दस्तावेज स्व स्वाय ज्या कार्य की विधि से एक किन एक का इमार्य केवाहद्व <u>काण्य प्रकाशिता ता.</u> को थी प्रमण्य <u>काण्य विश्व में वा. 17.0.2021</u> से की प्रमण्य मुर्धा के आएएपो स्वायेज में विद्या मुक्ताय के अनुसार प्रजेक पर्एका परिवाजनाओं के लिए केवे कृपतान पर प्राप्त कर सकते हैं। इसे दस्ताव कार्य केवाहद्व <u>काण्य पर्णायोग का</u>र्य कार्य कर्णका मुक्ताय कार्य केवाह से कार्य कार्य केवाह में कार्य

मी दलीबेच हमारी वेबसाइट्रेंस <u>www.meindin nic.in वथा www.texpotel in</u> से भी डाउनलोड किया था सकता और ऐसे मानले में सुकक पार्टी संबंधिका आपसाओं स्तावनिक में मिंप गूप डिबंशण के अनुसार फलेड परिष्ण परिशंकाओं :आजिंदेये गी- व्यापणी मीण शुरूष (ट.5,00,000-, परिण साख स्पर्ए केन्सण) वा 57000 (प्याप्त का सहार साह त्या केन्स : बीएसट्टी) का अलग से मुगतन करों पर डी आएस्प्री के जाग में अत्याव क्या कर सकते हैं। पर्योद एंड आएस्ट्री वो के स्पर्धिकरण उन्हों बोलीबाताओं को बारी किया वाएगा, किरहोंने अभेबित शुरूक का भुगतान करें आरएस्प्रो

आपंत्री पाना डेनलागेंट एंड कंसरटेंडी निमिटंड, मुं हिल्लो, भारत (आपंद्री निमिटंड के पूर्ण इसमित्त की सहावक कत्मी एक पासारत केंद्रीम सार्वाकीक उधाका भी ने अल्लाविक पांत्रण परियोजनाओं की स्थारणों हुए दी. बी. धी. थी. के अतर्गत मिण, स्वामित्र अनावत्त असे स्थानला प्राप्त के अल्लावा हुए कर्माय एक अल्लावा हुए अल्लावा हुए कर कर एक तिलाक चाली प्रक्रिया के तहत प्रस्ताव आपनित करता है। इच्चुक की लीटाता कुरवा होगी वेकसासूद्र प्रथप्त प्रत्यावाना में. जो शा का अल्लावान हो।

टेरिफ के जरिए प्रतियोगिता बोली (टीबीसीबी) प्रक्रिया के माध्यम में 02 (बी) अंतर-राज्यीय परिषण परियोज

आर्ड्सी पावर डेबलपमेंट एंड कंस्क्टेंसी लिमिटेड

कार्य पूपा ठकदारा का निवदा करने की पंजीकृत की अवधि श्रेणी वैद्यता 6 7 மு 2 माह ''ड़ी'' एवं 90

20.12.2024 को 16:30 बजे (भा.मा.स)

20.12.2024, 16:00 बचे तक (भा.मा.स)

क्षेत्र में प्रस्तावित ग्रीन हाइड्रोजन / 06.11.2024 गोनिया परियोजनाओं कि लिए

20.12.2024 को 15:30 बन्ने (भा मा.स)

20.12.2024, 15:00 बजे तक (भा.मा.स)

06.11.2024

गांव (पुणे) के निकट पप्पड भंडारण क्षमता प्रा काने के लिए पश्चिमी क्षेत्र में नेटवर्क

परियोजन का नाम

आस्एफपी प्रस्ताव खोलने का विवरण

बोली में कमी मुद्धिया, अनुरोप, संगोपन, समय बढ़ाना आदि एमार्ग बेबधाइस yww.recindia.nis.u. तमा www.recolci.in पर होत्र कियाएंगो नवीनतम बन्तकारी के लिए इमारी वेबसाइट का नियमित रूप से अवलीकन करते रहे

एल के पास किना कोई कारण बताए तथा किना किसी बाध्यता केबोली प्रक्रिया को रह या संशोधित करने

मुख्य कार्यपालक अंगिरकारी आरईसी पावर डेकलपाँन एड कंसलन्देती जिलिटेड कोर - 4, स्कीप कीमलेबस, लोशी रोड, नई दिल्ली - 110005, भारत

सम्बन्धित उपखण्ड कार्यालय से ली दा मूल्य ई-चालान का हैड-0515008000100, निविदा (इं० अल्लादिया) अधिशासी अभियन्ता निमाण कावा स सम्बन्धित विस्तृत की शत आदि किसा भा काथ दिवस में इस काषारा ई-चालान मूल्य जी०एस०टी० न०-0^{III}।

स्वत्रययाग कायोलय धकारी,

पकालीन) :-पत्रांक-564/40-जि०पू०अ०/वि0

देनांक 16.10.2024

07-कंदारनाथः विधानसभा अवसर्गे - जिल्ला

उत्तराखण्ड लोक सेवा आयोग

आंख्या : 154 / 81 / 08 /डीवआरक / (माविशित) / सेवा-1 / 2023-24 पिन कोड- अभ्रक

Annexure A5

Date: 28.03.2025

CERTIFICATE BY BID EVALUATION COMMITTEE

Subject:

Selection of Successful Bidder as Transmission Service Provider to establish "Network Expansion scheme in Western Region to cater to Pumped storage potential near Talegaon (Pune)" through tariff based competitive bidding process

It is certified that:

- a. The entire bid process has been carried out in accordance with the "Tariff based Competitive Bidding Guidelines for Transmission Service" and "Guidelines for encouraging competition in development of the Transmission Projects" issued by Ministry of Power, Govt. of India under Section 63 of the Electricity Act, 2003 as amended from time to time.
- b. M/s Adani Energy Solutions Limited, with the lowest annual transmission charges of Rs. 2,214.45 million, emerged as the successful Bidder after the conclusion of electronic reverse auction.
- c. The transmission charges of Rs. 2,214.45 million discovered after electronic reverse auction is acceptable.

(Rajesh Kumar Singh)
General Manager,
CCGRO-II, SBI
Chairman, BEC

(Manjari Chaturvedi) Director (PSPA-I), CEA Member, BEC (Bhanwar Singh Meena)
Director (PSETD), CEA
Member, BEC

Haran_

(P. D. Lone)
Superintending Engineer,
WRPC
Member, BEC

(Amit Naik)
Superintending Engineer,
MSETCL
Member, BEC

(Alok Singh)
Chairman – WRNES
Talegaon Power
Transmission Limited (SPV)
Convener – Member, BEC



Annexure A6

REC Power Development and Consultancy Limited

(Formerly known as REC Power Distribution Company Limited, A wholly owned subsidiary of REC Limited, a 'Maharatna CPSE' under Ministry of Power, Govt. of India)

Ref No.: RECPDCL/TBCB/Talegaon/2025-26/ 89

REC Power Development

Vice President (BD)
Adani Energy Solutions Limited

(Formerly known as Adani Transmission Limited), 12th Floor, South Wing, KP Epitome – B Block, Makarba, S G Highway, Ahmedabad – 380051.

(Kind Attention: Sh. Sanjay Johari)

Establishment of "Network Expansion scheme in Western Region to cater to Pumped storage potential near Talegaon (Pune)" through Tariff Based Competitive Bidding Process (TBCB) – Letter of Intent.

Sir.

We refer to:

- 1. The Request for Proposal (RfP) dated 17.10.2024 comprising RfP, Draft Transmission Service Agreement, Share Purchase Agreement and Survey Report dated 30.10.2024 issued to M/s Adani Energy Solutions Limited, as regards participation in the Global Invitation for Bids for establishment of "Network Expansion scheme in Western Region to cater to Pumped storage potential near Talegaon (Pune)" through Tariff Based Competitive Bidding process including all correspondence/clarifications/amendments/errata/corrigendum issued by REC Power Development and Consultancy Limited in regard thereto (hereinafter collectively referred to as the 'Final RFP') till the submission Bid Deadline and as listed below:
 - (i) Amendment-I dated 18.11.2024,
 - (ii) Clarifications dated 25.11.2024
 - (iii) Amendment-II dated 19.12.2024,
 - (iv) Amendment-III and Additional Clarifications dated 24.12.2024,
 - (v) Additional Clarifications dated 26.12.2024,
 - (vi) Amendment-IV dated 30.12.2024,
 - (vii) Amendment-V and Additional Clarifications dated 01.01.2025,
 - (viii) Amendment-VI dated 06.01.2025.
 - (ix) Amendment-VII dated 08.01.2025,
 - (x) Amendment-VIII dated 18.01.2025,
 - (xi) Amendment-IX dated 29.01.2025,
 - (xii) Amendment-X and Additional Clarifications dated 08.02.2025,
 - (xiii) Amendment-XI dated 13.02.2025.
 - (xiv) Amendment-XII dated 19.02.2025.
 - (xv) Amendment-XIII dated 20.02.2025.
 - (xvi) Amendment-XIV dated 27.02.2025.
 - (xvii) Amendment-XV dated 07.03.2025,
- 2. The offer of M/s Adani Energy Solutions Limited by way of a Technical Bid pursuant to (1) above submitted on 07.03.2025 in response to the Final RFP.
- The Initial Price Offer of M/s Adani Energy Solutions Limited as submitted on 07.03.2025 in response to the Final RFP.
- 4. The final offer of M/s Adani Energy Solutions Limited, discovered during e-Reverse Auction, conducted on 19.03.2025 in response to the Final RFP.
- The Technical Bid as in (2) above, the Initial Price Offer as in (3) above and the Final Offer as in (4) above hereinafter collectively referred to as the 'Bid'.



Contd soment and Containing Gurugram

We are pleased to inform you that your proposal and offer received by way of the 'Bid' has been accepted and M/s Adani Energy Solutions Limited is here by declared as Successful Bidder as per clause 3.6.1 of the Final RFP for the above project and consequently, this Letter of Intent (hereinafter referred to as the 'Lol') is being issued in 2 copies, One original plus One copy.

This Lol is based on the Final RFP and is further contingent upon you satisfying the following conditions:

- (a) Acknowledging its issuance and unconditionally accepting its contents and recording 'Accepted unconditionally' under the signature and stamp of your authorized signatory on each page of the duplicate copy of this letter attached herewith and returning the same to REC Power Development and Consultancy Limited within 7 (Seven) days from the date of issuance of Lol.
- (b) Completion of various activities as stipulated in the RFP including in particular Clause 2.15.2, Clause 2.15.3 and Clause 2.15.4 of the Final RFP within the timelines as prescribed therein.
- (c) Provide the Contract Performance Guarantee of Rs. 31.00 Crore (Rupees Thirty-One Crore Only) within 10 (Ten) days from issue of this Lol, in favour of the Central Transmission Utility of India Limited, as per the provisions of Clause 2.12.

It may be noted that REC Power Development and Consultancy Limited has the rights available to them under the Final RFP, including rights under clause 2.15.5 and 3.6.3 thereof, upon your failure to comply with the aforementioned conditions.

As you are aware, the issuance and contents of this Lol are based on the Bid submitted by you as per the Final RFP including the Transmission Charges and other details regarding the Scheduled COD as contained therein. The Quoted Transmission Charges as submitted by you and the Scheduled COD of transmission elements as agreed by you in your Bid, as per Annexure 21 and Format-1 of Annexure-8 respectively of the Final RFP is enclosed herewith as Schedule-A and incorporated herein by way of reference.

Further, please note that relationship of M/s Adani Energy Solutions Limited with the REC Power Development and Consultancy Limited & Central Transmission Utility of India Limited will be governed solely on the basis of the Final RFP.

You are requested to unconditionally accept the Lol, and record on one copy of the Lol, 'Accepted unconditionally', under the signature of the authorized signatory of your Company and return such copy to us within 7 (Seven) days of issue of Lol.

Yours faithfully.

Gurugram

(t.s.c. bosh) 08/04/25 CEO, RECPDCL

Enclosures:

1. Schedule A: Quoted Transmission Charges and the scheduled COD of transmission element submitted in your Bid, as per Annexure 21 and Format-1 of Annexure-8 respectively of the Final RfP.

Copy for kind information to:

1. The Secretary,

Central Electricity Regulatory Commission, 6th Floor, Tower B, World Trade Centre, Nauroji Nagar, New Delhi-110029

2. The Joint Secretary (Transmission),

Ministry of Power, Shram Shakti Bhawan, Rafi Marg, New Delhi- 110 004.

3. The Director (Transmission),

Ministry of Power, Govt, of India, Shram Shakti Bhawan, Raft Marg, New Delhi 110001

4. The Chairperson,

Central Electricity Authority, Sewa Bhawan, R K Puram, New Delhi-110086.

5. The Chief Operating Officer

Central Transmission Utility of India Limited, 5th to 10th Floor, Ircon International Tower, Tower No.-1, Plot No. 16, Sector 32, Gurugram, Haryana – 122003.

6. The Chief Engineer (PSP & A -I)

Central Electricity Authority, Sewa Bhawan, R.K. Puram, New Delhi – 110066.







ANNEXURE 21 - FORMAT FOR FINANCIAL BID

Quoted Annual Transmission Charges: Rs. 2,214.45 Million

Notes:

- 1. The Bidders are required to ensure compliance with the provisions of Clause 2.5.3 of this RFP.
- 2. Quotes to be in Rupees Millions and shall be up to two (2) decimal points.
- 3. The contents of this format shall be clearly typed.
- 4. The Financial Bid shall be digitally signed by the authorized signatory in whose name power of attorney as per Clause 2.5.2 is issued.
- 5. Ensure only one value for annual Transmission Charges is quoted. The same charge shall be payable every year to TSP for the term of TSA.









UNDERTAKING AND DETAILS OF EQUITY INVESTMENT

Date: 06.03.2025

To.

Chief Executive Officer. **REC Power Development and Consultancy Limited** (formerly REC Power Distribution Company Limited) (A wholly owned subsidiary of REC Limited) REC Corporate Head Quarter, D Block, Plot No. 1 - 4. Sec - 29 Gurugram - 122 001

Dear Sir.

Sub: Bidders' Undertakings in respect of Bid for selection of Bidder as TSP to establish Inter-State transmission system for "Network Expansion scheme in Western Region to cater to Pumped storage potential near Talegaon (Pune)"

We hereby undertake on our own behalf and on behalf of the TSP, that if selected as the Successful Bidder for the Project:

- 1. The Project shall comply with all the relevant electricity laws, codes, regulations, standards and Prudent Utility Practices, environment laws and relevant technical, operational and safety standards, and we shall execute any agreements that may be required to be executed as per law in this regard.
- 2. We confirm that the Project shall also comply with the standards and codes as per Clause 1.6.1.2 of the RFP and the TSP shall comply with the provisions contained in the Central Electricity Regulatory Commission Grant of Connectivity, Long-term Access and Medium-term Open Access in inter-state Transmission and related matters Open Access) Regulations, 2009.
- 3. We give our unconditional acceptance to the RFP dated 17.10.2024 issued by the BPC and the RFP Project Documents, as amended, and undertake to ensure that the TSP shall execute all the RFP Project Documents, as per the provisions of this RFP.

Adani Energy Solutions Ltd (Formerly known as Adani Transmission Limited) Fax +91 79 2555 7177 Adani Corporate House Shantigram, Near Vaishno Devi Circle. S. G. Highway, Khodiyar, Ahmedabad 382 421

Guiarat, India CIN: L40300GJ2013PLC077803

Tel +91 79 2555 7555 info@adani.com www.adanienergysolutions.com

Soluc



4. We have submitted the Bid on the terms and conditions contained in the RFP and the RFP Project Documents. Further, the Financial Bid submitted by us is strictly as per the format provided in Annexure 21 of the RFP, without

mentioning any deviations, conditions, assumptions or notes in the said

- Annexure.
- 5. Our Bid is valid up to the period required under Clause 2.8 of the RFP.
- Our Bid has been duly signed by authorized signatory and stamped in the manner and to the extent indicated in this RFP and the power of attorney / Board resolution in requisite format as per RFP has been enclosed with this undertaking.
- 7. Not Applicable
- 8. We confirm that our Bid meets the Scheduled COD of each transmission Element and the Project as specified below:

Sr. No	Name of the Transmission Element	Scheduled COD in months from Effective Date	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre- required for declaring the commercial operation (COD) of the respective Element
1	Establishment 2x1500 MVA, 765/400 kV Substation near South of Kalamb with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor			All Elements are required to be commissioned Simultaneously
2	LILO of Pune-III – Boisar- II 765 kV D/C line at South Kalamb S/s with associated bays at South Kalamb S/s	01.01.2028	100%	as their utilization is dependent on commissioning of
3	Installation of 1x240 MVAr switchable line reactor on each ckt at South Kalamb end of		power Trans	each other

Adani Energy Solutions Ltd (Formerly known as Adani Transmission Limited) Adani Corporate House Shantigram, Near Vaishno Devi Circle, S. G. Highway, Khodiyar,

Ahmedabad 382 421 Guiarat, India

CIN: L40300GJ2013PLC077803

Tel +91 79 2555 7555 Fax +91 79 2555 7177 info@adani.com www.adanienergysolutions.com

Section of Comment Administration Charleson Manufalter Conf Circle C O Historian Manufalter Administration 700 400





Sr. No	Name of the Transmission Element	Scheduled COD in months from Effective Date	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre- required for declaring the commercial operation (COD) of the respective Element
	Boisar-II – South Kalamb 765 kV D/C line (formed after above LILO)			

We agree that the payment of Transmission Charges for any Element irrespective of its successful commissioning on or before its Scheduled COD shall only be considered after the successful commissioning of Element(s) which are pre-required for declaring the commercial operation of such Element as mentioned in the above table.

Scheduled COD for the Project: 01.01.2028

- 9. We confirm that our Financial Bid conforms to all the conditions mentioned in this RFP, and in particular, we confirm that:
 - a. Financial Bid in the prescribed format of Annexure 21 has been submitted duly signed by the authorized signatory.
 - b. Financial Bid is unconditional.
 - c. Only one Financial Bid has been submitted.
- 10. We have neither made any statement nor provided any information in this Bid, which to the best of our knowledge is materially inaccurate or misleading. Further, all the confirmations, declarations and representations made in our Bid are true and accurate. In case this is found to be incorrect after our acquisition of WRNES TALEGAON POWER TRANSMISSION LIMITED, pursuant to our selection as Selected Bidder, we agree that the same would be treated as a TSP's Event of Default under Transmission Service Agreement, and relevant provisions of Transmission Service Agreement shall apply.

Tel +91 79 2555 7555

nited) Fax +91 79 2555 7177

info@adani.com

www.adanienergysolutions.com

Solution & Solution



- 11. We confirm that there are no litigations or other disputes against us which materially affect our ability to fulfill our obligations with regard to the Project as per the terms of RFP Project Documents.
- 12. Power of attorney/ Board resolution as per Clause 2.5.2 is enclosed.

Name

: Mr. Avijit Roy

Designation

: Authorized Signatory

Date

: 06.03.2025

Place

: Ahmedabad

Common seal of Adani Energy Solutions Limited has been affixed in my / our presence pursuant to Board of Director's Resolution dated 22.10.2024

WITNESS

Signature:

Name: Amit Chatteriee

Designation: Authorized Signatory

Date: 06.03.2025

Signature: -

Name: Bhatt Grishma

Designation: Authorized Signatory

Date: 06.03.2025



CIN: L40300GJ2013PLC077803

Annexure A7

Ahmedabad ·

World Business House, M.G.Road Nr.Parimal Garden, Ellis Bridge Ahmedabad SWIFT/IFSC Code: INDBINBBAHA/INDB0000009

To.

CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED, 5TH TO 10 TH FLOOR, IRCON INTERNATIONAL TOWER, TOWER NO, 1, PLOT NO 16, SECTOR 32 GURUGRAM, Gurgaon, Haryana, 122003 INDIA

Date: May 29, 2025

Dear Sir / Madam,

At the request of ADANI ENERGY SOLUTIONS LIMITED, we have issued guarantee as per following details.

Bank Guarantee No & Date of Issue	OGT0009250005637 May 29, 2025	
Amount	INR 310000000.00	
Expiry Date	Jun 30, 2028	
Claim Date	Jun 30, 2029	

We confirm that the officials who have signed the above bank guarantee are authorized to sign the same on behalf of IndusInd Bank Ltd. You may verify the genuineness of issuance of said Bank Guarantee by writing to Head, Bank Guarantee Operations, at the following address

Indusind Bank Limited CGMO Central Processing Centre PNA House, 3rd Floor, Plot No.57 & 57/1, Street No.17, Near ESI Hospital, MIDC, Andheri (East), Mumbai - 400 093. Mail ID: opsguarantee@indusind.com Tel No 022 61098390 / 022 61098478

Claims, if any under this Guarantee to be lodged only with the Issuing Branch as per the terms of the Bank Guarantee.



THIS IS A COMPUTER GENERATED ADVICE. NO SIGNATURE REQUIRED.

Please note that this advice provides details of the transaction handled by us on your behalf including details of charges / GST deducted (if applicable). In case you have registered your GSTIN details with us, you will receive a separate GST invoice (if applicable) on your registered mail id. We request you to ensure that your GSTIN details have been submitted to us and that your email id is registered with us to receive the GST invoice.

In case you wish to register your GSTIN details with us, please send an email to GSTC@indusind.com from your registered mail id and courier the documents to us at the following address: Indusind Bank Limited - GST Client Support Team, One Indiabulis Centre, Tower 1, 8th Floor, 841 Senapati Bapat Marg, Elphinstone Road (W), Mumbai — 400 013. For any queries, please feel free to contact your Service manager/ Relationship manager/



93



INDIA NON JUDICIAL Government of Gujarat

Certificate of Stamp Duty

Certificate No.

IN-GJ22306338520005X

Certificate Issued Date

22-May-2025 04:07 PM

Account Reference

IMPACC (SV)/ gi13269804/ GULBAI TEKRA/ GJ-AH

Unique Doc. Reference

SUBIN-GJGJ1326980453132149048113X

Purchased by

INDUSIND BANK LIMITED

Description of Document

Article 32 Letter of Guarantee

Description

BANK GUARANTEE

Consideration Price (Rs.)

(Zero)

First Party

3525 04:07 PM 22-May-2025 04:07 PM 22-May-2026 04:07 PM 22-May-2026 04:07 PM 22-May-2026 04:07 PM 22-May

22.May-2025 04:07 PM 22.May-2026 04:07 PM 22-May-2025 04:07 PM 22-May-2025 04:07

INDUSIND BANK LIMITED

Second Party

CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED

Stamp Duty Paid By

INDUSIND BANK LIMITED

Stamp Duty Amount(Rs.)

300

(Three Hundred only)

This Non-Judicial Stamp Paper Forms Part An Parcel of this 5G Number 0 050009 25 0005632 (Issuance | Amendment | Dated 29-05-2025

FOPINE 31,00,00,0001-





For, Indusing Bank Ltd Authorized Sign



U-GJ2 06338520005X

GG 0009,785515



- The authenticity of this Stamp certificate should be verified at 'www.shcilestamp.com' or using e-Stamp Mobile App of Stock Holding.
 Any discrepancy in the details on this Certificate and as available on the website / Mobile App renders it invalid.
 The onus of checking the legitimacy is on the users of the certificate.
- 3. In case of any discrepancy please inform the Competent Authority.



SR No. GTEE/ 0171159 CONTRACT PERFORMANCE GUARANTEE

BANK GUARANTEE NO: OGT0009250005637

DATE: 29.05.2025

To,
ED (BCD and Regulatory),
Central Transmission Utility of India Limited,
5th to 10th Floor,
Ircon International Tower, Tower no-1,
Plot no -16, Sector-32, Gurugram,
Haryana-122003

In consideration of the M/s Adani Energy Solutions Limited having its registered office at Adani Corporate House, Shantigram, Nr. Vaishnodevi Circle, SG Highway, Ahmedabad -382421 agreeing to undertake the obligations under the Transmission Service Agreement to be executed on dated 30.05.2025 and the other RFP Project Documents and the Central Transmission Utility of India Limited and REC Power Development and Consultancy Limited, agreeing to execute the RFP Project Documents with the Selected Bidder, regarding setting up the Project, We IndusInd Bank Limited, a banking company incorporated and registered under Companies Act 1956 and having license to carry on banking business under the Banking Regulation Act, 1949 having its Registered Office at 2401, General Thimmayya Road, Cantonment, Pune - 411 001 and its Corporate Office at 8th Floor, Tower -1, One India Bulls Centre, 841, S.B. Marg, Elphistone Road, Mumbai - 400 013 and its one of Branch Office at IndusInd Bank Limited, World Business House, M. G. Road Nr. Parimal Garden, Ellis Bridge, Ahmedabad - 380 006 (hereinafter referred to as Guarantor Bank) hereby agrees unequivocally, irrevocably and unconditionally to pay to Central Transmission Utility of India Limited (being the Nodal Agency) having address at 5th to 10th Floor, Ircon International Tower, Tower no-1, Plot no -16, Sector-32, Gurugram, Haryana-122003, forthwith on demand in writing from the Nodal Agency or any Officer authorized by it in this behalf, any amount up to and not exceeding Rs. 31,00,00,000/- (Rupees Thirty One Crore Only) on behalf of M/s Adani Energy Solutions Limited.

This guarantee shall be valid and binding on the Guarantor Bank up to and including 30.06.2028 and shall not be terminable by notice or any change in the constitution of the Bank or the term of the Transmission Service Agreement or by any other reasons whatsoever and our liability hereunder shall not be impaired or discharged by any extension of time or variations or alternations made, given, or agreed with or without our knowledge or consent, by or between parties to the respective agreement.

Our liability under this Guarantee is restricted to Rs. 31,00,00,000/- (Rupees Thirty One Crore Only) Our Guarantee shall remain in force until 30.06.2028 The Nodal Agency shall be entitled to invoke this Guarantee up to three hundred sixty five (365) days of the last date of the validity of this Guarantee.

The Guarantor Bank hereby expressly agrees that it shall not require any proof in addition to the written demand from the Central Transmission Utility of India Limited (in its role as the Nodal Agency), made in any format, raised at the above mentioned address of the Guarantor Bank, in order to make the said payment to the Nodal Agency.

The Guarantor Bank shall make payment hereunder on first demand without restriction or conditions and notwithstanding any objection by Adani Energy Solutions Limited, WRNES Talegaon Power Transmission Limited, and/or any other person. The Guarantor Bank shall not require the Nodal Agency to justify the invocation of this BANK GUARANTEE, nor shall the Guarantor Bank have any recourse against the Nodal Agency in respect of any payment made hereunder.

For, Indusind Bank Ltd.
CGMO, Appredabad Branch
Authorized Signatory



BANK GUARANTEE NO: OGT0009250005637

DATE: 29.05.2025

This BANK GUARANTEE shall be interpreted in accordance with the laws of India.

The Guarantor Bank represents that this BANK GUARANTEE has been established in such form and with such content that it is fully enforceable in accordance with its terms as against the Guarantor Bank in the manner provided herein.

This BANK GUARANTEE shall not be affected in any manner by reason of merger, amalgamation, restructuring, liquidation, winding up, dissolution or any other change in the constitution of the Guarantor Bank.

This BANK GUARANTEE shall be a primary obligation of the Guarantor Bank and accordingly the Nodal Agency shall not be obliged before enforcing this BANK GUARANTEE to take any action in any court or arbitral proceedings against WRNES Talegaon Power Transmission Limited or Adani Energy Solutions Limited, as the case may be, to make any claim against or any demand on WRNES Talegaon Power Transmission Limited or Adani Energy Solutions Limited, as the case may be, or to give any notice to WRNES Talegaon Power Transmission Limited or Adani Energy Solutions Limited, as the case may be, or to enforce any security held by the Nodal Agency or to exercise, levy or enforce any distress, diligence or other process against WRNES Talegaon Power Transmission Limited or Adani Energy Solutions Limited, as the case may be.

The Guarantor Bank acknowledges that this BANK GUARANTEE is not personal to Nodal Agency and may be assigned, in whole or in part, (whether absolutely or by way of security) by Nodal Agency to any entity to whom the Nodal Agency is entitled to assign its rights and obligations under the Transmission Service Agreement.

The Guarantor Bank hereby agrees and acknowledges that the Nodal Agency shall have a right to invoke this Bank Guarantee either in part or in full, as it may deem fit.

Notwithstanding anything contained hereinabove, our liability under this Guarantee is restricted to Rs. 31,00,00,000/- (Rupees Thirty One Crore Only) with an additional claim period of three hundred sixty five (365) days thereafter. This BANK GUARANTEE shall be extended from time to time for such period, as may be desired by M/s Adani Energy Solutions Limited. We are liable to pay the guaranteed amount or any part thereof under this Bank Guarantee only if the Nodal Agency serves upon us a written claim or demand.

Date: 2025-05-29	
Place: Ahmedabad	
Authorized Signatorie	

Authorized Signatorie

Signature:

Name:

<u>SAMIR SHAH</u> S S No. 17815

Signature Code:

Signature:

Namai

Signature Code:

S S No 9065

INDUSIND BANK LIMITED

Corporate & Global Market Operations
World Business House
M. G. Road, Near Parimal Garden,
Ellis Bridge, Ahmedabad - 380 006.





Ahmedabad

World Business House, M.G.Road Nr.Parimal Garden, Ellis Bridge Ahmedabad

SWIFT/IFSC Code: INDBINBBAHA/INDB0000009

To.

ED (BCD AND REGULATORY), CENTRAL TR ANSMISSION UTILITY OF INDIA LIMITED, 5TH TO 10TH FLOOR, IRCON INTERNATIO, NAL TOWER, TOWER NO 1, PLOT NO 16 S, Gurgaon, Haryana, 122003 INDIA

Date: May 31, 2025

At the request of the applicant, we have amended the guarantee, details of which are as follows:-

Bank Guarantee No	OGT0009250005637	
Date of Amendment	May 31, 2025	D. (Mariel 14
Amendment SI	AMD001	
Expiry Date	Jun 30; 2028	***************************************
Amount	INR 310000000.00	THE STATE OF THE S
Latest Claim Date	Jun 30, 2029	

Please find attached the amendment that forms an integral part of original guarantee & must be kept attached there with . On fulfillment of the obligation expiry, Kindly return the original guarantee with the amendment directly to us. We confirm that the said amendment is signed by the authorized signatories of the bank.

You may verify the genuineness of issuance of said BG amendment by writing to Head, bank Guarantee Operations, at the following address.

IndusInd Bank Limited
CGMO Central Processing Centre

PNA House, 3rd Floor, Plot No.57 & 57/1, Street No.17, Near ESI Hospital, MIDC, Andheri (East), Mumbai - 400 093.



THIS IS A COMPUTER GENERATED ADVICE. NO SIGNATURE REQUIRED

Please note that this advice provides details of the transaction handled by us on your behalf including details of charges / GST deducted (if applicable). In case you have registered your GSTIN details with us, you will receive a separate GST invoice (if applicable) on your registered mail id. We request you to ensure that your GSTIN details have been submitted to us and that your email id is registered with us to receive the GST invoice.

In case you wish to register your GSTIN details with us, please send an email to GSTC@indusind.com from your registered mail id and courier the documents to us at the following address: IndusInd Bank Limited - GST Client Support Team, One Indiabulls Centre, Tower 1, 8th Floor, 841 Senapati Bapat Marg, Elphinstone Road (W), Mumbai — 400 013.

For any queries, please feel free to contact your Service manager/ Relationship manager"



INDISIND BANK LIMITED INDUSIND BANK LIMITED INDUSTRIAL BANK LIMITED BANK L

INDIA NON JUDICIAL

Government of Gujarat

Certificate of Stamp Duty



Certificate No.

11:48 AM 31 MAY 2025 11:48 AM 31 MAY 2025 11:48 AM 31-MAY 2025 11:48 AM 31

IN-GJ28949538693206X

Certificate Issued Date

31-May-2025 11:48 AM

Account Reference

IMPACC (SV)/gj13269804/ GULBAI TEKRA/ GJ-AH

Unique Doc. Reference

SUBIN-GJGJ1326980466186520404505X

Purchased by

INDUSIND BANK LIMITED

Description of Document

Article 32 Letter of Guarantee

Description

BANK GUARANTEE

Consideration Price (Rs.)

0 (Zero)

First Party

31-May-2026 11-48 AM 31-May-2026

INDUSIND BANK LIMITED

Second Party

CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED

Stamp Duty Paid By

INDUSIND BANK LIMITED

Stamp Duty Amount(Rs.)

300

(Three Hundred only)

This Non-Judicial Stamp Paper Forms Part And Parcel of this BG Number 067009250006689 (leasure / Amendment | Dated 31.05- 2025

31,00,00,0001-





For, Indusind Bank Ltd. Authorized Signa

N-GJ289 9538693206X

Statutory Alert:

The authenticity of this Stamp certificate should be verified at 'www.shcilestamp.com' or using e-Stamp Mobile App of Stock Holding. Any discrepancy in the details on this Certificate and as available on the website / Mobile App renders it invalid.

The onus of checking the legitimacy is on the users of the certificate.

In case of any discrepancy please inform the Competent Authority.

BG Number: OGT0009250005637 Amendment Date: May 31, 2025

BANK GUARANTEE REFERENCE NUMBER: OGT0009250005637

DATE OF AMENDMENT: 31/05/2025

To,
ED (BCD and Regulatory),
Central Transmission Utility of India Limited,
5th to 10th Floor,
Ircon International Tower, Tower no-1,
Plot no -16, Sector-32, Gurugram,
Haryana-122003

Sir,

Subject : Amendment of the bank guarantee Bank Guarantee Number : OGT0009250005637

Amount: INR 31,00,00,000.00

Issue date: 29/05/2025

Present expiry date: 30/06/2028 Present claim expiry date: 30/06/2029

Applicant : ADANI ENERGY SOLUTIONS LIMITED

We IndusInd Bank Ltd, World Business House, M. G. Road Nr. Parimal Garden, Ellis Bridge, Ahmedabad - 380 006 herby amend the Bank Guarantee text as per below instead of existing.

Text Changes in BG text:

Where it read as:

Notwithstanding anything contained hereinabove, our liability under this Guarantee is restricted to Rs. 31,00,00,000/- (Rupees Thirty One Crore Only) with an additional claim period of three hundred sixty five (365) days thereafter. This BANK GUARANTEE shall be extended from time

Page 1 of 2

For, Indusind Bank Ltd.

Authorized Signatory



BG Number: OGT0009250005637 Amendment Date: May 31, 2025

to time for such period, as may be desired by M/s Adani Energy Solutions Limited. We are liable to pay the guaranteed amount or any part thereof under this Bank Guarantee only if the Nodal Agency serves upon us a written claim or demand.

Text Changes in BG text: Now to be read as:

Notwithstanding anything contained hereinabove, our liability under this Guarantee is restricted to Rs. 31,00,00,000/- (Rupees Thirty One Crore Only) and it shall remain in force until 30.06.2028 with an additional claim period of three hundred sixty five (365) days thereafter. This BANK GUARANTEE shall be extended from time to time for such period, as may be desired by M/s Adani Energy Solutions Limited. We are liable to pay the guaranteed amount or any part thereof under this Bank Guarantee only if the Nodal Agency serves upon us a written claim or demand.

ALL OTHER TERMS AND CONDITIONS OF THE ABOVE GUARANTEE REMAIN UNCHANGED.

Date: 31/05/2025 Place: Ahmedabad Authorized Signatories:

Signature: Name:

Signature Code: S S No. 17815 AVP

Signature:

Signature Code:

Page 2 of 2

INDUSIND BANK LIMITED Corporate & Global Market Operations

World Business House M. G. Road, Near Parimal Garden, Ellis Bridge, Ahmedabad - 380 006.





SHARE PURCHASE AGREEMENT

BETWEEN

REC POWER DEVELOPMENT AND CONSULTANCY LIMITED

AND

WRNES TALEGAON POWER TRANSMISSION LIMITED

AND

ADANI ENERGY SOLUTIONS LIMITED

Dated: 30th May, 2025





INDIA NON JUDICIAL

Government of National Capital Territory of Delhi

e-Stamp

Certificate No.

IN-DL90407493934578X

Certificate Issued Date

26-May-2025 03:35 PM

Account Reference

SELFPRINT (PU)/ dl-self/ NEHRU/ DL-DLH

Unique Doc. Reference

SUBIN-DLDL-SELF19316228059509X

Purchased by

REC POWER DEVELOPMENT AND CONSULTANCY

Description of Document

Article 5 General Agreement

Property Description

CORE-4,SCOPE COMPLEX, 7, LODHI ROAD, NEW DELHI-110003

Consideration Price (Rs.)

First Party

WRNES TALEGAON POWER TRANSMISSION LIMITED

Second Party

ADANI ENERGY SOLUTIONS LIMITED

Stamp Duty Paid By Stamp Duty Amount(Rs.) WRNES TALEGAON POWER TRANSMISSION LIMITED

(Five Hundred only)



SELF PRINTED CERTIFICATE TO BE VERIFIED BY THE RECIPIENT AT WWW.SHCILESTAMP.COM

IN-DL90407493934576X

Please write or type below this line

SHARE PURCHASE AGREEMENT

This SHARE PURCHASE AGREEMENT ('Agreement') made on the 30th day of May, 2025 at New Delhi by and between:

REC POWER DEVELOPMENT AND CONSULTANCY LIMITED, a company incorporated under the Companies Act, 1956, vide CIN-U40101DL2007GOI165779 having its registered office at Core 4, SCOPE Complex, 7, Lodhi Road, New Delhi 110 003, India (hereinafter referred to as "REC PDCL", which expression shall, unless it be repugnant to the context or meaning thereof, be deemed to mean and include its successors and permitted assigns) of the FIRST PART

Gurugram RECPDCL

WRNES TPTL

New Delhi 110003

Statutory Alert: emissite should be verified at www.shoilestamp.com, this Certificate and as available on the website / Mot The authenticity of this Any discrepanity in the

The onus of checking the legitimacy is on the usors of the certificate. an page of any discrepancy please inform the Compotent Authority

2-1-11



INDIA NON JUDICIAL

Government of National Capital Territory of Delhi

e-Stamp

Certificate No.

IN-DL90438832412861X

Certificate Issued Date

26-May-2025 04:01 PM

Account Reference

SELFPRINT (PU)/ dl-self/ NEHRU/ DL-DLH

Unique Doc. Reference

SUBIN-DLDL-SELF19373407741815X

Purchased by

REC POWER DEVELOPMENT AND CONSULTANCY

Description of Document

Article 5 General Agreement

Property Description

CORE-4,SCOPE COMPLEX, 7, LODHI ROAD, NEW DELHI-110003

Consideration Price (Rs.)

First Party

WRNES TALEGAON POWER TRANSMISSION LIMITED

Second Party

ADANI ENERGY SOLUTIONS LIMITED

Stamp Duty Paid By

WRNES TALEGAON POWER TRANSMISSION LIMITED

Stamp Duty Amount(Rs.)

(Five Hundred only)



SELF PRINTED CERTIFICATE TO BE VERIFIED BY THE RECIPIENT AT WWW.SHCILESTAMP.COM

IN DE00438832413861X

Please write or type below this line

AND

WRNES TALEGAON POWER TRANSMISSION LIMITED a company incorporated under the Companies Act, 2013 vide CIN- U42202DL2024GOI438750, having its registered office at Core 4, SCOPE Complex, 7, Lodhi Road, New Delhi 110003, India (herein after referred to as "Company" which expression shall, unless repugnant to the context, mean and include its successors in interest) of the SECOND PART:

RECPDCI

WRNES TPTL

New Delhi

Statutory Alert:

1. The authenticity of this Stemp cartificate should be verified at 'www.shcilestamp.com' or using Any discrepancy in the details on this Certificate and as available on the website / Mobile App 2. The onus of checking the legitimacy is on the users of the certificate.

3. In case of any discrepancy please inform the Competent Authority.



INDIA NON JUDICIAL

Government of National Capital Territory of Delhi

e-Stamp Reprinted e-Stamp Certificate

Certificate No.

IN-DL90371528260222X

Certificate Issued Date

26-May-2025 03:06 PM

Account Reference

SELFPRINT (PU)/ dl-self/ NEHRU/ DL-DLH

Unique Doc. Reference

SUBIN-DLDL-SELF19248144394767X

Purchased by

REC POWER DEVELOPMENT AND CONSULTANCY

Description of Document

Article 5 General Agreement

Property Description

CORE-4, SCOPE COMPLEX, 7, LODHI ROAD, NEW DELHI-110003

Consideration Price (Rs.)

0

First Party

WRNES TALEGAON POWER TRANSMISSION LIMITED

Second Party

ADANI ENERGY SOLUTIONS LIMITED

Stamp Duty Paid By

WRNES TALEGAON POWER TRANSMISSION LIMITED

Stamp Duty Amount(Rs.)

(Two Hundred only)



SELF PRINTED CERTIFICATE TO BE VERIFIED BY THE RECIPIENT AT WWW.SHCILESTAMP.COM

IN-DL00371528260222X

Please write or type below this line

AND

ADANI ENERGY SOLUTIONS LIMITED, a company incorporated under the Companies Act, 1956 vide CIN-L40300GJ2013PLC077803 and having its registered office at Adani Corporate House, Shantigram, Near Vaishno Devi Circle, S. G. Highway, Khodiyar, Ahmedabad, Gujarat, India - 382421 (hereinafter referred to as "Selected Bidder" which expression shall, unless repugnant to the context or meaning thereof, be deemed to mean and include its successors and permitted assigns) of the THIRD PART. oment and

RECPDCL

Statutory Afert:

New Delhi

certificate should be verified at 'www.shcilestamp.com' on this Certificate and as available on the website / Mot

2. The onus of checking the legitimacy is on the users of the certificate. 3. In case of any discrepancy please inform the Competent Authority.

WHEREAS:

- A. Ministry of Power, Government of India, vide its Notification No. 3229 [F. No. 15/3/2018-Trans-Part (4)] dated 21.08.2024 has appointed REC Power Development and Consultancy Limited to be the Bid Process Coordinator (BPC) for the purpose of selection of Bidder as Transmission Service Provider (TSP) to establish transmission system "Network Expansion scheme in Western Region to cater to Pumped storage potential near Talegaon (Pune)" through tariff based competitive bidding process (hereinafter referred to as the "Project").
- B. In accordance with the Bidding Guidelines, the BPC had initiated a competitive bidding process through issue of RFP for selecting a Successful Bidder to build, own, operate and transfer the Project comprising of the Elements mentioned in **Schedule 2** of the TSA. BPC had initiated this process in accordance with and on the terms and conditions mentioned in the RFP Project Documents (as defined hereinafter).
- C. BPC has incorporated the Company and has undertaken the preliminary studies, obtained certain approvals, etc. regarding the Project on behalf of the Company
- D. REC PDCL along with the Nominees hold one hundred per cent (100%) of the total issued and paid up equity share capital of the Company.
- E. Pursuant to the said Bid Process, Adani Energy Solutions Limited has been identified as the Selected Bidder vide Letter of Intent dated 08th April 2025 issued by the BPC in favour of the Selected Bidder.
- F. As envisaged in the RFP, the Shares Seller (as defined hereinafter) has agreed to sell the Sale Shares (as defined hereinafter) to the Selected Bidder and the Selected Bidder has agreed to purchase the Sale Shares from the Shares Seller, subject to and on the terms and conditions set forth in this Agreement.

NOW THEREFORE, IN CONSIDERATION OF THE MUTUAL COVENANTS AND AGREEMENTS SET FORTH IN THIS AGREEMENT AND FOR OTHER GOOD AND VALUABLE CONSIDERATION, THE PARTIES HEREBY AGREE AS FOLLOWS:

Sold Tales

RECPDCL

opment and

WRNES TPTE

AESL 4

1. DEFINITIONS

- 1.1 Capitalised terms in this Agreement, unless defined in this Agreement shall, in so far as the context admits, have the same meaning in this Agreement as has been ascribed to them in the TSA.
- 1.2 Additionally, the following terms shall have the meaning hereinafter respectively assigned to them herein below:
 - (i) "Acquisition Price" shall mean INR 17,95,01,197 (Rupees Seventeen Crore Ninety-Five Lakh One Thousand One Hundred Ninety-Seven Only) which is the aggregate consideration payable by the Selected Bidder towards purchase of the Sale Shares at par and for taking over of all assets and liabilities of the Company as on the Closing Date subject to adjustment as per the audited accounts of the Company as on the Closing Date;
 - (ii) "Agreement" or "the Agreement" or "this Agreement" shall mean this Share Purchase Agreement and shall include the recitals and/or annexures attached hereto, and the contracts, certificates, disclosures and other documents to be executed and delivered pursuant hereto, if any, and any amendments made to this Agreement by the Parties in writing;
 - (iii) "Bid Process" shall mean the competitive bidding process initiated by the BPC, by issuance of RFP for selecting a Successful Bidder to build, own, operate and transfer the Project in accordance with and on the terms and conditions mentioned in the RFP Project Documents;
 - (iv) "Board" shall mean the board of directors of the Company;
 - (v) "Closing Date" shall mean a mutually agreed date between the Parties falling within the period as mentioned in clause 2.15.2 of RFP or on failure of such mutual agreement between the Parties shall be the date falling on the last date of such period;
 - (vi) "Encumbrance" shall mean any mortgage, pledge, lien, charge, security assignment, hypothecation, trust, encumbrance or any other agreement having the effect of creating security interest;
 - (vii) "Letter of Intent" shall have the meaning ascribed thereto under the Bid Documents:

(viii) "Nominees" shall mean the Persons, who are named in Annexure A of this Agreement, holding the Sale Shares as nominees of REC PDCL:

RECPDCL Pallument and Consultant Consultant

New Delhi 110003

AESL 5

- (ix) "Party" shall mean REC PDCL, Company and the Selected Bidder, referred to individually, and "Parties" shall mean REC PDCL, Company and the Selected Bidder collectively referred to, as relevant:
- (x) "Person" shall include an individual, an association, a corporation, a partnership, a joint venture, a trust, an unincorporated organisation, a joint stock company or other entity or organisation, including a government or political subdivision, or an agency or instrumentality thereof, and/or any other legal entity;
- (xi) "RFP Project Documents" shall mean the following documents, referred to collectively:
 - a. Transmission Service Agreement; and
 - b. this Agreement.
- (xii) "Representations and Warranties" shall mean the representations and warranties mentioned in Clause 4 hereto;
- (xiii) "RoC" shall mean the Registrar of Companies;
- (xiv) "Sale Shares" shall mean 50,000 shares, representing one hundred percent (100%) of the total issued, subscribed and fully paid-up equity share capital of the Company held by the Shares Seller and Nominees as more particularly described in Annexure A attached hereto:
- (xv) "Shares" shall mean the fully paid-up equity shares of Company, of face value Rs. 10 each;
- (xvi) "Shares Seller" shall mean REC PDCL; and
- (xvii) "Transmission Service Agreement" or "TSA" means the agreement titled 'Transmission Service Agreement' to be executed on 30th May, 2025 between Central Transmission Utility of India Limited (CTUIL) and WRNES Talegaon Power Transmission Limited, pursuant to which the TSP shall build, own, operate and transfer the Project and make available the assets of the Project on a commercial basis.

1.3 Interpretation Clause

Unless the context otherwise requires, the provisions of the TSA relating to the interpretation of the TSA shall apply to this Agreement as if they were set out in full in this Agreement and to this end are incorporated herein by reference.

RECPDCL DOWNER PONTING

WRNES TPTL

2. TRANSFER OF SHARES

- 2.1 Subject to the terms and conditions of this Agreement, the Shares Seller agrees to sell and transfer to the Selected Bidder and the Selected Bidder hereby agrees to purchase from the Shares Seller, the Sale Shares free from Encumbrances together with all assets and liabilities of the Company with rights and benefits attached thereto in consideration of the Acquisition Price and the covenants, undertakings and the agreements of the Selected Bidder contained in this Agreement.
- 2.2 The Shares Seller hereby undertakes to cause the Nominees to transfer part of the Sale Shares held by them as nominees of the Shares Seller to the Nominees of Selected Bidder and execute any documents required to deliver good title to the Sale Shares to the Selected Bidder.

3. CLOSING

- 3.1 Prior to the Closing Date, the Selected Bidder shall provide to the Shares Seller, valid share transfer forms duly stamped with requisite amount of stamp duty payable on the transfer of the Sale Shares ("Share Transfer Forms").
- 3.2 On the Closing Date, the Shares Seller shall hand over to the Selected Bidder or its authorised representative, the original share certificates representing the Sale Shares ("Sale Share Certificates") executed by the Shares Seller and the Nominees, simultaneously against the Selected Bidder handing over to the Shares Seller, demand drafts drawn in favour of the Shares Seller or by confirmation of RTGS transfer in favour of the Shares Seller, for the Acquisition Price payable to it.

Provided that prior to the handing over of the Sale Share Certificates to the Selected Bidder as mentioned above, the Selected Bidder shall provide satisfactory evidence to REC PDCL that on the Closing Date, the Selected Bidder has furnished the Contract Performance Guarantee to Central Transmission Utility of India Limited (CTUIL) and is in a position to comply with all other requirements of Clause 2.15.2 of the RFP.

3.3 The Selected Bidder shall immediately upon receiving the Sale Share Certificates and the Share Transfer Forms, duly execute the Share Transfer Forms and duly lodge the Share Transfer Forms and the Share Certificates with the Company along with the names of its nominees to be appointed on the Board of the Company and the address within the jurisdiction of the Registrar of Companies of New Delhi and Haryana, which would be the new registered office of the Company. The Company shall, upon receipt of the said documents from the Selected Bidder, do the following:

(i) Immediately on the Closing Date convene a meeting of the Board, wherein the Board shall pass the following necessary resolutions:

powerTra

RECPDCL

opment and

WRNES TPTE

- (a) approving the transfer of the Shares constituting the Sale Shares from the Shares Seller and the Nominees to the name of the Adani Energy Solutions Limited and its nominees and transfer of all assets and liabilities of the Company as on Closing Date:
- (b) approving the Adani Energy Solutions Limited and its nominees as the members of the Company and entering the name of the Adani Energy Solutions Limited and its nominees in the register of members.
- (c) changing the address of the registered office of the Company to the new address as provided by the Selected Bidder as per clause 3.3 above.
- (d) appointing the nominees of the Selected Bidder on the Board and accepting the resignations of the other existing Directors on the Board and the Chair of the meeting which was taken by one of the existing Directors shall be vacated and appointment of a new Chairman who shall be one of the newly appointed Director, for the rest of the meeting.

Immediately pursuant to the acceptance of resignation of the existing Directors and appointment of new Chairman, the newly constituted Board of Directors shall continue with the meeting and pass the following resolution:

- (e) terminating all the authorizations granted regarding the business and/or operations of the Company or the operations of the bank accounts of the Company, with prospective effect; and
- (f) acknowledging and accepting the terms and conditions as contained in the executed copies of the RFP Project Documents and to abide by the provisions contained therein.
- (ii) Enter the name of the Adani Energy Solutions Limited and its nominees as the legal and beneficial owner of the Sale Shares, free of all Encumbrances, in the register of members of the Company;
- (iii) Make the necessary endorsements on the Sale Share Certificates. indicating the name of the Adani Energy Solutions Limited and its nominees as the legal and beneficial owner of the Sale Shares evidenced there under;

(iv) Return the original Sale Share Certificates, duly endorsed in the name of the Adani Energy Solutions Limited and its nominees, to the Adani Energy Solutions Limited and its nominees, as the case may be or its authorized representative;

powerTran

New Delhi

RECPDCL

WRNES TPTL

- (v) Handover all the statutory registers and records, if any, of the Company to the Selected Bidder.
- (vi) Handover certified true copies of the Board resolution passed by the Company as per (i) (a) to (i) (f) of Clause 3.3 (i) to the Central Transmission Utility of India Limited (CTUIL).
- 3.4 The Parties to this Agreement agree to take all measures that may be required to ensure that all the events contemplated in the Clauses 3.1 to 3.3 above on the Closing Date are completed on the same day.

Notwithstanding the provisions of **Clause 3.3** hereto, all proceedings to be taken and all documents to be executed and delivered by the Parties at the Closing Date shall be deemed to have been taken and executed simultaneously and no proceedings shall be deemed to have been taken nor documents executed or delivered until all have been taken, executed and delivered.

- The Selected Bidder hereby acknowledges and agrees that after the date of acquisition of one hundred percent (100%) of the Shares of the Company by the Selected Bidder as per Clause 3.3, (a) the authority of the BPC in respect of the Bid Process shall forthwith cease and any actions to be taken thereafter regarding the Bid Process will be undertaken by the Central Transmission Utility of India Limited (CTUIL) themselves, (b) all rights and obligations of the BPC shall cease forthwith, (c) all other rights and obligations of the Company shall be of the TSP and (d) any decisions taken by the BPC on behalf of the Company prior to the date of acquisition, shall continue to be binding on the Company and/or Central Transmission Utility of India Limited (CTUIL) as the case may be.
- 3.6 This Agreement shall be effective from the date of its signing by the Parties and shall remain in force until all the obligations of the respective Parties under Clause 3.3 hereto are fulfilled.

4. REPRESENTATIONS AND WARRANTIES

4.1 The Selected Bidder hereby represents and warrants to the Shares Seller that:

4.1.1 The Selected Bidder has full legal right, power and authority to enter into, execute and deliver this Agreement and to perform the obligations, undertakings and transactions set forth herein, and this Agreement has been duly and validly executed and delivered by the Selected Bidder and constitutes its legal, valid and binding obligations, enforceable against it in accordance with its terms;

RECPDCL Style politics

WRNES TPTL



- 4.1.2 The execution, delivery and performance of this Agreement by the Selected Bidder (i) will not violate or contravene any provision of the Memorandum of Association or Articles of the Selected Bidder, (ii) will not violate or contravene any law, statute, rule, regulation, licensing requirement, order, writ, injunction or decree of any court, governmental instrumentality or other regulatory, governmental or public body, agency or authority by which the Selected Bidder is bound or by which any of its and/or their properties or assets are bound, and (iii) except to the extent that the same have been duly and properly completed or obtained, will not require any filing with, or permit, consent or approval of or license from, or the giving of any notice to, any court, governmental instrumentality or other regulatory, governmental or public body, agency or authority, joint venture party, or any other entity or person whatsoever; and
- The Selected Bidder is not restricted in any manner whatsoever, including without limitation, on account of any judicial or governmental order, action or proceeding, or any contractual obligation assumed by the Selected Bidder, from purchasing the Sale Shares from the Shares Seller in the manner provided for in this Agreement.
- 42 The Shares Seller hereby represents and warrants to the Selected Bidder that:
 - 4.2.1 The Shares Seller and the Nominees are the legal and beneficial owners of the Sale Shares, free and clear of any Encumbrance and the delivery to the Selected Bidder of the Sale Shares pursuant to the provisions of this Agreement will transfer to the Selected Bidder a good title to the Sale Shares.
 - 4.2.2 The Shares Seller has full legal right, power and authority to enter into, execute and deliver this Agreement and to perform the obligations, undertakings and transactions set forth herein. The execution, delivery and performance of this Agreement will not violate the Memorandum and Articles of Association of the Shares Seller or contravene any contract by which it is bound.
 - 4.2.3 The Shares Seller has obtained requisite authorizations to sell and transfer the Sale Shares to the Selected Bidder. The Shares Seller also represent that it is not prevented from transferring and selling the Sale Shares. Also, to the best of its knowledge, the Sale Shares are not the subject matter of any claim or pending proceeding or threatened by any legal proceeding made by any third party.

4.3 Except as specified in Clause 4.2 above, the Shares Seller shall not be deemed to have, made any representation or warranty whatsoever, whether express or implied, in relation to the Sale Shares or Company, including but not limited to any implied warranty or representation as to the business or affairs of Company. opment and

RECPDCL

Jurugram

lew Delhi WRNES TPTL

nowerTra

- 4.4 The Representations and Warranties are given as at the date of this Agreement except that where a Representation and Warranty is expressed to be made as at another date, the Representation and Warranty is given with respect to that date only.
- 4.5 Each Representation and Warranty is to be construed independently of the others and is not limited by reference to any other Warranty. The Representations, Warranties and undertakings contained in this Clause 4 hereto or in any document delivered pursuant to or in connection with this Agreement are continuing in nature and shall survive the Closing Date for a period of one (1) year.
- 4.6 The Parties represent to each other that all Representations and Warranties provided herein by the respective Party shall be true as of Closing Date.

5. OBLIGATIONS OF THE SELECTED BIDDER

The Selected Bidder agrees that the Shares Seller shall not be liable in any manner, nor shall it assume any responsibility or liability whatsoever, in respect of the business of the Company and its operations or activities, arising after the Closing Date, to any Person or any authority, central, state, local or municipal or otherwise and the same shall be the sole responsibility of the Selected Bidder.

6. MISCELLANEOUS

6.1 NOTICES

- a) All notices to be given under this Agreement shall be in writing and in the English language.
- b) All notices must be delivered personally or by registered or certified mail or by recognised courier to the addresses below:

Selected Bidder: Adani Energy Solutions Limited,

12th Floor - South Wing, KP Epitome - B Block, Makarba, S G Highway, Ahmedabad, Gujarat -

380051

REC PDCL:

REC Power Development and Consultancy

Limited

Core-4, SCOPE Complex, 7, Lodhi Road, New

Delhi-110003

Company:

WRNES Talegaon Power Transmission Limited

Core-4, SCOPE Complex, 7, Lodhi Road, New

Delhi-110003







c) Any Party may by notice of at least fifteen (15) days to the other Parties change the address and / or addresses to which such notices and communications to it are to be delivered or mailed.

6.2 RESOLUTION OF DISPUTES

- 6.2.1 If any dispute arises between the Parties, in connection with the validity, interpretation, implementation or alleged breach of any provision of this Agreement ("Dispute"), the disputing Parties hereto shall endeavor to settle such Dispute amicably. The attempt to bring about an amicable settlement shall be considered to have failed if not resolved within sixty (60) days from the date of the Dispute.
- 6.2.2 If the Parties are unable to amicably settle the Dispute in accordance with Clause 6.2.1 within the period specified therein, any of the Parties shall be entitled to within thirty (30) days after expiry of the aforesaid period, refer the Dispute to the Chief Executive Officer/Director of REC PDCL and Chief Executive/ Managing Director of the Selected Bidder for resolution of the said Dispute. The attempt to bring about such resolution shall be considered to have failed if not resolved within thirty (30) days from the date of receipt of a written notification in this regard.
- 6.2.3 In the event the Dispute is not settled in accordance with Clause 6.2.2 above, any Party to the Dispute shall be entitled to serve a notice invoking this Clause and making a reference to a sole arbitrator. If the Parties to the Dispute cannot agree as to the appointment of the sole arbitrator within thirty (30) days of receipt of the notice of the Party making the reference, then the Shares Seller along with the Company shall appoint one arbitrator and the Selected Bidder shall appoint one arbitrator. However, after the Closing Date, in such an event the Shares Seller shall appoint one arbitrator and the Selected Bidder along with the Company shall appoint one arbitrator and the two arbitrators, so appointed shall appoint the third arbitrator.
- 6.2.4 The place of the arbitration shall be New Delhi. The Arbitration proceedings shall be governed by the Arbitration and Conciliation Act, 1996.
- 6.2.5 The proceedings of arbitration shall be in English language.
- 6.2.6 The arbitrator's award shall be substantiated in writing. The arbitrators shall also decide on the costs of the arbitration proceedings. In case the arbitrators have not decided on the costs of the arbitration proceedings, each Party to the Dispute shall bear its own costs, in relation to the arbitration proceedings.

RECPDCL Politics Apolitics

WRNES TPTL 110003

6.3 AUTHORISED PERSON

For the purposes of this Agreement, the Selected Bidder is represented by Mr. Sanjay Arvind Johari, pursuant to an authorization granted to Mr. Sanjay Arvind Johari through necessary Board resolutions. Further, Mr. Sanjay Arvind Johari is also authorized by such resolutions to take any decision which may be required to be taken, do all acts and execute all documents which are or may be required by the Selected Bidder for the proper and effective fulfillment of the rights and obligations under this Agreement. Any action taken or document executed by Mr. Sanjay Arvind Johari shall be deemed to be acts done or documents executed by the Selected Bidder and shall be binding on the Selected Bidder.

6.4 RESERVATION OF RIGHTS

No forbearance, indulgence or relaxation or inaction by any Party at any time to require performance of any of the provisions of this Agreement shall in any way affect, diminish or prejudice the right of such Party to require performance of that provision, and any waiver or acquiescence by any Party of any breach of any of the provisions of this Agreement shall not be construed as a waiver or acquiescence of any continuing or succeeding breach of such provisions, a waiver of any right under or arising out of this Agreement or acquiescence to or recognition of rights other than that expressly stipulated in this Agreement.

6.5 CUMULATIVE RIGHTS

All remedies of either Party under this Agreement whether provided herein or conferred by statute, civil law, common law, custom or trade usage, are cumulative and not alternative and may be enforced successively or concurrently.

6.6 PARTIAL INVALIDITY

If any provision of this Agreement or the application thereof to any person or circumstance shall be invalid or unenforceable to any extent, the remainder of this Agreement and the application of such provision to persons or circumstances other than those as to which it is held invalid or unenforceable shall not be affected thereby, and each provision of this Agreement shall be valid and enforceable to the fullest extent permitted by law. Any invalid or unenforceable provision of this Agreement shall be replaced with a provision, which is valid and enforceable and most nearly reflects the original intent of the unenforceable provision.

RECPDCL Palling Palling

WRNES TRTL

6.7 TERMINATION

If (i) the Closing does not occur on the Closing Date for any reason-whatsoever, or (ii) the Letter of Intent is withdrawn or terminated for any reason, or (iii) due to termination of the TSA by the Central Transmission Utility of India Limited (CTUIL) in accordance with Article 3.3.2 or Article 13 of the TSA thereof, REC PDCL shall have a right to terminate this Agreement forthwith by giving a written notice to the other Parties hereto.

6.8 AMENDMENTS

No modification or amendment of this Agreement and no waiver of any of the terms or conditions hereof shall be valid or binding unless made in writing and duly executed by all the Parties.

6.9 ASSIGNMENT

This Agreement and the rights and liabilities hereunder shall bind and inure to the benefit of the respective successors of the Parties hereto, but no Party hereto shall assign or transfer its rights and liabilities hereunder to any other Person without the prior written consent of the other Parties, which will not be unreasonably withheld.

6.10 ENTIRE AGREEMENT

This Agreement constitutes the entire Agreement between the Parties with respect to the subject matter herein and supersedes and cancels any prior oral or written agreement, representation, understanding, arrangement, communication or expression of intent relating to the subject matter of this Agreement.

6.11 COSTS

Each of the Parties hereto shall pay their own costs and expenses relating to the negotiation, preparation and execution of this Agreement and the transactions contemplated by this Agreement.

The Selected Bidder shall be liable to bear and pay the costs in respect of this Agreement and transfer of Sale Shares.

6.12 RELATIONSHIP

None of the provisions of this Agreement shall be deemed to constitute a partnership between the Parties hereto and no Party shall have any authority to bind the other Party otherwise than under this Agreement or shall be deemed to be the agent of the other in any way.

RECPDCL Railing

oment and

WRNES TETL

6.13 GOVERNING LAW AND JURISDICTION

This Agreement shall be governed by and construed in accordance with the laws of India and shall be subject to the exclusive jurisdiction of the courts of Delhi.

6.14 COUNTERPARTS

This Agreement may be executed in counterparts by the Parties and each fully executed counterpart shall be deemed to be original.

6.15 CONFIDENTIALITY

The Parties undertake to hold in confidence and not to disclose the terms and conditions of the transaction contemplated hereby to third parties, except:

- (a) to their professional advisors:
- (b) to their officers, employees, agents or representatives, who need to have access to such information for the proper performance of their activities:
- (c) disclosures required under Law;

without the prior written consent of the other Parties.

Provided that the Central Transmission Utility of India Limited (CTUIL) and REC PDCL may at any time, disclose the terms and conditions of transactions contemplated hereby to any person, to the extent stipulated under the law or the Bidding Guidelines.

6.16 INDEMNIFICATION

The Parties hereby agree that transfer of Sale Shares to the Selected Bidder shall vest all the rights, privileges, licenses, responsibilities, liabilities and other obligations pertaining to the Company in the Selected Bidder.

The Selected Bidder hereby agrees that the Selected Bidder shall not be entitled to any claims or initiate any legal proceedings by itself or through the Transmission Service Provider against the Shares Seller, its directors, officers, employees and the subscribers including the members of any committees appointed by them in respect of any actions or decisions taken by any of them up to the Closing Date in furtherance of the Project referred to in recital A of this Agreement.



RECPDCL Palling

WRNES TRTL



- Further, the Selected Bidder hereby indemnifies and holds harmless at all times the Shares Seller against all past, present and future third party claims and liabilities arising out of actions or decisions taken by any of the persons or bodies referred to in Clause 6.3 up to the Closing Date in furtherance of the Project referred to above or otherwise concerning the Company. All such actions shall be defended by the Selected Bidder either itself or through the TSP at its own cost.
- The Parties hereby agree that the provisions of this clause shall survive the termination of this Agreement.

6.17 SURVIVAL

The provisions of Clause 1 (Definitions and Interpretation), Clause 4 (Representations and Warranties), Clause 6.2 (Resolution of Disputes), Clause 6.7 (Termination), Clause 6.15 (Confidentiality), Clause 6.16 (Indemnification) and other representations, warranties, covenants and provisions contained herein that by their nature are intended to survive, shall survive the termination of this Agreement

6.18 FORCE MAJEURE

No party shall be liable for its inability or delay in performing any of its obligations hereunder if such delay is caused by circumstances beyond the reasonable control of the party including delay caused through flood, riot, Act of God, lighting civil commotion, storm, tempest and earthquake.

IN WITNESS WHEREOF, THE PARTIES HERETO HAVE CAUSED THIS AGREEMENT TO BE DULY EXECUTED AND DELIVERED AS OF THE DAY AND YEAR FIRST ABOVE WRITTEN

Tales of Tal

RECPDCL

ment and

WRNES TIPTL 110003

16

SIGNED AND DELIVERED by the within named **REC POWER DEVELOPMENT AND CONSULTANCY LIMITED** by the hand of Sh. TSC Bosh, CEO

(Authorised pursuant to the resolution passed by its Board of Directors in its meeting held on 03rd May, 2025)

IN THE PRESENCE OF:

WITNESS: (Name and address)

1. Avel Kennar Perala Chief Manager (Engg.)

2. Nill bhay Goel AM (CS)

SIGNED AND DELIVERED by the within named WRNES TALEGAON POWER TRANSMISSION LIMITED by the hand of Sh. Mukul Agarwal, Chairman

(Authorised pursuant to the resolution passed by its Board of Directors in its meeting held on 30th May, 2025)

WITNESS:

(Name and address)

Cch. V. Lakshmanachooyelly GM7 HOB (Fin), REOPISCL

Fould (NFM), MECPACE



(Core-4, SCOPE Complex, 7, Lodhi Road, New Delhi-110003)

(Core-4, SCOPE Complex, 7, Lodhi Road, New Delhi-110003)

£ 2 - 1.



(Core-4, SCOPE Complex, 7, Lodhi Road, New Delhi-110003)

(Core-4, SCOPE Complex, 7, Lodhi Road, New Delhi-110003)

SONET Transmitted

SIGNED AND DELIVERED by the within named **ADANI ENERGY SOLUTIONS LIMITED** by the hand of Mr. Sanjay Arvind Johani

(Authorised pursuant to the resolution passed by its Board of Directors in its meeting held on 24.04.2025)

WITNESS: (Name and address)

NARENDEA ICVMAR OJHA Sr. Mgr.

SHASHANK SHARMA Head Business Development A A CON ENGLANCE OF THE PARTY STATES OF THE PA

Narenda & Ja 12th Floor - South Wing, KP Epitome – B Block, Makarba, S G Highway, Ahmedabad, Gujarat - 380051,

12th Floor - South Wing, KP Epitome – B Block, Makarba, S G Highway, Ahmedabad, Gujarat - 380051



ANNEXURE A

DESCRIPTION OF THE SALE SHARES

S. NO.	NAME OF THE SHAREHOLDER(s)	NUMBER OF EQUITY SHARES HELD	PERCENTAGE OF THE TOTAL PAID UP EQUITY CAPITAL
1.	REC Power Development and Consultancy Limited	49,994	99.988
2.	Shri Jaspal Singh Kushwaha*	1	0.002
3.	Shri Mukul Agarwal*	1	0.002
4.	Shri Ch. V. Lakshmana Charyulu*	1	0.002
5.	Shri Neerajkumar Vijay Sharma*	1	0.002
6.	Shri Arvind Kumar*	1	0.002
7.	Shri Anil Kumar Perala*	1	0.002
	Total	50,000	100.000

^{*} Held as nominee of REC PDCL.



Soment and Co RECPDCL

New Dalhi 110003 WRNES TRTL



TRANSMISSION SERVICE AGREEMENT

FOR

DEVELOPMENT AND OPERATION OF INTER-STATE TRANSMISSION SYSTEM

FOR TRANSMISSION OF ELECTRICITY THROUGH TARIFF **BASED COMPETITIVE BIDDING FOR**

NETWORK EXPANSION SCHEME IN WESTERN REGION TO CATER TO PUMPED STORAGE POTENTIAL NEAR **TALEGAON (PUNE)**

BETWEEN THE

CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED (NODAL AGENCY)

AND

WRNES TALEGAON POWER TRANSMISSION LIMITED

30th May, 2025

Central Transmission Utility of India Limited | WRNES Talegaon Power Transmission Limited

CONTENTS

1	Definitions and Interpretations	5
2	Effectiveness and Term of Agreement	166
3	Conditions Subsequent	188
4	Development of the Project	222
5	Construction of the Project	266
6	Connection and commissioning of the Project	300
7	Operation and Maintenance of the Project	344
8	Availability of the project	355
9	Insurances	366
10	Billing And Payment of Transmission Charges	37
11	Force Majeure	38
12	Change in Law	422
13	Events of Default and Termination	444
14	Liability and Indemnification	49
15	Assignments and Charges	544
16	Governing Law and Dispute Resolution	56
17	Representation and Warranties	57
18	Independent Engineer	59
19	Miscellaneous Provisions	611



Central Transmission Utility of India Limited





Indian-Non Judicial Stamp Haryana Government



Date:07/05/2025

Certificate No. G0G2025E4102

GRN No.

130930532



Stamp Duty Paid : ₹ 101

Penalty :₹ 0 (Rs. Zero Only)

<u>Deponent</u>

Name: Central Transmission utility of India Itd

H.No/Floor : 2 City/Village : Gurugram Sector/Ward: 29

District: Gurugram

Landmark: Na

State: Haryana

Phone: 98*****10



Purpose: ARTICLE 5 GENERAL AGREEMENT to be submitted at Concerned office

THIS TRANSMISISON SERVICE AGREEMENT (hereinafter referred to as "TSA" or "Agreement" or "the Agreement" or "this Agreement") is made on the "M". [Insert day] of May Insert month] of Two Thousand and Twenty Five.

BETWEEN:

The CENTRAL TRANSMISSION UTILITY OF INDIA LIMITED, a company incorporated under the Companies Act, 2013, having its registered office at Plot No.2, Sector 29, Gurugram, Haryana 122001, India & Correspondence address at Floor No. 5-10, Tower 1, Plot No. 16, IRCON International Tower, Institutional Area, Sector 32, Gurugram, Haryana – 122001, India (hereinafter referred to as "Nodal Agency/CTU" which expression shall unless repugnant to the context or meaning thereof include its successors and assigns) as party of the one part;

AND

WRNES TALEGAON POWER TRANSMISSION LIMITED, incorporated under the Companies Act, 2013, having its registered office at Core-4, Scope Complex 7, Lodhi Road Delhi, South Delhi, Delhi 110003 (herein after referred to as "Transmission Service Provider" or "TSP" or "ISTS Licensee", which expression shall unless repugnant to the context or meaning thereof include its successors, and permitted assigns) as Party of the other part;

("Nodal Agency" and "TSP" are individually referred to as "Party" and collectively as the "Parties")



Central Transmission Utility of India Limited

3

AND WHEREAS:

- In accordance with the Bidding Guidelines, the Bid Process Coordinator (hereinafter referred to as BPC) had initiated a competitive e-reverse bidding process through issue of RFP for selecting a Successful Bidder to build, own, operate and transfer the Project comprising of the Elements mentioned in Schedule 1 (hereinafter referred to as the Project)
- B) Pursuant to the said e-reverse bidding process, the BPC has identified the Successful Bidder, who will be responsible to set up the Project on build, own, operate and transfer basis to provide Transmission Service in accordance with the terms of this Agreement and the Transmission License.
- C) The Selected Bidder have submitted the Contract Performance Guarantee and acquired one hundred percent (100%) of the equity shareholding of WRNES Talegaon Power Transmission Limited, along with all its related assets and liabilities in terms of the provisions of the Share Purchase Agreement.
- D) The TSP has agreed to make an application for a Transmission License to the Commission for setting up the Project on build, own, operate and transfer basis.
- E) The TSP has further agreed to make an application to the Commission for the adoption of the Transmission Charges under Section 63 of the Electricity Act, 2003, along with a certification from the Bid Evaluation Committee in accordance with the Bidding Guidelines issued by Ministry of Power, Government of India.
- F) The TSP has agreed to execute the agreement(s) required, if any, under Sharing Regulations within fifteen (15) days from the date of grant of Transmission License from the Commission.
- G) The TSP agrees to the terms and conditions laid down under Sharing Regulations, for making available the ISTS and charge the Transmission Charges in accordance with the terms and conditions of Sharing Regulations.
- H) The billing, collection and disbursement of the Transmission Charges by the CTU to the ISTS Licensee shall be governed as per Sharing Regulations.
- I) The terms and conditions stipulated in the Transmission License issued by the Commission to the TSP shall be applicable to this Agreement and the TSP agrees to comply with these terms and conditions. In case of inconsistency between the Transmission License terms & conditions and the conditions of this Agreement, the conditions stipulated in the Transmission License granted by the Commission shall prevail.

NOW, THEREFORE, IN CONSIDERATION OF THE PREMISES AND MUTUAL AGREEMENTS, COVENANTS AND CONDITIONS SET FORTH HEREIN, IT IS HEREBY AGREED BY AND BETWEEN THE PARTIES HERETO AS FOLLOWS:

Central Transmission Utility of India Limited





ARTICLE: 1

1 DEFINITIONS AND INTERPRETATIONS

1.1 Definitions:

1.1.1 The words / expressions used in this Agreement, unless as defined below or repugnant to the context, shall have the same meaning as assigned to them by the Electricity Act, 2003 and the rules or regulations framed there under including those issued / framed by the Commission (as defined hereunder), as amended or re-enacted from time to time or the General Clauses Act, failing which it shall bear its ordinary English meaning.

The words/expressions when used in this Agreement shall have the respective meanings as specified below:

"Acquisition Price" shall have the same meaning as defined in the Share Purchase Agreement;

"Act" or "Electricity Act" or "Electricity Act 2003" shall mean the Electricity Act, 2003 and any amendments made to the same or any succeeding enactment thereof;

"Affiliate" shall mean a company that either directly or indirectly

- i. controls or
- ii. is controlled by or
- iii. is under common control with

a Bidding Company (in the case of a single company) or a Member (in the case of a Consortium) and "control" means ownership by one entity of at least twenty-six percent (26%) of the voting rights of the other entity;

"Availability" in relation to the Project or in relation to any Element of the Project, for a given period shall mean the time in hours during that period the Project is capable to transmit electricity at its Rated Voltage and shall be expressed in percentage of total hours in the given period and shall be calculated as per the procedure contained in Appendix –IV to Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2024, attached herewith in Schedule 6;

"Bid" shall mean technical bid and financial bid submitted by the Bidder, in response to the RFP, in accordance with the terms and conditions of the RFP;

"Bid Deadline" shall mean the last date and time for submission of the Bid in response to RFP, as specified in the RFP;

"Bidding Company" shall refer to such single company that has made a Response to RFP for the Project;

5

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited



"Bidding Consortium / Consortium" shall refer to a group of companies that has collectively made a Response to RFP for the Project;

"Bid Documents" or "Bidding Documents" shall mean the RFP, along with all attachments thereto or clarifications thereof:

"Bidding Guidelines" shall mean the "Tariff Based Competitive Bidding Guidelines for Transmission Service" and "Guidelines for Encouraging Competition in Development of Transmission Projects" issued by Government of India, Ministry of Power under Section – 63 of the Electricity Act as amended from time to time;

"Bid Process Coordinator" or "BPC" shall mean a person or its authorized representative as notified by the Government of India, responsible for carrying out the process for selection of Bidder who will acquire Transmission Service Provider;

"Bill" shall mean any bill raised by the CTU on the DICs to recover the Transmission Charges pursuant to the Sharing Regulations;

"Business Day" shall mean a day other than Sunday or a statutory holiday, on which the banks remain open for business in the State in which the Nodal Agency's registered office is located and the concerned TSP are located;

"CEA" shall mean the Central Electricity Authority constituted under Section -70 of the Electricity Act;

"Change in law" shall have the meaning ascribed thereto in Article 12;

"Commercial Operation Date" or "COD" shall mean the date as per Article 6.2;

"Commission" or "CERC" shall mean the Central Electricity Regulatory Commission referred to in sub-section (1) of Section 76 of the Electricity Act, 2003 or its successors and assigns;

"Competent Court of Law" shall mean the Supreme Court or any High Court, or any tribunal or any similar judicial or quasi-judicial body in India that has jurisdiction to adjudicate upon issues relating to the Project;

"Connection Agreement" shall mean the agreement between the CTU or STU or any other concerned parties and the TSP, setting out the terms relating to the connection of the Project to the Inter-connection Facilities and use of the Inter-State Transmission System as per the provisions of the IEGC, as the case may be;

"Consultation Period" shall mean the period of sixty (60) days or such longer period as the Parties may agree, commencing from the date of issue of a TSP's Preliminary Notice or a Nodal Agency's Preliminary Termination Notice, as provided in Article 13 of this Agreement, for consultation between the Parties to mitigate the consequence of the relevant event having regard to all the circumstances;

entral Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

"Consents, Clearances and Permits" shall mean all authorizations, licenses, approvals, registrations, permits, waivers, privileges, acknowledgements, agreements, or concessions required to be obtained from or provided by any concerned authority for the development, execution and operation of Project including without any limitation for the construction, ownership, operation and maintenance of the Transmission Lines and/or sub-stations;

"Construction Period" shall mean the period from (and including) the Effective Date of the Transmission Service Agreement up to (but not including) the COD of the Element of the Project in relation to an Element and up to (but not including) the COD of the Project in relation to the Project;

"Contractors" shall mean the engineering, procurement, construction, operation & maintenance contractors, surveyors, advisors, consultants, designers, suppliers to the TSP and each of their respective sub-contractors (and each of their respective successors and permitted assigns) in their respective capacities as such;

"Contract Performance Guarantee" shall mean the irrevocable unconditional bank guarantee, submitted and to be submitted by the TSP or by the Selected Bidder on behalf of the TSP to the Nodal Agency from a bank mentioned in Annexure 17 of the RFP, in the form attached here to as Schedule 8, in accordance with Article 3 of this Agreement and which shall include the additional bank guarantee furnished by the TSP under this Agreement;

"Contract Year", for the purpose of payment of Transmission Charges, shall mean the period beginning on the COD, and ending on the immediately succeeding March 31 and thereafter each period of 12 months beginning on April 1 and ending on March 31 provided that the last Contract Year shall end on the last day of the term of the TSA;

"CTU" or "Central Transmission Utility" shall have same meaning as defined in the Electricity Act, 2003;

"Day" shall mean a day starting at 0000 hours and ending at 2400 hours;

"D/C" shall mean Double Circuit;

"Designated ISTS Customers" or "DICs" shall have the meaning as ascribed in the Sharing Regulations;

"Dispute" shall mean any dispute or difference of any kind between the Parties, in connection with or arising out of this Agreement including any issue on the interpretation and scope of the terms of this Agreement as provided in Article 16;

"Effective Date" for the purposes of this Agreement, shall have the same meaning as per Article 2.1 of this Agreement;



Central Transmission Utility of India Limited

7

WRNES Talegaon Power Transmission Limited

"Electrical Inspector" shall mean a person appointed as such by the Government under sub-section (1) of Section 162 of the Electricity Act 2003 and also includes Chief Electrical Inspector;

"Electricity Rules 2005" shall mean the rules framed pursuant to the Electricity Act 2003 and as amended from time to time;

"Element" shall mean each Transmission Line or each circuit of the Transmission Lines (where there are more than one circuit) or each bay of Sub-station or switching station or HVDC terminal or inverter station of the Project, including ICTs, Reactors, SVC, FSC, etc. forming part of the ISTS, which will be owned, operated and maintained by the concerned ISTS Licensee, and which has a separate Scheduled COD as per Schedule 2 of this Agreement and has a separate percentage for recovery of Transmission Charges on achieving COD as per Schedule 5 of this Agreement;

"Event of Default" shall mean the events as defined in Article 13 of this Agreement;

"Expiry Date" shall be the date which is thirty-five (35) years from the COD of the Project;

"Financial Closure" shall mean the first Business Day on which funds are made available to the TSP pursuant to the Financing Agreements;

"Financially Evaluated Entity" shall mean the company which has been evaluated for the satisfaction of the financial requirement set forth in the RFP;

"Financing Agreements" shall mean the agreements pursuant to which the TSP is to finance the Project including the loan agreements, security documents, notes, indentures, security agreements, letters of credit and other documents, as may be amended, modified, or replaced from time to time, but without in anyway increasing the liabilities of the Designated ISTS Customers / Nodal Agency;

"Financial Year" shall mean a period of twelve months at midnight Indian Standard Time (IST) between 1st April & 31st March;

"Force Majeure" and "Force Majeure Event" shall have the meaning assigned thereto in Article 11;

"GOI" shall mean Government of India;

"Grid Code" / "IEGC" shall mean the Grid Code specified by the Central Commission under Clause (h) of sub-section (1) of Section 79 of the Electricity Act;

"Independent Engineer" shall mean an agency/ company, appointed by Nodal Agency in accordance with the Guidelines for Encouraging Competition in Development of Transmission Projects.

Sur Power Transmission

Central Transmission Utility of India Limited



"Indian Governmental Instrumentality" shall mean Government of India, Government of any State in India or any ministry, department, board, authority, agency, corporation, commission under the direct or indirect control of Government of India or any State Government or both, any political sub-division of any of them including any court or Commission or tribunal or judicial or quasijudicial body in India but excluding the CTU, TSP and the Designated ISTS Customers;

"Insurances" shall mean the insurance cover to be obtained and maintained by the TSP in accordance with Article 9 of this Agreement;

"Interconnection Facilities" shall mean the facilities as may be set up for transmission of electricity through the use of the Project, on either one or both side of generating station's / CTU's / STU's / ISTS Licensee's / Designated ISTS Customer's substations (as the case may be) which shall include, without limitation, all other transmission lines, gantries, sub-stations and associated equipments not forming part of the Project;

"ISTS Licensee" shall be the TSP under this Agreement, consequent to having been awarded a Transmission License by the CERC and shall be referred to as the TSP or the ISTS Licensee, as the context may require in this Agreement;

"Law" or "Laws" in relation to this Agreement, shall mean all laws including electricity laws in force in India and any statute, ordinance, rule, regulation, notification, order or code, or any interpretation of any of them by an Indian Governmental Instrumentality having force of law and shall include all rules, regulations, decisions and orders of the Commission;

"Lead Member of the Bidding Consortium" or "Lead Member" shall mean a company who commits at least 26% equity stake in the Project, meets the technical requirement as specified in the RFP and so designated by other Member(s) in Bidding Consortium;

"Lenders" means the banks, financial institutions, multilateral funding agencies, non-banking financial companies registered with the Reserve Bank of India (RBI), insurance companies registered with the Insurance Regulatory & Development Authority (IRDA), pension funds regulated by the Pension Fund Regulatory & Development Authority (PFRDA), mutual funds registered with Securities & Exchange Board of India (SEBI), etc., including their successors and assigns, who have agreed on or before COD of the Project to provide the TSP with the debt financing described in the capital structure schedule, and any successor banks or financial institutions to whom their interests under the Financing Agreements may be transferred or assigned;

Provided that, such assignment or transfer shall not relieve the TSP of its obligations to the Nodal Agency under this Agreement in any manner and shall also does not lead to an increase in the liability of the Nodal Agency;

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

"Lenders Representative" shall mean the person notified by the Lender(s) in writing as being the representative of the Lender(s) or the Security Trustee and such person may from time to time be replaced by the Lender(s) pursuant to the Financing Agreements by written notice to the TSP;

"Letter of Intent" or "LOI" shall have the same meaning as in the RFP;

"Member in a Bidding Consortium / Member" shall mean each company in the Bidding Consortium;

"Month" shall mean a period of thirty (30) days from (and excluding) the date of the event;

"Monthly Transmission Charges" for any Element of the Project, after COD of the Element till COD of the Project, and for the Project after COD of the Project, shall mean the amount of Transmission Charges as specified in Schedule 5 of this Agreement multiplied by no. of days in the relevant month and divided by no. of days in the year;

"National Load Despatch Centre" shall mean the centre established as per subsection (1) of Section 26 of the Electricity Act 2003;

"Nodal Agency" shall mean CTU, which shall execute and implement the Transmission Service Agreement (TSA);

Provided that while taking major decisions, CTU shall consult CEA on technical matters and any other matter it feels necessary.

"Notification" shall mean any notification, issued in the Gazette of India;

"Operating Period" for any Element of the Project shall mean the period from (and including) the COD of such Element of the Project, up to (and including) the Expiry Date and for the Project, shall mean the period from (and including) the COD of the Project, up to (and including) the Expiry Date;

"Parent Company" shall mean an entity that holds at least twenty-six percent (26%) of the paid - up equity capital directly or indirectly in the Bidding Company or in the Member in a Bidding Consortium, as the case may be;

"Preliminary Termination Notice" shall mean a Nodal Agency's Preliminary Termination Notice as defined in Article 13 of this Agreement;

"Project" shall mean Network Expansion scheme in Western Region to cater to Pumped storage potential near Talegaon (Pune), as detailed in Schedule 1 of this Agreement;

"Project Assets" shall mean all physical and other assets relating to and forming part of the Project including:

10

entral Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

- (a) rights over the Site for substations, ROW for transmission lines;
- (b) tangible & intangible assets such as civil works and equipment including foundations, embankments, pavements, electrical systems, communication systems, relief centres, administrative offices, Sub-stations, software, tower and sub-stations designs etc;
- (c) project facilities situated on the Site;
- (d) all rights of the TSP under the project agreements;
- (e) financial assets, such as receivables, security deposits etc;
- (f) insurance proceeds; and
- (g) Applicable Permits and authorisations relating to or in respect of the Transmission System;"

"Project Execution Plan" shall mean the plan referred to in Article 3.1.3(c) hereof;

"Prudent Utility Practices" shall mean the practices, methods and standards that are generally accepted internationally from time to time by electric transmission utilities for the purpose of ensuring the safe, efficient and economic design, construction, commissioning, operation, repair and maintenance of the Project and which practices, methods and standards shall be adjusted as necessary, to take account of:

- operation, repair and maintenance guidelines given by the manufacturers to be incorporated in the Project,
- (ii) the requirements of Law, and
- (iii) the physical conditions at the Site;
- (iv) the safety of operating personnel and human beings;

11

"Rated Voltage" shall mean voltage at which the Transmission System is designed to operate or such lower voltage at which the line is charged, for the time being, in consultation with the Central Transmission Utility;

"Rebate" shall have the meaning as ascribed to in Article 10.3 of this Agreement;

"RFP" shall mean Request for Proposal dated 17.10.2024 along with all schedules, annexures and RFP Project Documents attached thereto, issued by the BPC for tariff based competitive bidding process for selection of Bidder as TSP to execute the Project, including any modifications, amendments or alterations thereto;

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

"RFP Project Documents" shall mean the following documents to be entered into in respect of the Project, by the Parties to the respective agreements:

- a. Transmission Service Agreement,
- b. Share Purchase Agreement,
- c. Agreement(s) required under Sharing Regulations and
- d. Any other agreement as may be required;

"RLDC" shall mean the relevant Regional Load Dispatch Centre as defined in the Electricity Act, 2003, in the region(s) in which the Project is located;

"RPC" shall mean the relevant Regional Power Committee established by the Government of India for the specific Region(s) in accordance with the Electricity Act, 2003 for facilitating integrated operation of the Power System in that Region;

"Scheduled COD" in relation to an Element(s) shall mean the date(s) as mentioned in Schedule 2 as against such Element(s) and in relation to the Project, shall mean the date as mentioned in Schedule 2 as against such Project, subject to the provisions of Article 4.4 of this Agreement, or such date as may be mutually agreed among the Parties;

"Scheduled Outage" shall mean the final outage plan as approved by the RPC as per the provisions of the Grid Code;

"Selected Bid" shall mean the technical Bid and the Final Offer of the Selected Bidder submitted during e-reverse bidding, which shall be downloaded and attached in Schedule 7 on or prior to the Effective Date;

"Share Purchase Agreement" shall mean the agreement amongst REC Power Development and Consultancy Limited, WRNES Talegaon Power Transmission Limited and the Successful Bidder for the purchase of one hundred (100%) per cent of the shareholding of the WRNES Talegaon Power Transmission Limited for the Acquisition Price, by the Successful Bidder on the terms and conditions as contained therein:

"Sharing Regulations" shall mean the Central Electricity Regulatory Commission (Sharing of Inter-State Transmission Charges and Losses) Regulations, 2020 and as amended from time to time;

"Site" in relation to a substation, switching station or HVDC terminal or inverter station, shall mean the land and other places upon which such station / terminal is to be established;

"SLDC" shall mean the State Load Despatch Centre established as per sub-section (1) of Section 31 of the Electricity Act 2003;

Central Transmission Utility of India Limited





"STU" or "State Transmission Utility" shall be the Board or the Government company, specified as such by the State Government under sub-section (1) of Section 39 of the Electricity Act 2003;

"Successful Bidder" or "Selected Bidder" shall mean the Bidder selected pursuant to the RFP and who has to acquire one hundred percent (100%) equity shares of WRNES Talegaon Power Transmission Limited along with all its related assets and liabilities, which will be responsible as the TSP to establish the Project on build, own, operate and transfer basis as per the terms of the TSA and other RFP Project Documents;

"TSP's Preliminary Notice" shall mean a notice issued by the TSP in pursuant to the provisions of Article 13.3 of this Agreement;

"Target Availability" shall have the meaning as ascribed hereto in Article 8.2 of this Agreement;

"Technically Evaluated Entity" shall mean the company which has been evaluated for the satisfaction of the technical requirement set forth in RFP;

"Termination Notice" shall mean a Nodal Agency's Termination Notice given by the Nodal Agency to the TSP pursuant to the provisions of Articles 3.3.2, 3.3.4, 4.4.2, 5.8, 13.2 and 13.3 of this Agreement for the termination of this Agreement;

"Term of Agreement" for the purposes of this Agreement shall have the meaning ascribed thereto in Article 2.2 of this Agreement;

"Transmission Charges" shall mean the Final Offer of the Selected Bidder during the e-reverse bidding and adopted by the Commission, payable to the TSP as per Sharing Regulations;

"Transmission License" shall mean the license granted by the Commission in terms of the relevant regulations for grant of such license issued under the Electricity Act;

"Transmission Service" shall mean making the Project available as per the terms and conditions of this Agreement and Sharing Regulations;

"Unscheduled Outage" shall mean an interruption resulting in reduction of the Availability of the Element(s) / Project (as the case may be) that is not a result of a Scheduled Outage or a Force Majeure Event.

"Ultimate Parent Company" shall mean an entity which owns at least twenty six percent (26%) equity in the Bidding Company or Member of a Consortium, (as the case may be) and in the Technically Evaluated Entity and / or Financially Evaluated Entity (as the case may be) and such Bidding Company or Member of a Consortium, (as the case may be) and the Technically Evaluated Entity and / or Financially Evaluated Entity (as the case may be) shall be under the direct control or indirectly under the common control of such entity;

Sinow * Osing Si

Central Transmission Utility of India Limited

13 WRNES Talegaon Power Transmission Limited

1.2 Interpretation:

Save where the contrary is indicated, any reference in this Agreement to:

"Agreement" shall be construed as including a reference to its Schedules, Appendices and Annexures;

"Rupee", "Rupees" and "Rs." shall denote lawful currency of India:

"crore" shall mean a reference to ten million (10,000,000) and a "lakh" shall mean a reference to one tenth of a million (1,00,000);

"encumbrance" shall be construed as a reference to a mortgage, charge, pledge, lien or other encumbrance securing any obligation of any person or any other type of preferential arrangement (including, without limitation, title transfer and retention arrangements) having a similar effect;

"holding company" of a company or corporation shall be construed as a reference to any company or corporation of which the other company or corporation is a subsidiary;

"indebtedness" shall be construed so as to include any obligation (whether incurred as principal or surety) for the payment or repayment of money, whether present or future, actual or contingent;

"person" shall have the meaning as defined in Section 2 (49) of the Act;

"subsidiary" of a company or corporation (the holding company) shall be construed as a reference to any company or corporation:

- (i) which is controlled, directly or indirectly, by the holding company, or
- (ii) more than half of the issued share capital of which is beneficially owned, directly or indirectly, by the holding company, or
- (iii) which is a subsidiary of another subsidiary of the holding company,

for these purposes, a company or corporation shall be treated as being controlled by another if that other company or corporation is able to direct its affairs and/or to control the composition of its board of directors or equivalent body;

"winding-up", "dissolution", "insolvency", or "reorganization" in the context of a company or corporation shall have the same meaning as defined in the Companies Act, 1956/ Companies Act, 2013 (as the case may be).

1.2.1 Words importing the singular shall include the plural and vice versa.

14

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

- 1.2.2 This Agreement itself or any other agreement or document shall be construed as a reference to this or to such other agreement or document as it may have been, or may from time to time be, amended, varied, novated, replaced or supplemented.
- 1.2.3 A Law shall be construed as a reference to such Law including its amendments or re-enactments from time to time.
- 1.2.4 A time of day shall, save as otherwise provided in any agreement or document be construed as a reference to Indian Standard Time.
- 1.2.5 Different parts of this Agreement are to be taken as mutually explanatory and supplementary to each other and if there is any inconsistency between or among the parts of this Agreement, they shall be interpreted in a harmonious manner so as to give effect to each part.
- 1.2.6 The tables of contents and any headings or sub-headings in this Agreement have been inserted for ease of reference only and shall not affect the interpretation of this Agreement.
- 1.2.7 All interest payable under this Agreement shall accrue from day to day and be calculated on the basis of a year of three hundred and sixty five (365) days.
- 1.2.8 The words "hereof" or "herein", if and when used in this Agreement shall mean a reference to this Agreement.
- 1.2.9 The contents of Schedule 7 shall be referred to for ascertaining accuracy and correctness of the representations made by the Selected Bidder in Article 17.2.1 hereof.

Power Franchiston & Passing Sion

Central Transmission Utility of India Limited

New Delhi 110003

ARTICLE: 2

2 EFFECTIVENESS AND TERM OF AGREEMENT

2.1 Effective Date:

This Agreement shall be effective from later of the dates of the following events:

- a. The Selected Bidder, on behalf of the TSP, has provided the Contract Performance Guarantee, as per terms of Article 3.1 of this Agreement; and
- b. The Selected Bidder has acquired for the Acquisition Price, one hundred percent (100%) of the equity shareholding of REC Power Development and Consultancy Limited in WRNES TALEGAON POWER TRANSMISSION LIMITED along with all its related assets and liabilities as per the provisions of the Share Purchase Agreement. and
- c. The Agreement is executed and delivered by the Parties;

2.2 Term and Termination:

- 2.2.1 Subject to Article 2.2.3 and Article 2.4, this Agreement shall continue to be effective in relation to the Project until the Expiry Date, when it shall automatically terminate.
- 2.2.2 Post the Expiry Date of this Agreement, the TSP shall ensure transfer of Project Assets to CTU or its successors or an agency as decided by the Central Government at zero cost and free from any encumbrance and liability. The transfer shall be completed within 90 days of expiry of this Agreement failing which CTU shall be entitled to take over the Project Assets Suo moto.
- 2.2.3 This Agreement shall terminate before the Expiry Date in accordance with Article 13 or Article 3.3.2 or Article 3.3.4.

2.3 Conditions prior to the expiry of the Transmission License

- 2.3.1 In order to continue the Project beyond the expiry of the Transmission License, the TSP shall be obligated to make an application to the Commission at least two (2) years before the date of expiry of the Transmission License, seeking the Commission's approval for the extension of the term of the Transmission License up to the Expiry Date.
- 2.3.2 The TSP shall timely comply with all the requirements that may be laid down by the Commission for extension of the term of the Transmission License beyond the initial term of twenty-five (25) years & upto the Expiry Date and the TSP shall keep the Nodal Agency fully informed about the progress on its application for extension of the term of the Transmission License.

Central Transmission Utility of India Limited







2.4 Survival:

The expiry or termination of this Agreement shall not affect any accrued rights, obligations/ roles and liabilities of the Parties under this Agreement, including the right to receive liquidated damages as per the terms of this Agreement, nor shall it effect the survival of any continuing obligations/ roles for which this Agreement provides, either expressly or by necessary implication, which are to survive after the Expiry Date or termination including those under Articles 3.3.3, 3.3.5, Article 9.3 (Application of Insurance Proceeds), Article 11 (Force Majeure), Article 13 (Events of Default and Termination), Article 14 (Liability & Indemnification), Article 16 (Governing Law & Dispute Resolution), Article 19 (Miscellaneous).

2.5 Applicability of the provisions of this Agreement

- 2.5.1 For the purpose of Availability, Target Availability and the computation of Availability, Incentive, Penalty, the provisions provided in this Agreement shall apply and any future modifications in the relevant Rules and Regulations shall not be applicable for this Project.
- 2.5.2 For the purposes of this Agreement for ISTS systems developed under the tariff based competitive bidding framework, the provisions relating to the definitions (Availability and COD), Article 3 (Contract Performance Guarantee and Conditions Subsequent), Article 5 (Construction of the Project), Article 6 (Connection and Commissioning of the Project), Article 8 (Target Availability and calculation of Availability), Article 11 (Force Majeure), Article 12 (Change in Law), Article 13 (Event of Default), Article 14 (Indemnification), Article 15 (Assignment and Charges), Articles 16.1, 16.2 and 16.4 (Governing Laws and Dispute Resolution) and Article 17 (representation and warranties of the ISTS Licensee) of this agreement shall supersede the corresponding provisions under Sharing Regulations.

17



Central Transmission Utility of India Limited



ARTICLE: 3

3 CONDITIONS SUBSEQUENT

- 3.1 Satisfaction of conditions subsequent by the TSP
- 3.1.1 Within ten (10) days from the date of issue of Letter of Intent, the Selected Bidder, shall:
 - a. Provide the Contract Performance Guarantee, and
 - b. Acquire, for the Acquisition Price, one hundred percent (100%) equity shareholding of WRNES TALEGAON POWER TRANSMISSION LIMITED from REC Power Development and Consultancy Limited, who shall sell to the Selected Bidder, the equity shareholding of WRNES TALEGAON POWER TRANSMISSION LIMITED, along with all its related assets and liabilities.
 - c. Execute this Agreement;

The TSP shall, within five (5) working days from the date of acquisition of SPV by the Selected Bidder, undertake to apply to the Commission for the grant of Transmission License and for the adoption of tariff as required under section-63 of the Electricity Act.

The Selected Bidder, on behalf of the TSP, will provide to the **Central Transmission Utility of India Limited** (being the Nodal Agency) the Contract Performance Guarantee for an amount of **Rs. 31.00 Crore (Rupees Thirty-One Crore Only)**.

- The Contract Performance Guarantee shall be initially valid for a period up to three (3) months after the Scheduled COD of the Project and shall be extended from time to time to be valid for a period up to three (3) months after the COD of the Project. In case the validity of the Contract Performance Guarantee is expiring before the validity specified in this Article, the TSP shall, at least thirty (30) days before the expiry of the Contract Performance Guarantee, replace the Contract Performance Guarantee with another Contract Performance Guarantee or extend the validity of the existing Contract Performance Guarantee until the validity period specified in this Article.
- 3.1.3 The TSP agrees and undertakes to duly perform and complete the following activities within six (6) months from the Effective Date (except for c) below), unless such completion is affected due to any Force Majeure Event, or if any of the activities is specifically waived in writing by the Nodal Agency:
 - a. To obtain the Transmission License for the Project from the Commission;
 - To obtain the order for adoption of Transmission Charges by the Commission, as required under Section 63 of the Electricity Act 2003;

Central Transmission Utility of India Limited









- c. To submit to the Nodal Agency, CEA & Independent Engineer, the Project Execution Plan, immediately after award of contract(s) and maximum within one hundred and twenty (120) days from the Effective Date. Also, an approved copy each of Manufacturing Quality Plan (MQP) and Field Quality Plan (FQP) would be submitted to Independent Engineer & Nodal Agency in the same time period. The TSP's Project Execution Plan should be in conformity with the Scheduled COD as specified in Schedule 2 of this Agreement, and shall bring out clearly the organization structure, time plan and methodology for executing the Project, award of major contracts, designing, engineering, procurement, shipping, construction, testing and commissioning to commercial operation;
- d. To submit to the Nodal Agency, CEA & Independent Engineer a detailed bar (GANTT) chart of the Project outlining each activity (taking longer than one Month), linkages as well as durations;
- To submit to the Nodal Agency, CEA & Independent Engineer detailed specifications of conductor meeting the functional specifications specified in RFP;
- f. To achieve Financial Closure;
- g. To provide an irrevocable letter to the Lenders duly accepting and acknowledging the rights provided to the Lenders under the provisions of Article 15.3 of this Agreement and all other RFP Project Documents;
- h. To award the Engineering, Procurement and Construction contract ("EPC contract") for the design and construction of the Project and shall have given to such Contractor an irrevocable notice to proceed; and
- i. To sign the Agreement(s) required, if any, under Sharing Regulations.

3.2 Recognition of Lenders' Rights by the Nodal Agency

- 3.2.1 The Nodal Agency hereby accepts and acknowledges the rights provided to the Lenders as per Article 15.3 of this Agreement and all other RFP Project Documents.
- 3.3 Consequences of non-fulfilment of conditions subsequent
- 3.3.1 If any of the conditions specified in Article 3.1.3 is not duly fulfilled by the TSP even within three (3) Months after the time specified therein, then on and from the expiry of such period and until the TSP has satisfied all the conditions specified in Article 3.1.3, the TSP shall, on a monthly basis, be liable to furnish to Central Transmission Utility of India Limited (being the Nodal Agency) additional Contract Performance Guarantee of Rupees Three Crore Ten Lakh









Only (Rs. 3.10 Crore) within two (2) Business Days of expiry of every such Month. Such additional Contract Performance Guarantee shall be provided to Central Transmission Utility of India Limited (being the Nodal Agency) in the manner provided in Article 3.1.1 and shall become part of the Contract Performance Guarantee and all the provisions of this Agreement shall be construed accordingly. Central Transmission Utility of India Limited (being the Nodal Agency) shall be entitled to hold and / or invoke the Contract Performance Guarantee, including such additional Contract Performance Guarantee, in accordance with the provisions of this Agreement.

- 3.3.2 Subject to Article 3.3.4, if:
 - (i) the fulfilment of any of the conditions specified in Article 3.1.3 is delayed beyond nine (9) Months from the Effective Date and the TSP fails to furnish additional Contract Performance Guarantee to the Nodal Agency in accordance with Article 3.3.1 hereof; or
 - (ii) the TSP furnishes additional Performance Guarantee to the Nodal Agency in accordance with Article 3.3.1 hereof but fails to fulfil the conditions specified in Article 3.1.3 within a period of twelve (12) months from the Effective Date,

the Nodal Agency shall have the right to terminate this Agreement, by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement.

3.3.3 If the Nodal Agency elects to terminate this Agreement as per the provisions of Article 3.3.2, the TSP shall be liable to pay to the Nodal Agency an amount of Rs. 31.00 Crore (Rupees Thirty One Crore Only) as liquidated damages. The Nodal Agency shall be entitled to recover this amount of damages by invoking the Contract Performance Guarantee to the extent of liquidated damages, which shall be required by the Nodal Agency, and the balance shall be returned to TSP, if any.

It is clarified for removal of doubt that this Article shall survive the termination of this Agreement.

In case of inability of the TSP to fulfil the conditions specified in Article 3.1.3 due to any Force Majeure Event, the time period for fulfilment of the condition subsequent as mentioned in Article 3.1.3, may be extended for a period of such Force Majeure Event. Alternatively, if deemed necessary, this Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement and the Contract Performance

20

Central Transmission Utility of India Limited







Guarantee shall be returned as per the provisions of Article 6.5.1.

Provided, that due to the provisions of this Article 3.3.4, any increase in the time period for completion of conditions subsequent mentioned under Article 3.1.3, shall lead to an equal increase in the time period for the Scheduled COD. If the Scheduled COD is extended beyond a period of one hundred eighty (180) days due to the provisions of this Article 3.3.4, the TSP will be allowed to recover the interest cost during construction corresponding to the period exceeding one hundred eighty (180) days by adjustment in the Transmission Charges in accordance with Schedule 9.


- 3.3.5 Upon termination of this Agreement as per Articles 3.3.2 and 3.3.4, the Nodal Agency may take steps to bid out the Project again.
- 3.3.6 The Nodal agency, on the failure of the TSP to fulfil its obligations, if it considers that there are sufficient grounds for so doing, apart from invoking the Contract Performance Guarantee under para 3.3.3 may also initiate proceedings for blacklisting the TSP as per provisions of Article 13.2 of TSA.

3.4 Progress Reports

The TSP shall notify the Nodal Agency and CEA in writing at least once a Month on the progress made in satisfying the conditions subsequent in Articles 3.1.3.

Central Transmission Utility of India Limited







ARTICLE: 4

4 DEVELOPMENT OF THE PROJECT

4.1 TSP's obligations in development of the Project:

Subject to the terms and conditions of this Agreement, the TSP at its own cost and expense shall observe, comply with, perform, undertake and be responsible:

- for procuring and maintaining in full force and effect all Consents,
 Clearances and Permits, required in accordance with Law for development of the Project;
- b. for financing, constructing, owning and commissioning each of the Element of the Project for the scope of work set out in Schedule 1 of this Agreement in accordance with:
 - i. the Electricity Act and the Rules made thereof;
 - ii. the Grid Code;
 - iii. the CEA Regulations applicable, and as amended from time to time, for Transmission Lines and sub-stations:
 - the Central Electricity Authority (Technical Standards for Connectivity to the Grid) Regulations, 2007;
 - Central Electricity Authority (Technical Standards for construction of Electrical Plants and Electric Lines) Regulation, 2010;
 - Central Electricity Authority (Grid Standard) Regulations, 2010;
 - Central Electricity Authority (Safety requirements for construction, operation and maintenance of Electrical Plants and Electrical Lines) Regulation, 2011;
 - Central Electricity Authority (Measures relating to Safety and Electricity Supply) Regulation, 2010;
 - Central Electricity Authority (Technical Standards for Communication System in Power System Operation) Regulations, 2020.
 - iv. Safety/ security Guidelines laid down by the Government;
 - v. Prudent Utility Practices, relevant Indian Standards and the Law:

not later than the Scheduled COD as per Schedule 2 of this Agreement;

Central Transmission Utility of India Limited

pour







- c. for entering into a Connection Agreement with the concerned parties in accordance with the Grid Code.
- for owning the Project throughout the term of this Agreement free and clear of any encumbrances except those expressly permitted under Article 15 of this Agreement;
- to co-ordinate and liaise with concerned agencies and provide on a timely basis relevant information with regard to the specifications of the Project that may be required for interconnecting the Project with the Interconnection Facilities;
- f. for providing all assistance to the Arbitrators as they may require for the performance of their duties and responsibilities;
- g. to provide to the Nodal Agency and CEA, on a monthly basis, progress reports with regard to the Project and its execution (in accordance with prescribed form) to enable the CEA to monitor and co-ordinate the development of the Project matching with the Interconnection Facilities;
- h. to comply with Ministry of Power order no. 25-11/6/2018 PG dated 02.07.2020 as well as other Guidelines issued by Govt. of India pertaining to this;
- i. to procure the products associated with the Transmission System as per provisions of Public Procurement (Preference to Make in India) orders issued by Ministry of Power vide orders No. A-1/2021-FSC-Part(5) dated 16.11.2021 and No.: P-45021/2/2017-PP (BE-II)-Part-4 Vol.II dated 19.07.2024 issued by Ministry of Power for transmission sector, as amended from time to time read with Department for Promotion of Industry and Internal Trade (DPIIT) orders in this regard (Procuring Entity as defined in above orders shall deemed to have included Selected Bidder and/ or TSP).

Also, to comply with Department of Expenditure, Ministry of Finance vide Order (Public Procurement No 1) bearing File No. 6/18/2019-PPD dated 23.07.2020, Order (Public Procurement No 2) bearing File No. 6/18/2019-PPD dated 23.07.2020, Order (Public Procurement No. 3) bearing File No. 6/18/2019-PPD dated 24.07.2020, Office Memorandum (OM) No. F.18/37/2020-PPD dated 08.02.2021, OM No. F.12/1/2021-PPD(Pt.) dated 02.03.2021, OM No. F.7/10/2021-PPD dated 08.06.2021 and Order (Public Procurement No 4) bearing File No. F.7/10/2021-PPD dated 23.02.2023, as amended from time to time, regarding public procurement from a bidder of a country, which shares land border with India:

Central Transmission Utility of India Limited







- to submit to Nodal Agency information in the prescribed format [To be devised by Nodal Agency] for ensuring compliance to Article 4.1 i) above.
- k. to comply with all its obligations undertaken in this Agreement.

4.2 Roles of the Nodal Agency in implementation of the Project:

- 4.2.1 Subject to the terms and conditions of this Agreement, the Nodal Agency shall be the holder and administrator of this Agreement and shall inter alia:
 - a. appoint an Independent Engineer within 90 days of the Effective Date
 - provide letters of recommendation to the concerned Indian Governmental Instrumentality, as may be requested by the TSP from time to time, for obtaining the Consents, Clearances and Permits required for the Project;
 - c. coordinate among TSP and upstream/downstream entities in respect of Interconnection Facilities; and
 - d. monitor the implementation of the Agreement and take appropriate action for breach thereof including revocation of guarantees, cancellation of Agreement, blacklisting etc
 - e. provide all assistance to the Arbitrators as required for the performance of their duties and responsibilities; and
 - f. perform any other responsibility (ies) as specified in this Agreement.

4.3 Time for Commencement and Completion:

- a. The TSP shall take all necessary steps to commence work on the Project from the Effective Date of the Agreement and shall achieve Scheduled COD of the Project in accordance with the time schedule specified in Schedule 2 of this Agreement;
- b. The COD of each Element of the Project shall occur no later than the Scheduled COD or within such extended time to which the TSP shall be entitled under Article 4.4 hereto.

4.4 Extension of time:

4.4.1 In the event that the TSP is unable to perform its obligations for the reasons solely attributable to the Nodal Agency, the Scheduled COD shall be extended, by a 'day to day' basis, subject to the provisions of Article 13.

Central Transmission Utility of India Limited







- In the event that an Element or the Project cannot be commissioned by its Scheduled COD on account of any Force Majeure Event as per Article 11, the Scheduled COD shall be extended, by a 'day to day' basis for a period of such Force Majeure Event. Alternatively, if deemed necessary, the Nodal Agency may terminate the Agreement as per the provisions of Article 13.4 by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement.
- 4.4.3 If the Parties have not agreed, within thirty (30) days after the affected Party's performance has ceased to be affected by the relevant circumstance, on how long the Scheduled COD should be deferred by, any Party may raise the Dispute to be resolved in accordance with Article 16.

4.5 Metering Arrangements:

4.5.1 The TSP shall comply with all the provisions of the IEGC and the Central Electricity Authority (Installation and Operation of Meters) Regulations, 2006 as amended from time to time, with regard to the metering arrangements for the Project. The TSP shall fully cooperate with the CTU / STU / RLDC and extend all necessary assistance in taking meter readings.

4.6 Interconnection Facilities:

- 4.6.1 Subject to the terms and conditions of this Agreement, the TSP shall be responsible for connecting the Project with the interconnection point(s) specified in Schedule 1 of this Agreement. The Interconnection Facilities shall be developed as per the scope of work and responsibilities assigned in Schedule 1 of this Agreement. The Nodal Agency shall be responsible for coordinating to make available the Interconnection Facilities.
- 4.6.2 In order to remove any doubts, it is made clear that the obligation of the TSP within the scope of the project is to construct the Project as per Schedule-1 of this Agreement and in particular to connect it to the Interconnection Facilities as specified in this Agreement.

25

Central Transmission Utility of India Limited







5 CONSTRUCTION OF THE PROJECT

5.1 TSP's Construction Responsibilities:

- 5.1.1 The TSP, at its own cost and expense, shall be responsible for designing, constructing, erecting, testing and commissioning each Element of the Project by the Scheduled COD in accordance with the Regulations and other applicable Laws specified in Article 4.1 of this Agreement.
- 5.1.2 The TSP acknowledges and agrees that it shall not be relieved from any of its obligations under this Agreement or be entitled to any extension of time or any compensation whatsoever by reason of the unsuitability of the Site or Transmission Line route(s).
- The TSP shall be responsible for obtaining all Consents, Clearances and Permits related but not limited to road / rail / river / canal / power line / crossings, Power and Telecom Coordination Committee (PTCC), defence, civil aviation, right of way / way-leaves and environmental & forest clearances from relevant authorities required for developing, financing, constructing, maintaining/ renewing all such Consents, Clearances and Permits in order to carry out its obligations under this Agreement in general and shall furnish to the Nodal Agency such copy/ies of each Consents, Clearances and Permits, on demand. Nodal Agency shall provide letters of recommendation to the concerned Indian Governmental Instrumentality, as may be requested by the TSP from time to time, for obtaining the Consents, Clearances and Permits required for the Project.

5.1.4 The TSP shall be responsible for:

- (a) acquisition of land for location specific substations, switching stations or HVDC terminal or inverter stations. Also, the actual location of Greenfield substations (Switching Stations or HVDC Terminal or Inverter Stations) for a generation pooling substation and for load serving substations in the scope of TSP shall not be beyond 3 Km radius of the location proposed by the BPC in the survey report. However, actual location of any Greenfield Intermediate Substations in the scope of TSP shall not be beyond 10 Km radius of the location proposed by the BPC in the Survey Report;
- (b) final selection of Site including its geo-technical investigation;

26

 survey and geo-technical investigation of line route in order to determine the final route of the Transmission Lines;

Central Transmission Utility of India Limited







- (d) seeking access to the Site and other places where the Project is being executed, at its own risk and costs, including payment of any crop, tree compensation or any other compensation as may be required.
- In case the Project involves any resettlement and rehabilitation, the resettlement and rehabilitation package will be implemented by the State Government authorities, for which the costs is to be borne by the TSP and no changes would be allowed in the Transmission Charges on account of any variation in the resettlement and rehabilitation cost. The TSP shall provide assistance on best endeavour basis, in implementation of the resettlement and rehabilitation package, if execution of such package is in the interest of expeditious implementation of the Project and is beneficial to the Project affected persons.

5.2 Appointing Contractors:

- 5.2.1 The TSP shall conform to the requirements as provided in this Agreement while appointing Contractor(s) for procurement of goods & services.
- 5.2.2 The appointment of such Contractor(s) shall neither relieve the TSP of any of its obligations under this Agreement nor make the Nodal Agency liable for the performance of such Contractor(s).

5.3 Monthly Progress Reporting:

The TSP shall provide to the CEA, Nodal Agency & Independent Engineer, on a monthly basis, progress reports along with likely completion date of each Element with regard to the Project and its execution (in accordance with prescribed form). The Nodal Agency/ CEA shall monitor the development of the Project for its timely completion for improving and augmenting the electricity system as a part of its statutory responsibility.

5.4 Quality of Workmanship:

The TSP shall ensure that the Project is designed, built and completed in a good workmanship using sound engineering and construction practices, and using only materials and equipment that are new and manufactured as per the MQP and following approved FQP for erection, testing & commissioning and complying with Indian /International Standards such that, the useful life of the Project will be at least thirty-five (35) years from the COD of the Project.

The TSP shall ensure that all major substation equipment / component (e.g. transformers, reactors, Circuit Breakers, Instrument Transformers (IT), Surge Arresters (SA), Protection relays, clamps & connectors etc.), equipment in terminal stations of HVDC installations including Thyristor/ IGBT valves, Converter Transformers, smoothing reactors, Transformer bushings and wall bushings, GIS bus ducts, towers and gantry structures and transmission towers or poles and line materials (conductors, earthwire, OPGW, insulator, accessories for conductors,

Central Transmission Utility of India Limited 27 WRNES Talegaon Power Transmission Limited







OPGW & earthwires, hardware fittings for insulators, aviation lights etc), facilities and system shall be designed, constructed and tested (Type test, Routine tests, Factory Acceptance Test (FAT)) in accordance with relevant CEA Regulations and Indian Standards. In case Indian Standards for any particular equipment/ system/ process is not available, IEC/ IEEE or equivalent International Standards and Codes shall be followed.

5.5 **Progress Monitoring & Quality Assurance:**

- 5.5.1 The Project Execution Plan submitted by the TSP in accordance with Article 3.1.3 c) shall comprise of detailed schedule of all the equipments/items /materials required for the Project, right from procurement of raw material till the dispatch from works and receipt at the site. Further, it should also include various stages of the construction schedule up to the commissioning of the Project.
- Nodal Agency, CEA & Independent Engineer shall have access at all reasonable times to the Site and to the Manufacturer's works and to all such places where the Project is being executed.
- Independent Engineer shall ensure conformity of the conductor specifications with the functional specifications specified in RFP.
- 5.5.4 The Independent Engineer shall monitor the following during construction of the Project:
 - a) Quality of equipments, material, foundation, structures and workmanship etc. as laid down in Article 5.4 and 6.1.4 of the TSA. Specifically, quality of Sub-station equipments, transmission line material and workmanship etc. would be checked in accordance with the Article 5.4.
 - b) Progress in the activities specified in Condition Subsequent
 - c) Verification of readiness of the elements including the statutory clearances & completion of civil works, fixing of all components and finalisation of punch points (if any) prior to charging of the elements
 - d) Progress of construction of substation and Transmission Lines
- 5.5.5 The progress shall be reviewed by the Independent Engineer against the Project Execution Plan. The Independent Engineer shall prepare its report on monthly basis and submit the same to Nodal Agency highlighting the progress achieved till the end of respective month vis-à-vis milestone activities, areas of concern, if any, which may result in delay in the timely completion of the Project. Based on the progress, Nodal Agency and/ or CEA shall issue written instructions to the TSP to take corrective measures, as may be prudent for the timely completion of the Project. In case of any deficiency, the Nodal Agency would be at liberty to take action in accordance with the procedure of this Agreement.

28

Central Transmission Utility of India Limited





5.5.6 For any delay in commissioning any critical Element(s), as identified in Schedule 1 & Schedule 2 of this Agreement, beyond a period of 45 days shall lead to a sequestration of 10% of the Contract Performance Guarantee.

5.6 Site regulations and Construction Documents

The TSP shall abide by the Safety Rules and Procedures as mentioned in Schedule 3 of this Agreement

The TSP shall retain at the Site and make available for inspection at all reasonable times, copies of the Consents, Clearances and Permits, construction drawings and other documents related to construction.

5.7 Supervision of work:

The TSP shall provide all necessary superintendence for execution of the Project and its supervisory personnel shall be available to provide full-time superintendence for execution of the Project. The TSP shall provide skilled personnel who are experienced in their respective fields.

5.8 Remedial Measures:

The TSP shall take all necessary actions for remedying the shortfall in achievement of timely progress in execution of the Project, if any, as intimated by the Independent Engineer and/ or CEA and/ or the Nodal Agency. However, such intimation by the Independent Engineer and/ or CEA and/ or the Nodal Agency and the subsequent effect of such remedial measures carried out by the TSP shall not relieve the TSP of its obligations in the Agreement. Independent Engineer and/ or CEA and/ or the Nodal Agency may carry out random inspections during the Project execution, as and when deemed necessary by it. If the shortfalls as intimated to the TSP are not remedied to the satisfaction of the CEA and/ or the Nodal Agency, this Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement.

29

Central Transmission Utility of India Limited



6 CONNECTION AND COMMISSIONING OF THE PROJECT

- 6.1 Connection with the Inter-Connection Facilities:
- The TSP shall give the RLDC(s), CTU, / STU, as the case may be, and any other agencies as required, at least sixty (60) days advance written notice of the date on which it intends to connect an Element of the Project, which date shall not be earlier than its Scheduled COD or Schedule COD extended as per Article 4.4.1 & 4.4.2 of this Agreement, unless mutually agreed to by Parties. Further, any preponing of COD of any element prior to Scheduled COD must be approved by the Nodal Agency.
- 6.1.2 The RLDC / SLDC (as the case may be) or the CTU / STU (as the case may be), for reasonable cause, including non-availability of Interconnection Facilities as per Article 4.2, can defer the connection for up to fifteen (15) days from the date notified by the TSP pursuant to Article 6.1.1, if it notifies to the TSP in writing, before the date of connection, of the reason for the deferral and when the connection is to be rescheduled. However, no such deferment on one or more occasions would be for more than an aggregate period of thirty (30) days. Further, the Scheduled COD would be extended as required, for all such deferments on "day to day" basis.
- 6.1.3 Subject to Articles 6.1.1 and 6.1.2, any Element of Project may be connected with the Interconnection Facilities when:
 - it has been completed in accordance with this Agreement and the Connection Agreement;
 - b. it meets the Grid Code, Central Electricity Authority (Technical Standards for Connectivity to the Grid) Regulations, 2007 as amended from time to time and all other Indian legal requirements, and
 - c. The TSP has obtained the approval in writing of the Electrical Inspector certifying that the Element is ready from the point of view of safety of supply and can be connected with the Interconnection Facilities.
 - d. It has satisfactorily met all the testing requirements as per Articles 6.1.4
- 6.1.4 Site Acceptance Test (SAT)/ pre-commissioning tests of all major substation equipment, component, system, facilities shall be successfully carried out before commissioning. The Type tests, FAT and SAT reports should be available at the substation / terminal station of HVDC installations for ready reference of operation and maintenance staff and has to be made available to the

30

Central Transmission Utility of India Limited



Independent Engineer appointed for quality monitoring or their authorised representatives, as and when they wish to examine the same.

6.2 Commercial Operation:

An Element of the Project shall be declared to have achieved COD twenty-four (24) hours following the connection of the Element with the Interconnection Facilities pursuant to Article 6.1 or seven (7) days after the date on which it is declared by the TSP to be ready for charging but is not able to be charged for reasons not attributable to the TSP subject to Article 6.1.2.

Provided that an Element shall be declared to have achieved COD only after all the Element(s), if any, which are pre-required to have achieved COD as defined in Schedule 2 of this Agreement, have been declared to have achieved their respective COD.

- Once any Element of the Project has been declared to have achieved deemed COD as per Article 6.2.1 above, such Element of the Project shall be deemed to have Availability equal to the Target Availability till the actual charging of the Element and to this extent, TSP shall be eligible for the Monthly Transmission Charges applicable for such Element
- 6.3 Compensation for Direct Non Natural Force Majeure Event or Indirect Non Natural Force Majeure Event or Natural Force Majeure Event (affecting the Nodal Agency)
- 6.3.1 If the TSP is otherwise ready to connect the Element(s) of the Project and has given due notice, as per provisions of Article 6.1.1, to the concerned agencies of the date of intention to connect the Element(s) of the Project, where such date is not before the Scheduled COD, but is not able to connect the Element(s) of the Project by the said date specified in the notice, due to Direct Non Natural Force Majeure Event or Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency, provided such Direct Non Natural Force Majeure Event or Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency has continued for a period of more than three (3) continuous or non-continuous Months, the TSP shall, until the effects of the Direct Non Natural Force Majeure Event or of Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency no longer prevent the TSP from connecting the Element(s) of the Project, be deemed to have achieved COD relevant to that date and to this extent, be deemed to have been providing Transmission Service with effect from the date notified, and shall be treated as follows:
 - a. In case of delay due to Direct Non Natural Force Majeure Event, TSP is entitled for Transmission Charges calculated on Target Availability for the period of such events in excess of three (3) continuous or non-continuous Months in the manner provided in (c) below.

Sentral Transmission Utility of India Limited 31 WRNES Talegaon Power-Fransmission Limited





- b. In case of delay due to Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency, TSP is entitled for payment for debt service which is due under the Financing Agreements, subject to a maximum of Transmission Charges calculated on Target Availability, for the period of such events in excess of three (3) continuous or non-continuous Months in the manner provided in (c) below.
- c. In case of delay due to Direct Non Natural Force Majeure Event or Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency, the TSP is entitled for payments mentioned in (a) and (b) above, after commencement of Transmission Service, in the form of an increase in Transmission Charges. These amounts shall be paid from the date, being the later of a) the date of cessation of such Indirect Non Natural Force Majeure Event or Natural Force Majeure Event affecting the Nodal Agency and b) the completion of sixty (60) days from the receipt of the Financing Agreements by the Nodal Agency from the TSP.

Provided such increase in Transmission Charges shall be so as to put the TSP in the same economic position as the TSP would have been in case the TSP had been paid amounts mentioned in (a) and (b) above in a situation where the Force Majeure Event had not occurred.

For the avoidance of doubt, it is clarified that the charges payable under this Article 6.3.1 shall be recovered as per Sharing Regulations.

6.4 Liquidated Damages for Delay in achieving COD of Project:

- 6.4.1 If the TSP fails to achieve COD of any Element of the Project or the Project, by the Element's / Project's Scheduled COD or such Scheduled COD as extended under Articles 4.4.1 and 4.4.3, then the TSP shall pay to the Nodal Agency, a sum equivalent to 3.33% of Monthly Transmission Charges applicable for the Element of the Project [in case where no Elements have been defined, to be on the Project as a whole] / Project, for each day of delay up to sixty (60) days of delay and beyond that time limit, at the rate of five percent (5%) of the Monthly Transmission Charges applicable to such Element / Project, as liquidated damages for such delay and not as penalty, without prejudice to any rights of the Nodal Agency under the Agreement.
- 6.4.2 The TSP's maximum liability under this Article 6.4 shall be limited to the amount of liquidated damages calculated in accordance with Article 6.4.1 for and up to six (6) months of delay for the Element or the Project.

Provided that, in case of failure of the TSP to achieve COD of the Element of the Project even after the expiry of six (6) months from its Scheduled COD, the provisions of Article 13 shall apply.

Central Transmission Utility of India Limited







- 6.4.3 The TSP shall make payment to the Nodal Agency of the liquidated damages calculated pursuant to Article 6.4.1 within ten (10) days of the earlier of:
 - a. the date on which the applicable Element achieves COD; or
 - b. the date of termination of this Agreement.

The payment of such damages shall not relieve the TSP from its obligations to complete the Project or from any other obligation and liabilities under the Agreement.

- 6.4.4 If the TSP fails to pay the amount of liquidated damages to the Nodal Agency within the said period of ten (10) days, the Nodal Agency shall be entitled to recover the said amount of the liquidated damages by invoking the Contract Performance Guarantee. If the then existing Contract Performance Guarantee is for an amount which is less than the amount of the liquidated damages payable by the TSP to the Nodal Agency under this Article 6.3 and the TSP fails to make payment of the balance amount of the liquidated damages not covered by the Contract Performance Guarantee, then such balance amount shall be deducted from the Transmission Charges payable to the TSP. The right of the Nodal Agency to encash the Contract Performance Guarantee is without prejudice to the other rights of the Nodal Agency under this Agreement.
- 6.4.5 For avoidance of doubt, it is clarified that amount payable by TSP under this Article is over and above the penalty payable by TSP under Article 5.5.6 of this Agreement.

6.5 Return of Contract Performance Guarantee

- 6.5.1 The Contract Performance Guarantee as submitted by TSP in accordance with Article 3.1.1 shall be released by the Nodal Agency within three (3) months from the COD of the Project. In the event of delay in achieving Scheduled COD of any of the Elements by the TSP (otherwise than due to reasons as mentioned in Article 3.1.3 or Article 11) and consequent part invocation of the Contract Performance Guarantee by the Nodal Agency, Nodal Agency shall release the Contract Performance Guarantee, if any remaining unadjusted, after the satisfactory completion by the TSP of all the requirements regarding achieving the Scheduled COD of the remaining Elements of the Project. It is clarified that the Nodal Agency shall also return / release the Contract Performance Guarantee in the event of (i) applicability of Article 3.3.2 to the extent the Contract Performance Guarantee is valid for an amount in excess of Rs. 31.00 Crore (Rupees Thirty One Crore Only), or (ii) termination of this Agreement by the Nodal Agency as mentioned under Article 3.3.4 of this Agreement.
- 6.5.2 The release of the Contract Performance Guarantee shall be without prejudice to other rights of the Nodal Agency under this Agreement.

Central Transmission Utility of India Limited







7 **OPERATION AND MAINTENANCE OF THE PROJECT**

7.1 Operation and Maintenance of the Project:

The TSP shall be responsible for ensuring that the Project is operated and maintained in accordance with the regulations made by the Commission and CEA from time to time and provisions of the Act.

Central Transmission Utility of India Limited







8 AVAILABILITY OF THE PROJECT

8.1 Calculation of Availability of the Project:

Calculation of Availability for the Elements and for the Project, as the case may be, shall be as per Appendix –IV to Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2024, as applicable on the Bid Deadline and as appended in Schedule 6 of this Agreement.

8.2 Target Availability:

The Target Availability of each Element and the Project shall be 98%.

Payment of monthly Transmission charges based on actual availability will be calculated as per para 1.2 of Schedule 4 of this Agreement.

If the availability of any Element or the Project is below the Target Availability, for six consecutive months in a Contract Year, the DIC(s) or the Nodal Agency may issue a show cause notice to the TSP, asking them to show cause as to why the Transmission Service Agreement be not terminated, and if no satisfactory cause is shown it may terminate the Agreement. If the Nodal Agency is of the opinion that the transmission system is of critical importance, it may carry out or cause to carry the operation and maintenance of transmission system at the risk and cost of TSP.

Central Transmission Utility of India Limited

35

WRNES Talegaon Power Transmission Limited

New Delhi
110003

Ner Transmission

9 INSURANCES

9.1 Insurance:

- 9.1.1 The TSP shall effect and maintain or cause to be effected and maintained during the Construction Period and the Operating Period, adequate Insurances against such risks, with such deductibles including but not limited to any third party liability and endorsements and co-beneficiary/insured, as may be necessary under
 - a. any of the Financing Agreements,
 - b. the Laws, and
 - c. in accordance with Prudent Utility Practices.

The Insurances shall be taken effective from a date prior to the date of the Financial Closure till the Expiry Date.

9.2 Evidence of Insurance cover:

9.2.1 The TSP shall furnish to the Nodal Agency copies of certificates and policies of the Insurances, as and when the Nodal Agency may seek from the TSP as per the terms of Article 9.1

9.3 Application of Insurance Proceeds:

- 9.3.1 Save as expressly provided in this Agreement, the policies of Insurances and the Financing Agreements, the proceeds of any insurance claim made due to loss or damage to the Project or any part of the Project shall be first applied to reinstatement, replacement or renewal of such loss or damage.
- 9.3.2 If a Natural Force Majeure Event renders the Project no longer economically and technically viable and the insurers under the Insurances make payment on a "total loss" or equivalent basis, the portion of the proceeds of such Insurance available to the TSP (after making admissible payments to the Lenders as per the Financing Agreements) shall be allocated only to the TSP. Nodal Agency and / or concerned Designated ISTS Customers shall have no claim on such proceeds of the Insurance.
- 9.3.3 Subject to the requirements of the Lenders under the Financing Agreements, any dispute or difference between the Parties as to whether the Project is no longer economically and technically viable due to a Force Majeure Event or whether that event was adequately covered in accordance with this Agreement by the Insurances shall be determined in accordance with Article 16.

9.4 Effect on liability of the Nodal Agency / Designated ISTS Customers

9.4.1 The Nodal Agency and / or the Designated ISTS Customers shall have no financial obligations or liability whatsoever towards the TSP in respect of this Article 9.

110003

Central Transmission Utility of India Limited 36 WRNES Talegaon Power Transmission Limited



10 BILLING AND PAYMENT OF TRANSMISSION CHARGES

Subject to provisions of this Article 10, the Monthly Transmission Charges shall be paid to the TSP, in Indian Rupees, on monthly basis as per the provisions of the Sharing Regulations, from the date on which an Element(s) has achieved COD until the Expiry Date of this Agreement, unless terminated earlier and in line with the provisions of Schedule 4 of this Agreement.

10.2 Calculation of Monthly Transmission Charges:

The Monthly Transmission Charges for each Contract Year including Incentive & Penalty payment shall be calculated in accordance with the provisions of Schedule 4 of this Agreement.

10.3 Rebate & Late Payment Surcharge:

The rebate and late payment surcharge shall be governed as per Sharing Regulations.

10.4 Disputed Bills, Default in payment by the Designated ISTS Customers & Annual Reconciliation:

Any Disputed Bill, Default in payment by the Designated ISTS Customers & Annual Reconciliation shall be governed as per Sharing Regulations.





WRNES Talegaon Power Transmission Limited

New Delhi 1100**03**

FORCE MAJEURE

- 11.1 **Definitions**
- The following terms shall have the meanings given hereunder. 11.1.1
- 11.2 **Affected Party**
- 11.2.1 An Affected Party means any Party whose performance has been affected by an event of Force Majeure.
- 11.2.2 Any event of Force Majeure shall be deemed to be an event of Force Majeure affecting the TSP only if the Force Majeure event affects and results in, late delivery of machinery and equipment for the Project or construction, completion, commissioning of the Project by Scheduled COD and/or operation thereafter;

11.3 Force Majeure

A 'Force Majeure' means any event or circumstance or combination of events and circumstances including those stated below that wholly or partly prevents or unavoidably delays an Affected Party in the performance of its obligations/ roles under this Agreement, but only if and to the extent that such events or circumstances are not within the reasonable control, directly or indirectly, of the Affected Party and could not have been avoided if the Affected Party had taken reasonable care or complied with Prudent Utility Practices:

(a) **Natural Force Majeure Events:**

- act of God, including, but not limited to drought, fire and explosion (to the extent originating from a source external to the Site), earthquake, volcanic eruption, landslide, flood, cyclone, typhoon, tornado, or exceptionally adverse weather conditions, which are in excess of the statistical measures for the last hundred (100) years; and
- epidemic/ pandemic notified by Indian Governmental Instrumentality.

Non-Natural Force Majeure Events:

- i. Direct Non-Natural Force Majeure Events
 - Nationalization or compulsory acquisition by any Indian Governmental Instrumentality of any material assets or rights of the Affected Party; or

the unlawful, unreasonable or discriminatory revocation of, or refusal

New Delhi

Central Transmission Utility of India Limited 38 WRNES Talegaon Power Transmission Limited





aprice

to renew, any Consents, Clearances and Permits required by the Affected Party to perform their obligations/ roles under the RFP Project Documents or any unlawful, unreasonable or discriminatory refusal to grant any other Consents, Clearances and Permits required for the development/ operation of the Project, provided that a Competent Court of Law declares the revocation or refusal to be unlawful, unreasonable and discriminatory and strikes the same down; or

- any other unlawful, unreasonable or discriminatory action on the part of an Indian Governmental Instrumentality which is directed against the Project, provided that a Competent Court of Law declares the action to be unlawful, unreasonable and discriminatory and strikes the same down.
- ii. Indirect Non Natural Force Majeure Events
 - act of war (whether declared or undeclared), invasion, armed conflict or act of foreign enemy, blockade, embargo, revolution, riot, insurrection, terrorist or military action; or
 - radio active contamination or ionising radiation originating from a source in India or resulting from any other Indirect Non Natural Force Majeure Event mentioned above, excluding circumstances where the source or cause of contamination or radiation is brought or has been brought into or near the Site by the Affected Party or those employed or engaged by the Affected Party; or
 - industry-wide strikes and labour disturbances, having a nationwide impact in India.

11.4 Force Majeure Exclusions

- 11.4.1 Force Majeure shall not include (i) any event or circumstance which is within the reasonable control of the Parties and (ii) the following conditions, except to the extent that they are consequences of an event of Force Majeure:
 - (a) Unavailability, late delivery, or changes in cost of the machinery, equipment, materials, spare parts etc. for the Project;
 - (b) Delay in the performance of any Contractors or their agents;
 - (c) Non-performance resulting from normal wear and tear typically experienced in transmission materials and equipment;
 - (d) Strikes or labour disturbance at the facilities of the Affected Party:

39

entral Transmission Utility of India Limited



- (e) Insufficiency of finances or funds or the Agreement becoming onerous to perform; and
- (f) Non-performance caused by, or connected with, the Affected Party's:
 - i. negligent or intentional acts, errors or omissions;
 - ii. failure to comply with an Indian Law; or
 - iii. breach of, or default under this Agreement or any Project Documents.
- (g) Any error or omission in the survey report provided by BPC during the bidding process.

11.5 Notification of Force Majeure Event

11.5.1 The Affected Party shall give notice to the other Party of any event of Force Majeure as soon as reasonably practicable, but not later than seven (7) days after the date on which such Party knew or should reasonably have known of the commencement of the event of Force Majeure. If an event of Force Majeure results in a breakdown of communications rendering it unreasonable to give notice within the applicable time limit specified herein, then the Party claiming Force Majeure shall give such notice as soon as reasonably practicable after reinstatement of communications, but not later than one (1) day after such reinstatement.

Provided that, such notice shall be a pre-condition to the Affected Party's entitlement to claim relief under this Agreement. Such notice shall include full particulars of the event of Force Majeure, its effects on the Party claiming relief and the remedial measures proposed. The Affected Party shall give the other Party regular reports on the progress of those remedial measures and such other information as the other Party may reasonably request about the Force Majeure.

11.5.2 The Affected Party shall give notice to the other Party of (i) the cessation of the relevant event of Force Majeure; and (ii) the cessation of the effects of such event of Force Majeure on the performance of its rights or obligations/ roles under this Agreement, as soon as practicable after becoming aware of each of these cessations.

11.6 Duty to perform and duty to mitigate

To the extent not prevented by a Force Majeure Event, the Affected Party shall continue to perform its obligations/ roles as provided in this Agreement. The Affected Party shall use its reasonable efforts to mitigate the effect of any event of Force Majeure as soon as practicable.

11.7 Available Relief for a Force Majeure Event

Central Transmission Utility of India Limited 40 WRNES Talegaon Power Transmission Limited





Subject to this Article 11,

- (a) no Party shall be in breach of its obligations/ roles pursuant to this Agreement to the extent that the performance of its obligations/ roles was prevented, hindered or delayed due to a Force Majeure Event;
- (b) each Party shall be entitled to claim relief for a Force Majeure Event affecting its performance in relation to its obligations/ roles under Articles 3.3.4, 4.4.2 and 6.3.1 of this Agreement.
- (c) For the avoidance of doubt, it is clarified that the computation of Availability of the Element(s) under outage due to Force Majeure Event, as per Article 11.3 affecting the TSP shall be as per Appendix –IV to Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2024 as on Bid Deadline. For the event(s) for which the Element(s) is/are deemed to be available as per Appendix –IV to Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2024, then the Transmission Charges, as applicable to such Element(s), shall be payable as per Schedule 4, for the duration of such event(s).
- (d) For so long as the TSP is claiming relief due to any Force Majeure Event under this Agreement, the Nodal Agency may, if it so desires, from time to time on one (1) day notice, inspect the Project and the TSP shall provide the Nodal Agency's personnel with access to the Project to carry out such inspections.
- (e) For avoidance of doubt, the TSP acknowledges that for extension of Scheduled COD a period up to one hundred eighty (180) days due to Force Majeure event, no compensation on the grounds such as interest cost, incident expenditure, opportunity cost will be made to the TSP. However, if Scheduled COD is extended beyond a period of one hundred eighty (180) days due to Force Majeure event, the TSP will be allowed to recover the interest cost during construction corresponding to the period exceeding one hundred eighty (180) days by adjustment in the Transmission Charges in accordance with Schedule 9.

41

Central Transmission Utility of India Limited

12 CHANGE IN LAW

12.1 Change in Law

- 12.1.1 Change in Law means the occurrence of any of the following after the Bid Deadline resulting into any additional recurring / non-recurring expenditure by the TSP or any savings of the TSP:
 - the enactment, coming into effect, adoption, promulgation, amendment, modification or repeal (without re-enactment or consolidation) in India, of any Law, including rules and regulations framed pursuant to such Law, subject to the provisions under Article 12.1.2;
 - a change in the interpretation or application of any Law by any Indian Governmental Instrumentality having the legal power to interpret or apply such Law, or any Competent Court of Law;
 - the imposition of a requirement for obtaining any Consents,
 Clearances and Permits which was not required earlier;
 - a change in the terms and conditions prescribed for obtaining any Consents, Clearances and Permits or the inclusion of any new terms or conditions for obtaining such Consents, Clearances and Permits;
 - any change in the licensing regulations of the Commission, under which the Transmission License for the Project was granted if made applicable by such Commission to the TSP;
 - change in wind zone; or
 - any change in tax or introduction of any tax made applicable for providing Transmission Service by the TSP as per the terms of this Agreement.
- 12.1.2 Notwithstanding anything contained in this Agreement, Change in Law shall not cover any change:
 - a) Taxes on corporate income; and

42

b) Withholding tax on income or dividends distributed to the shareholders of the TSP.

entral Transmission Utility of India Limited



12.2 Relief for Change in Law

During Construction Period, the impact of increase/decrease in the cost of the Project on the Transmission Charges shall be governed by the formula given in Schedule 9 of this Agreement.

12.2.2 During the Operation Period:

During the operation period, if as a result of Change in Law, the TSP suffers or is benefited from a change in costs or revenue, the aggregate financial effect of which exceeds 0.30% (zero point three percent) of the Annual Transmission Charges in aggregate for a Contract Year, the TSP may notify so to the Nodal Agency and propose amendments to this Agreement so as to place the TSP in the same financial position as it would have enjoyed had there been no such Change in Law resulting in change in costs or revenue as aforesaid.

12.2.3 For any claims made under Articles 12.2.1 and 12.2.2 above, the TSP shall provide to the Nodal Agency documentary proof of such increase / decrease in cost of the Project / revenue for establishing the impact of such Change in Law.

In cases where Change in Law results in decrease of cost and it comes to the notice of Nodal Agency that TSP has not informed Nodal Agency about such decrease in cost, Nodal Agency may initiate appropriate claim.

12.3 Notification of Change in Law:

- 12.3.1 If the TSP is affected by a Change in Law in accordance with Article 12.1 and wishes to claim relief for such Change in Law under this Article 12, it shall give notice to Nodal Agency of such Change in Law as soon as reasonably practicable after becoming aware of the same.
- 12.3.2 The TSP shall also be obliged to serve a notice to the Nodal Agency even when it is beneficially affected by a Change in Law.
- 12.3.3 Any notice served pursuant to Articles 12.3.1 and 12.3.2 shall provide, amongst other things, precise details of the Change in Law and its estimated impact on the TSP.

12.4 Payment on account of Change in Law

12.4.1 The payment for Change in Law shall be through a separate Bill. However, in case of any change in Monthly Transmission Charges by reason of Change in Law, as determined in accordance with this Agreement, the Bills to be raised by the Nodal Agency after such change in Transmission Charges shall appropriately reflect the changed Monthly Transmission Charges.

43

Central Transmission Utility of India Limited

dono



13 EVENTS OF DEFAULT AND TERMINATION

13.1 TSP's Event of Default

The occurrence and continuation of any of the following events shall constitute a TSP Event of Default, unless any such TSP Event of Default occurs as a result of any non-fulfilment of its obligations as prescribed under this Agreement by the Nodal Agency or a Force Majeure Event:

- a. After having taken up the construction of the Project, the abandonment by the TSP or the TSP's Contractors of the construction of the Project for a continuous period of two (2) months and such default is not rectified within thirty (30) days from the receipt of notice from the Nodal Agency in this regard;
- The failure to commission any Element of the Project by the date falling six (6) months after its Scheduled COD unless extended by Nodal Agency as per provisions of this Agreement;
- c. If the TSP:
 - assigns, mortgages or charges or purports to assign, mortgage or charge any of its assets or rights related to the Project in contravention of the provisions of this Agreement; or
 - ii. transfers or novates any of its obligations pursuant to this Agreement, in a manner contrary to the provisions of this Agreement;

Except where such transfer is in pursuance of a Law and

- it does not affect the ability of the transferee to perform, and such transferee has the financial and technical capability to perform, its obligations under this Agreement;
- is to a transferee who assumes such obligations under the Project and this Agreement remains effective with respect to the transferee;
- d. If:

 The TSP becomes voluntarily or involuntarily the subject of any bankruptcy or insolvency or winding up proceedings and such proceedings remain uncontested for a period of thirty (30) days; or

ver Central Transmission Utility of India Limited



- ii. any winding up or bankruptcy or insolvency order is passed against the TSP; or
- iii. the TSP goes into liquidation or dissolution or a receiver or any similar officer is appointed over all or substantially all of its assets or official liquidator is appointed to manage its affairs, pursuant to Law,

Provided that a dissolution or liquidation of the TSP will not be a TSP's Event of Default, where such dissolution or liquidation of the TSP is for the purpose of a merger, consolidation or reorganization with the prior approval of the Commission as per the provisions of Central Electricity Regulatory Commission (Procedure, terms and Conditions for grant of Transmission License and other related matters) Regulations, 2006 or as amended from time to time; or

- e. Failure on the part of the TSP to comply with the provisions of Article 19.1 of this Agreement; or
- f. the TSP repudiates this Agreement and does not rectify such breach even within a period of thirty (30) days from a notice from the Nodal Agency in this regard; or
- g. after Commercial Operation Date of the Project, the TSP fails to achieve monthly Target Availability of 98%, for a period of six (6) consecutive months or within a non-consecutive period of six (6) months within any continuous aggregate period of eighteen(18) months except where the Availability is affected by Force Majeure Events as per Article 11; or
- h. any of the representations and warranties made by the TSP in Article 17 of this Agreement being found to be untrue or inaccurate. Further, in addition to the above, any of the undertakings submitted by the Selected Bidder at the time of submission of the Bid being found to be breached or inaccurate, including but not limited to undertakings from its Parent Company / Affiliates related to the minimum equity obligation; or
- i. the TSP fails to complete / fulfil all the activities / conditions within the specified period as per Article 3; or
- j. except for the reasons solely attributable to Nodal Agency, the TSP is in material breach of any of its obligations under this Agreement and such material breach is not rectified by the TSP within thirty (30) days of receipt of notice in this regard from the Nodal Agency; or
- the TSP fails to take the possession of the land required for location specific substations, switching stations or HVDC terminal or inverter

New Delhi

ral Transmission Utility of India Limited 45 WRNES Talegaon Power Transmission Limited

stations and / or fails to pay the requisite price to the parties and / or any State Government authority from whom the land is acquired, within twelve (12) months from the Effective Date.

13.2 <u>Termination Procedure for TSP Event of Default</u>

- a. Upon the occurrence and continuance of any TSP's Event of Default under Article 13.1 the Nodal Agency may serve notice on the TSP, with a copy to the CEA and the Lenders' Representative, of their intention to terminate this Agreement (a "Nodal Agency's Preliminary Termination Notice"), which shall specify in reasonable detail, the circumstances giving rise to such Nodal Agency's Preliminary Termination Notice.
- b. Following the issue of a Nodal Agency's Preliminary Termination Notice, the Consultation Period shall apply and would be for the Parties to discuss as to what steps shall be taken with a view to mitigate the consequences of the relevant Event of Default having regard to all the circumstances.
- c. During the Consultation Period, the Parties shall, save as otherwise provided in this Agreement, continue to perform their respective obligations/ roles under this Agreement, and the TSP shall not remove any material, equipment or any part of the Project, without prior consent of the Nodal Agency.

Following the expiry of the Consultation Period, unless the Parties shall have otherwise agreed to the contrary or the circumstances giving rise to Nodal Agency's Preliminary Termination Notice shall have ceased to exist or shall have been remedied, this Agreement may be terminated by the Nodal Agency by giving a Termination Notice to the TSP, in writing, of at least seven (7) days, with a copy to CEA and the Lenders' Representative in order to enable the Lenders to exercise right of substitution in accordance with Article 15.3 of this Agreement.

Further, the Nodal Agency may also initiate proceedings to blacklist the TSP & its Affiliates from participation in any RFP issued by BPCs for a period of 5 years.

13.3 Procedure for Nodal Agency's non-fulfilment of Role

- a. Upon the Nodal Agency not being able to fulfil its role under Article 4.2, the TSP may serve notice on the Nodal Agency, with a copy to CEA and the Lenders' Representative (a "TSP's Preliminary Notice"), which notice shall specify in reasonable detail the circumstances giving rise to such non-fulfilment of role by the Nodal Agency.
- Following the issue of a TSP's Preliminary Notice, the Consultation Period shall apply.

Central Transmission Utility of India Limited



- c. The Consultation Period would be for the Parties to discuss as to what steps shall be taken with a view to mitigate the consequences of the relevant non-fulfilment of role by the Nodal Agency including giving time extension to TSP, having regard to all the circumstances.
- d. During the Consultation Period, both Parties shall, save as otherwise provided in this Agreement, continue to perform their respective obligations/ roles under this Agreement.

13.4 Termination due to Force Majeure

- In case the Parties could not reach an agreement pursuant to Articles 3.3.4 and 4.4.2 of this Agreement and the Force Majeure Event or its effects continue to be present, the Nodal Agency shall have the right to cause termination of the Agreement. In case of such termination, the Contract Performance Guarantee shall be returned to the TSP as per the provisions of Article 6.5.1.
- In case of termination of this Agreement, the TSP shall provide to the Nodal Agency the full names and addresses of its Contractors as well as complete designs, design drawings, manufacturing drawings, material specifications and technical information, as required by the Nodal Agency within thirty (30) days of Termination Notice.

13.5 Termination or amendment due to non-requirement of any Element or Project during construction

- 13.5.1 In case any Element or Project, which is under construction, is no longer required due to any reason whatsoever, the Nodal Agency may issue a notice to this effect to the TSP.
- 13.5.2 Nodal agency may also issue notice to the TSP seeking their response to the proposed termination/amendment (as the case may be) of the Agreement. The Nodal Agency shall issue copy of such notice to Lenders. In the notice, Nodal

47

Central Transmission Utility of India Limited



- Agency shall also include an assessment of the physical progress made by TSP in the Element/ Project (as the case may be) that is no longer required.
- 13.5.3 The TSP shall neither carry out further investment nor carry out any work on the Element/ Project (as the case may be) that is no longer required after delivery of the notice.
- 13.5.4 After taking into account the comments of the TSP, the Nodal Agency may terminate the Agreement or amend it if both Parties agree to the amendment.

13.6 Revocation of the Transmission License

13.6.1 The Commission may, as per the provisions of the Electricity Act, 2003, revoke the Transmission License of the ISTS Licensee. Further, in such a case, the Agreement shall be deemed to have been terminated.

13.7 Termination Payment

13.7.1 If Agreement is terminated on account of Force Majeure Events, non-requirement of any Element or Project during Construction, Nodal Agency's non-fulfilment of Role & TSP's Event of Default, the TSP shall be entitled for Termination Payment equivalent to valuation of Project Assets. Upon payment, the Nodal Agency shall take over the Project Assets.

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

New Delhi 110003



14 LIABILITY AND INDEMNIFICATION

14.1 Indemnity

- 14.1.1 The TSP shall indemnify, defend and hold the Nodal Agency harmless against:
 - (a) any and all third party claims, actions, suits or proceedings against the Nodal Agency for any loss of or damage to property of such third party, or death or injury to such third party, arising out of a breach by the TSP of any of its obligations under this Agreement, except to the extent that any such claim, action, suit or proceeding has arisen due to a negligent act or omission, breach of this Agreement or non-fulfilment of statutory duty on the part of Nodal Agency; and
 - (b) any and all losses, damages, costs and expenses including legal costs, fines, penalties and interest actually suffered or incurred by the Nodal Agency from third party claims arising by reason of:
 - i. a breach by the TSP of any of its obligations under this Agreement, (provided that this Article 14 shall not apply to such breaches by the TSP, for which specific remedies have been provided for under this Agreement) except to the extent that any such losses, damages, costs and expenses including legal costs, fines, penalties and interest (together to constitute "Indemnifiable Losses") has arisen due to a negligent act or omission, breach of this Agreement or non-fulfilment of statutory duty on the part of the Nodal Agency, or
 - ii. any of the representations and warranties of the TSP under this Agreement being found to be inaccurate or untrue.
- 14.1.2 The Nodal Agency shall, in accordance with the Regulations framed by CERC in this regard, indemnify, defend and hold the TSP harmless against:
 - (a) any and all third party claims, actions, suits or proceedings against the TSP, for any loss of or damage to property of such third party, or death or injury to such third party, arising out of any material breach by the Nodal Agency of any of their roles under this Agreement, except to the extent that any such claim, action, suit or proceeding has arisen due to a negligent act or omission, breach of this Agreement or breach of statutory duty on the part of the TSP, its Contractors, servants or agents; and
 - (b) any and all losses, damages, costs and expenses including legal costs, fines, penalties and interest ('Indemnifiable Losses') actually suffered or incurred by the TSP from third party claims arising by reason of:

49

Central Transmission Utility of India Limited



- i. any material breach by the Nodal Agency of any of its roles under this Agreement (provided that, this Article 14 shall not apply to such breaches by the Nodal Agency, for which specific remedies have been provided for under this Agreement), except to the extent that any such Indemnifiable Losses have arisen due to a negligent act or omission, breach of this Agreement or breach of statutory duty on the part of the TSP, its Contractors, servants or agents or
- any of the representations and warranties of the Nodal Agency under this Agreement being found to be inaccurate or untrue.

14.2 Patent Indemnity:

14.2.1

(a) The TSP shall, subject to the Nodal Agency's compliance with Article 14.2.1 (b), indemnify and hold harmless the Nodal Agency and its employees and officers from and against any and all suits, actions or administrative proceedings, claims, demands, losses, damages, costs, and expenses of whatsoever nature, including attorney's fees and expenses, which the Nodal Agency may suffer as a result of any infringement or alleged infringement of any patent, utility model, registered design, trademark, copyright or other intellectual property right registered or otherwise existing at the date of the Agreement by reason of the setting up of the Project by the TSP.

Such indemnity shall not cover any use of the Project or any part thereof other than for the purpose indicated by or to be reasonably inferred from the Agreement, any infringement resulting from the misuse of the Project or any part thereof, or any products produced in association or combination with any other equipment, plant or materials not supplied by the TSP, pursuant to the Agreement.

- (b) If any proceedings are brought or any claim is made against the Nodal Agency arising out of the matters referred to in Article 14.2.1(a), the Nodal Agency shall promptly give the TSP a notice thereof, and the TSP shall at its own expense take necessary steps and attend such proceedings or claim and any negotiations for the settlement of any such proceedings or claim. The TSP shall promptly notify the Nodal Agency of all actions taken in such proceedings or claims.
- (c) If the TSP fails to notify the Nodal Agency within twenty-eight (28) days after receipt of such notice from the Nodal Agency under Article 14.2.1(b) above, that it intends to attend any such proceedings or claim, then the Nodal Agency shall be free to attend the same on their own behalf at the cost of the TSP. Unless the TSP has so failed to notify the Nodal Agency within the twenty eight (28) days period, the Nodal Agency shall make no

Central Transmission Utility of India Limited

50 WRNES Talegaon Power Transmission Limited

New Delhi 110003



admission that may be prejudicial to the defence of any such proceedings or claims.

(d) The Nodal Agency shall, at the TSP's request, afford all available assistance to the TSP in attending to such proceedings or claim, and shall be reimbursed by the TSP for all reasonable expenses incurred in so doing.

14.2.2

- (a) The Nodal Agency, in accordance with the Regulations framed by CERC in this regard, subject to the TSP's compliance with Article 14.2.2(b) shall indemnify and hold harmless the TSP and its employees, officers from and against any and all suits, actions or administrative proceedings, claims, demands, losses, damages, costs and expenses of whatsoever nature, including attorney's fees and expenses, which the TSP may suffer as a result of any infringement or alleged infringement of any patent, utility model, registered design, trademark, copyright or other intellectual property right registered or otherwise existing at the date of the Agreement by reason of the setting up of the Project by the TSP.
- (b) If any proceedings are brought or any claim is made against the TSP arising out of the matters referred to in Article 14.2.2 (a) the TSP shall promptly give the Nodal Agency a notice thereof, and the Nodal Agency shall at its own expense take necessary steps and attend such proceedings or claim and any negotiations for the settlement of any such proceedings or claim. The Nodal Agency shall promptly notify the TSP of all actions taken in such proceedings or claims.
- (c) If the Nodal Agency fails to notify the TSP within twenty-eight (28) days after receipt of such notice from the TSP under Article 14.2.2(b) above, that it intends to attend any such proceedings or claim, then the TSP shall be free to attend the same on its own behalf at the cost of the Nodal Agency. Unless the Nodal Agency has so failed to notify the TSP within the twenty (28) days period, the TSP shall make no admission that may be prejudicial to the defence of any such proceedings or claim.
- (d) The TSP shall, at the Nodal Agency request, afford all available assistance to the Nodal Agency in attending to such proceedings or claim, and shall be reimbursed by the Nodal Agency for all reasonable expenses incurred in so doing.

14.3 Monetary Limitation of liability

14.3.1 A Party ("Indemnifying Party") shall be liable to indemnify the other Party ("Indemnified Party") under this Article 14 for any indemnity claims made in a Contract Year only up to an amount of Rupees Two Crore Seven Lakh Only (Rs. 2.07 Crore).

Central Transmission Utility of India Limited

51



14.4 Procedure for claiming indemnity

14.4.1 Where the Indemnified Party is entitled to indemnification from the Indemnifying Party pursuant to Articles 14.1 or 14.2 the Indemnified Party shall promptly notify the Indemnifying Party of such claim, proceeding, action or suit referred to in Articles 14.1 or 14.2 in respect of which it is entitled to be indemnified. Such notice shall be given as soon as reasonably practicable after the Indemnified Party becomes aware of such claim, proceeding, action or suit. The Indemnifying Party shall be liable to settle the indemnification claim within thirty (30) days of receipt of the above notice.

Provided however that, if:

- i. the Parties choose to contest, defend or litigate such claim, action, suit or proceedings in accordance with Article 14.4.3 below; and
- ii. the claim amount is not required to be paid/deposited to such third party pending the resolution of the Dispute,

the Indemnifying Party shall become liable to pay the claim amount to the Indemnified Party or to the third party, as the case may be, promptly following the resolution of the Dispute, if such Dispute is not settled in favour of the Indemnified Party.

- 14.4.2 The Indemnified Party may contest, defend and litigate a claim, action, suit or proceeding for which it is entitled to be indemnified under Articles 14.1 or 14.2 and the Indemnifying Party shall reimburse to the Indemnified Party all reasonable costs and expenses incurred by the Indemnified Party. However, such Indemnified Party shall not settle or compromise such claim, action, suit or proceedings without first getting the consent of the Indemnifying Party, which consent shall not be unreasonably withheld or delayed.
- 14.4.3 An Indemnifying Party may, at its own expense, assume control of the defence of any proceedings brought against the Indemnified Party if it acknowledges its obligation to indemnify such Indemnified Party, gives such Indemnified Party prompt notice of its intention to assume control of the defence, and employs an independent legal counsel at its own cost that is reasonably satisfactory to the Indemnified Party.

14.5 Limitation on Liability

14.5.1 Except as expressly provided in this Agreement, neither the TSP nor the Nodal Agency nor their respective officers, directors, agents, employees or Affiliates (including, officers, directors, agents or employees of such Affiliates), shall be liable or responsible to the other Party or its Affiliates including its officers, directors, agents, employees, successors, insurers or permitted assigns for incidental, indirect or consequential, punitive or exemplary damages, connected

Sentral Transmission Utility of India Limited 52 WRNES Talegaon Power Transmission Limited



with or resulting from performance or non-performance of this Agreement, or anything done in connection herewith, including claims in the nature of lost revenues, income or profits (other than payments expressly required and properly due under this Agreement), any increased expense of, reduction in or loss of transmission capacity or equipment used therefore, irrespective of whether such claims are based upon breach of warranty, tort (including negligence, whether of the Nodal Agency, the TSP or others), strict liability, contract, breach of statutory duty, operation of law or otherwise.

14.5.2 The Nodal Agency shall have no recourse against any officer, director or shareholder of the TSP or any Affiliate of the TSP or any of its officers, directors or shareholders for such claims excluded under this Article. The TSP shall also have no recourse against any officer, director or shareholder of the Nodal Agency, or any Affiliate of the Nodal Agency or any of its officers, directors or shareholders for such claims excluded under this Article.

14.6 Duty to Mitigate

The party entitled to the benefit of an indemnity under this Article 14 shall take all reasonable measures to mitigate any loss or damage which has occurred. If the Party fails to take such measures, the other Party's liabilities shall be correspondingly reduced.

Central Transmission Utility of India Limited

53

WRNES Talegaon Power Transmission Limited

New Delhi





15 ASSIGNMENTS AND CHARGES

15.1 Assignments:

15.1.1 This Agreement shall be binding upon, and inure to the benefit of the Parties and their respective successors and permitted assigns. This Agreement shall not be assigned by any Party, except as provided in Article 15.3.

15.2 Permitted Charges:

- Neither Party shall create or permit to subsist any encumbrance over all or any of its rights and benefits under this Agreement.
- 15.2.2 However, the TSP may create any encumbrance over all or part of the receivables, or the Project Assets of the Project in favour of the Lenders or the Lenders' Representative on their behalf, as security for amounts payable under the Financing Agreements and any other amounts agreed by the Parties.

Provided that:

- the Lenders or the Lenders' Representative on their behalf shall have entered into the Financing Agreements and agreed in writing to the provisions of this Agreement; and
- ii. any encumbrance granted by the TSP in accordance with this Article 15.2.2 shall contain provisions pursuant to which the Lenders or the Lender's Representative on their behalf agrees unconditionally with the TSP to release from such encumbrances upon payment by the TSP to the Lenders of all amounts due under the Financing Agreements.

15.2.3 Article 15.2.1 does not apply to:

- a. liens arising by operation of law (or by an agreement evidencing the same)
 in the ordinary course of the TSP developing and operating the Project;
- b. pledges of goods, the related documents of title and / or other related documents, arising or created in the ordinary course of the TSP developing and operating the Project; or
- c. security arising out of retention of title provisions in relation to goods acquired in the ordinary course of the TSP developing and operating the Project.

Central Transmission Utility of India Limited





15.3 Substitution Rights of the Lenders

- 15.3.1 The TSP would need to operate and maintain the Project under the provisions of this Agreement and cannot assign the Transmission License or transfer the Project or part thereof to any person by sale, lease, exchange or otherwise, without the prior approval of the Nodal Agency.
- 15.3.2 However, in the case of default by the TSP in debt repayments or in the case of default by the TSP as per Article 13 of this Agreement during the debt repayments, the Commission may, on an application from the Lenders, assign the Transmission License to the nominee of the Lenders subject to the fulfilment of the qualification requirements and provisions of the Central Electricity Regulatory Commission (Procedure, terms and Conditions for grant of Transmission License and other related matters) Regulations, 2006 and as amended from time to time.

Central Transmission Utility of India Limited

55





16 GOVERNING LAW AND DISPUTE RESOLUTION

16.1 Governing Law:

This Agreement shall be governed by and construed in accordance with the Laws of India. Any legal proceedings in respect of any matters, claims or disputes under this Agreement shall be under the jurisdiction of appropriate courts in Delhi.

16.2 Amicable Settlement:

- 16.2.1 Either Party is entitled to raise any claim, dispute or difference of whatever nature arising under, out of or in connection with this Agreement, including its existence or validity or termination or whether during the execution of the Project or after its completion and whether prior to or after the abandonment of the Project or termination or breach of the Agreement by giving a written notice to the other Party, which shall contain:
 - (i) a description of the Dispute;
 - (ii) the grounds for such Dispute; and
 - (iii) all written material in support of its claim.
- 16.2.2 The other Party shall, within thirty (30) days of issue of notice issued under Article 16.2.1, furnish:
 - (i) counter-claim and defences, if any, regarding the Dispute; and
 - (ii) all written material in support of its defences and counter-claim.
- 16.2.3 Within thirty (30) days of issue of notice by the Party pursuant to Article 16.2.1, if the other Party does not furnish any counter claim or defense under Article 16.2.2, or thirty (30) days from the date of furnishing counter claims or defence by the other Party, both the Parties to the Dispute shall meet to settle such Dispute amicably. If the Parties fail to resolve the Dispute amicably within thirty (30) days from the later of the dates mentioned in this Article 16.2.3, the Dispute shall be referred for dispute resolution in accordance with Article 16.3.

16.3 Dispute Resolution:

All Disputes shall be adjudicated by the Commission.

56

16.4 Parties to Perform Obligations:

Notwithstanding the existence of any Dispute and difference referred to the Commission as provided in Article 16.3 and save as the Commission may otherwise direct by a final or interim order, the Parties hereto shall continue to perform their respective obligations/ roles (which are not in dispute) under this Agreement.

Central Transmission Utility of India Limited





17 REPRESENTATION AND WARRANTIES

17.1 Representation and warranties of the Nodal Agency

- 17.1.1 The Nodal Agency hereby represents and warrants to and agrees with the TSP as follows and acknowledges and confirms that the TSP is relying on such representations and warranties in connection with the transactions described in this Agreement:
 - a. It has all requisite powers and authority to execute and consummate this Agreement;
 - b. This Agreement is enforceable against the Nodal Agency in accordance with its terms;
 - c. The consummation of the transactions contemplated by this Agreement on the part of Nodal Agency will not violate any provision of nor constitute a default under, nor give rise to a power to cancel any charter, mortgage, deed of trust or lien, lease, agreement, license, permit, evidence of indebtedness, restriction, or other contract to which the Nodal Agency is a Party or to which the Nodal Agency is bound, which violation, default or power has not been waived;

17.2 Representation and Warranties of the TSP:

- 17.2.1 The TSP hereby represents and warrants to and agrees with the Nodal Agency as follows and acknowledges and confirms that the Nodal Agency is relying on such representations and warranties in connection with the transactions described in this Agreement:
 - a. It has all requisite powers and has been duly authorized to execute and consummate this Agreement;
 - This Agreement is enforceable against it, in accordance with its terms;
 - c. The consummation of the transactions contemplated by this Agreement on the part of the TSP will not violate any provision of nor constitute a default under, nor give rise to a power to cancel any charter, mortgage, deed of trust or lien, lease, agreement, license, permit, evidence of indebtedness, restriction, or other contract to which the TSP is a Party or to which the TSP is bound which violation, default or power has not been waived;
 - d. The TSP is not insolvent and no insolvency proceedings have been instituted, nor threatened or pending by or against the TSP;
 - e. There are no actions, suits, claims, proceedings or investigations pending or, to the best of the TSP's knowledge, threatened in writing against the TSP at law, in equity, or otherwise, and whether civil or criminal in nature, before

entral Transmission Utility of India Limited





Transmission Service Agreement

or by, any court, commission, arbitrator or governmental agency or authority, and there are no outstanding judgments, decrees or orders of any such courts, commission, arbitrator or governmental agencies or authorities, which materially adversely affect its ability to execute the Project or to comply with its obligations under this Agreement.

17.2.2 The TSP makes all the representations and warranties above to be valid as on the Effective Date of this Agreement.

Central Transmission Utility of India Limited







ARTICLE: 18

18 INDEPENDENT ENGINEER

18.1 Appointment of Independent Engineer

The Nodal Agency shall appoint an agency/ company as Independent Engineer as per framework provided in the Guidelines for Encouraging Competition in Development of Transmission Projects for selection of Independent Engineer.

18.2 Roles and functions of Independent Engineer

The role and functions of the Independent Engineer shall include the following:

- a. Progress Monitoring as required under this Agreement;
- b. Ensuring Quality as required under this Agreement;
- determining, as required under the Agreement, the costs of any works or services and/or their reasonableness during construction phase;
- d. determining, as required under the Agreement, the period or any extension thereof, for performing any duty or obligation during construction phase;
- e. determining, as required under the Agreement, the valuation of the Project Assets.
- f. Assisting the Parties in resolution of Disputes and
- g. Undertaking all other duties and functions in accordance with the Agreement.

18.3 Remuneration of Independent Engineer

The fee and charges of the Independent Engineer shall be paid by the Nodal Agency as per terms & conditions of appointment.

18.4 Termination of appointment

- 18.4.1 The Nodal Agency may, in its discretion, terminate the appointment of the Independent Engineer at any time, but only after appointment of another Independent Engineer.
- 18.4.2 If the TSP has reason to believe that the Independent Engineer is not discharging its duties and functions in a fair, efficient and diligent manner, it may make a written representation to the Nodal Agency and seek termination of the appointment of the Independent Engineer. Upon receipt of such representation, the Nodal Agency shall hold a tripartite meeting with the TSP and Independent Engineer for an amicable resolution, and the decision of Nodal agency is final. In the event that the appointment of the Independent Engineer is terminated hereunder, the Nodal Agency shall appoint forthwith another Independent Engineer.

New Delhi

Central Transmission Utility of India Limited 59 WRNES Talegaon Power Transmission Limited





18.5 Authorised signatories

The Nodal Agency shall require the Independent Engineer to designate and notify to the Nodal Agency up to 2 (two) persons employed in its firm to sign for and on behalf of the Independent Engineer, and any communication or document required to be signed by the Independent Engineer shall be valid and effective only if signed by any of the designated persons; provided that the Independent Engineer may, by notice in writing, substitute any of the designated persons by any of its employees.

Central Transmission Utility of India Limited

60







ARTICLE: 19

19 MISCELLANEOUS PROVISIONS

19.1 Equity Lock-in Commitment:

19.1.1 The aggregate equity share holding of the Selected Bidder in the issued and paid up equity share capital of WRNES Talegaon Power Transmission Limited shall not be less than Fifty-one percent (51%) up to a period of one (1) year after COD of the Project.

Provided that, in case the Lead Member or Bidding Company is holding equity through Affiliate/s, Ultimate Parent Company or Parent Company, such restriction as specified above shall apply to such entities.

Provided further, that in case the Selected Bidder is a Bidding Consortium, the Lead Member shall continue to hold equity of at least twenty-six percent (26%) upto a period of one (1) year after COD of the Project and any Member of such Bidding Consortium shall be allowed to divest its equity as long as the other remaining Members (which shall always include the Lead Member) hold the minimum equity specified above.

- 19.1.2 If equity is held by the Affiliates, Parent Company or Ultimate Parent Company of the Selected Bidder, then, subject to the second proviso to Article 19.1.1, such Affiliate, Parent Company or Ultimate Parent Company shall be eligible to transfer its shareholding in WRNES Talegaon Power Transmission Limited to another Affiliate or to the Parent Company / Ultimate Parent Company of the Selected Bidder. If any such shareholding entity, qualifying as an Affiliate / Parent Company / Ultimate Parent Company, is likely to cease to meet the criteria to qualify as an Affiliate / Parent Company / Ultimate Parent Company, the shares held by such entity shall be transferred to another Affiliate / Parent Company / Ultimate Parent Company of the Selected Bidder.
- 19.1.3 Subject to Article 19.1.1, all transfer(s) of shareholding WRNES Talegaon Power Transmission Limited by any of the entities referred to in Article 19.1.1 and 19.1.2 above, shall be after prior written intimation to the Nodal Agency.
- 19.1.4 For computation of effective Equity holding, the Equity holding of the Selected Bidder or its Ultimate Parent Company in such Affiliate(s) or Parent Company and the equity holding of such Affiliate(s) or Ultimate Parent Company in WRNES Talegaon Power Transmission Limited shall be computed in accordance with the example given below:

61

If the Parent Company or the Ultimate Parent Company of the Selected Bidder A directly holds thirty percent (30%) of the equity in WRNES Talegaon Power Transmission Limited, then holding of Selected Bidder A in WRNES Talegaon Power Transmission Limited shall be thirty percent (30%);

entral Transmission Utility of India Limited



If Selected Bidder A holds thirty percent (30%) equity of the Affiliate and the Affiliate holds fifty percent (50%) equity in WRNES Talegaon Power Transmission Limited, then, for the purposes of ascertaining the minimum equity/equity lock-in requirements specified above, the effective holding of Bidder A WRNES Talegaon Power Transmission Limited shall be fifteen percent (15%), (i.e., 30% x 50%)

- 19.1.5 The provisions as contained in this Article 19.1 shall override the terms of the consortium agreement submitted as part of the Bid.
- 19.1.6 The TSP shall be responsible to report to Nodal Agency, within thirty (30) days from the occurrence of any event that would result in any change in its equity holding structure from that which existed as on the date of signing of the Share Purchase Agreement. In such cases, the Nodal Agency would reserve the right to ascertain the equity holding structure and to call for all such required documents / information / clarifications as may be required.

19.2 **Commitment of maintaining Qualification Requirement**

- 19.2.1 The Selected Bidder will be required to continue to maintain compliance with the Qualification Requirements, as stipulated in RFP Document, till the COD of the Project. Where the Technically Evaluated Entity and/or the Financially Evaluated Entity is not the Bidding Company or a Member in a Bidding Consortium, as the case may be, the Bidding Company or Member shall continue to be an Affiliate of the Technically Evaluated Entity and/or Financially Evaluated Entity till the COD of the Project.
- 19.2.2 Failure to comply with the aforesaid provisions shall be dealt in the same manner as TSP's Event of Default as under Article 13 of this Agreement.


19.3 Language:

- 19.3.1 All agreements, correspondence and communications between the Parties relating to this Agreement and all other documentation to be prepared and supplied under the Agreement shall be written in English, and the Agreement shall be construed and interpreted in accordance with English language.
- 19.3.2 If any of the agreements, correspondence, communications or documents are prepared in any language other than English, the English translation of such agreements, correspondence, communications or documents shall prevail in matters of interpretation.

19.4 **Affirmation**

The TSP and the Nodal Agency, each affirm that:

1. neither it nor its respective directors, employees, or agents has paid or undertaken to pay or shall in the future pay any unlawful commission, bribe,





pay-off or kick-back; and

 it has not in any other manner paid any sums, whether in Indian currency or foreign currency and whether in India or abroad to the other Party to procure this Agreement, and the TSP and the Nodal Agency hereby undertake not to engage in any similar acts during the Term of Agreement.

19.5 Severability

The invalidity or enforceability, for any reason, of any part of this Agreement shall not prejudice or affect the validity or enforceability of the remainder of this Agreement, unless the part held invalid or unenforceable is fundamental to this Agreement.

19.6 Counterparts

This Agreement may be executed in one or more counterparts, each of which shall be deemed an original and all of which collectively shall be deemed one and the same Agreement.

19.7 Breach of Obligations/ Roles

The Parties acknowledge that a breach of any of the obligations/ roles contained herein would result in injuries. The Parties further acknowledge that the amount of the liquidated damages or the method of calculating the liquidated damages specified in this Agreement is a genuine and reasonable pre-estimate of the damages that may be suffered by the non-defaulting Party in each case specified under this Agreement.

19.8 Restriction of Shareholders / Owners Liability

- 19.8.1 Parties expressly agree and acknowledge that none of the shareholders of the Parties hereto shall be liable to the other Parties for any of the contractual obligations of the concerned Party under this Agreement.
- 19.8.2 Further, the financial liabilities of the shareholder(s) of each Party to this Agreement shall be restricted to the extent provided in the Indian Companies Act, 1956 / Companies Act, 2013 (as the case may be).

19.9 Taxes and Duties:

- 19.9.1 The TSP shall bear and promptly pay all statutory taxes, duties, levies and cess, assessed/levied on the TSP, its Contractors or their employees that are required to be paid by the TSP as per the Law in relation to the execution of the Project and for providing Transmission Service as per the terms of this Agreement.
- 19.9.2 The Nodal Agency shall be indemnified and held harmless by the TSP against any claims that may be made against the Nodal Agency in relation to the matters set out in Article 19.9.1.

63

Central Transmission Utility of India Limited







19.9.3 The Nodal Agency shall not be liable for any payment of, taxes, duties, levies, cess whatsoever for discharging any obligation of the TSP by the Nodal Agency on behalf of TSP or its personnel, provided the TSP has consented in writing to the Nodal Agency for such work, for which consent shall not be unreasonably withheld.

19.10 No Consequential or Indirect Losses

The liability of the TSP shall be limited to that explicitly provided in this Agreement.

Provided that, notwithstanding anything contained in this Agreement, under no event shall the Nodal Agency or the TSP claim from one another any indirect or consequential losses or damages.

19.11 Discretion:

Except where this Agreement expressly requires a Party to act fairly or reasonably, a Party may exercise any discretion given to it under this Agreement in any way it deems fit.

19.12 Confidentiality

- 19.12.1 The Parties undertake to hold in confidence this Agreement and RFP Project Documents and not to disclose the terms and conditions of the transaction contemplated hereby to third parties, except:
 - (a) to their professional advisors;
 - to their officers, contractors, employees, agents or representatives, financiers, who need to have access to such information for the proper performance of their activities; or
 - (c) disclosures required under Law,

without the prior written consent of the other Parties.

Provided that, the TSP agrees and acknowledges that the Nodal Agency, may, at any time, disclose the terms and conditions of the Agreement and the RFP Project Documents to any person, to the extent stipulated under the Law and the Competitive Bidding Guidelines.

19.13 Order of priority in application:

Save as provided in Article 2.5, in case of inconsistencies between the terms and conditions stipulated in Transmission License issued by the Commission to the TSP, agreement(s) executed between the Parties, applicable Law including rules and regulations framed thereunder, the order of priority as between them shall be the order in which they are placed below:

Central Transmission Utility of India Limited





- terms and conditions of Transmission License:
- · applicable Law, rules and regulations framed thereunder;
- this Agreement;
- Agreement(s), if any, under Sharing Regulations.

19.14 Independent Entity:

- 19.14.1 The TSP shall be an independent entity performing its obligations pursuant to the Agreement.
- 19.14.2 Subject to the provisions of the Agreement, the TSP shall be solely responsible for the manner in which its obligations under this Agreement are to be performed. All employees and representatives of the TSP or Contractors engaged by the TSP in connection with the performance of the Agreement shall be under the complete control of the TSP and shall not be deemed to be employees, representatives, Contractors of the Nodal Agency and nothing contained in the Agreement or in any agreement or contract awarded by the TSP shall be construed to create any contractual relationship between any such employees, representatives or Contractors and the Nodal Agency.

19.15 Amendments:

19.15.1 This Agreement may only be amended or supplemented by a written agreement between the Parties.

19.16 Waiver:

- 19.16.1 No waiver by either Party of any default or breach by the other Party in the performance of any of the provisions of this Agreement shall be effective unless in writing duly executed by an authorised representative of such Party.
- 19.16.2 Neither the failure by either Party to insist on any occasion upon the performance of the terms, conditions and provisions of this Agreement nor time or other indulgence granted by one Party to the other Parties shall act as a waiver of such breach or acceptance of any variation or the relinquishment of any such right or any other right under this Agreement, which shall remain in full force and effect.

19.17 Relationship of the Parties:

This Agreement shall not be interpreted or construed to create an association, joint venture, or partnership or agency or any such other relationship between the Parties or to impose any partnership obligation or liability upon either Party and neither Party shall have any right, power or authority to enter into any agreement or undertaking for, or act on behalf of, or to act as or be an agent or representative of, or to otherwise bind, the other Party.

65

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

New Delhi 110003



19.18 Entirety:

- 19.18.1 This Agreement along with its sections, schedules and appendices is intended by the Parties as the final expression of their agreement and is intended also as a complete and exclusive statement of the terms of their agreement.
- 19.18.2 Except as provided in this Agreement, all prior written or oral understandings, offers or other communications of every kind pertaining to this Agreement or the provision of Transmission Service under this Agreement to the Nodal Agency by the TSP shall stand superseded and abrogated.

19.19 Notices:

- 19.19.1 All notices or other communications which are required to be given under this Agreement shall be in writing and in the English language
- 19.19.2 If to the TSP, all notices or communications must be delivered personally or by registered post or facsimile or any other mode duly acknowledged to the addressee below: Adami Energy Solutions Limited

Address : 12th floor, Block-B, KP-Epitome, Makarba
Ahmedabad - 3800 53

Attention : Rahul Mathu (

Email : Rahul Mathur @ adani.com

Fax. No.

Telephone No.: +916359965956

19.19.3 If to the Nodal Agency, all notices or communications must be delivered personally or by registered post or facsimile or any other mode duly acknowledged to the addresses below:

(i) Central Transmission Utility of India Limited

Address : 5th to 10th Floor, IRCON International Tower,

Tower no-1, Plot no -16, Sector-32, Gurugram,

Haryana: 122003

Attention : Ramachandra, Sr GM Email : ramachand@powergrid.in

Fax. No. :

Telephone No.: : 9910378128

19.19.4 All notices or communications given by facsimile shall be confirmed by sending a copy of the same via post office in an envelope properly addressed to the appropriate Party for delivery by registered mail. All notices shall be deemed validly delivered upon receipt evidenced by an acknowledgement of the recipient, unless the Party delivering the notice can prove in case of delivery through the registered post that the recipient refused to acknowledge the

Central Transmission Utility of India Limited 66 WRNES Talegaon Power Transmission Limited







receipt of the notice despite efforts of the postal authorities.

19.19.5 Any Party may by notice of at least fifteen (15) days to the other Party change the address and/or addresses to which such notices and communications to it are to be delivered or mailed.

19.20 Fraudulent and Corrupt Practices

- 19.20.1 The TSP and its respective officers, employees, agents and advisers shall observe the highest standard of ethics during the subsistence of this Agreement. Notwithstanding anything to the contrary contained in the Agreement, the Nodal Agency may terminate the Agreement without being liable in any manner whatsoever to the TSP, if it determines that the TSP has, directly or indirectly or through an agent, engaged in corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice in the Bid process. In such an event, the Nodal Agency shall forfeit the Contract Performance Guarantee of the TSP, without prejudice to any other right or remedy that may be available to the Nodal Agency hereunder or subsistence otherwise.
- 19.20.2 Without prejudice to the rights of the Nodal Agency under Clause 19.20.1 hereinabove and the rights and remedies which the Nodal Agency may have under this Agreement, if a TSP is found by the Nodal Agency to have directly or indirectly or through an agent, engaged or indulged in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice during the Bid process, or after the issue of Letter of Intent (hereinafter referred to as LoI) or after the execution of the agreement(s) required under Sharing Regulations, the Nodal Agency may terminate the Agreement without being liable in any manner whatsoever to the TSP. Further, the TSP & its Affiliates shall not be eligible to participate in any tender or RFP issued by any BPC for an indefinite period from the date such TSP is found by the Nodal Agency to have directly or indirectly or through an agent, engaged or indulged in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practices, as the case may be.
- 19.20.3 For the purposes of this Clause 19.20, the following terms shall have the meaning hereinafter respectively assigned to them:
 - (a) "corrupt practice" means (i) the offering, giving, receiving, or soliciting, directly or indirectly, of anything of value to influence the actions of any person connected with the Bid process (for avoidance of doubt, offering of employment to or employing or engaging in any manner whatsoever, directly or indirectly, any official of the BPC who is or has been associated or dealt in any manner, directly or indirectly with the Bid process or the LoI or has dealt with matters concerning the RFP Project Documents or arising there from, before or after the execution thereof, at any time prior to the expiry of one year from the date such official resigns or retires from or otherwise ceases to be in the service of the BPC, shall be deemed to constitute influencing the actions of a person connected with the Bid Process); or (ii) engaging in any manner whatsoever, whether during the

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

New Delhi





Bid Process or after the issue of the LoI or after the execution of the RFP Project Documents, as the case may be, any person in respect of any matter relating to the Project or the LoI or the RFP Project Documents, who at any time has been or is a legal, financial or technical adviser of the BPC in relation to any matter concerning the Project;

- (b)"fraudulent practice" means a misrepresentation or omission of facts or suppression of facts or disclosure of incomplete facts, in order to influence the Bid process;
- (c) "coercive practice" means impairing or harming, or threatening to impair or harm, directly or indirectly, any person or property to influence any person's participation or action in the Bid process;
- (d) "undesirable practice" means (i) establishing contact with any person connected with or employed or engaged by the BPC with the objective of canvassing, lobbying or in any manner influencing or attempting to influence the Bid process; or (ii) having a Conflict of Interest; and
- (e) "restrictive practice" means forming a cartel or arriving at any understanding or arrangement among Bidders with the objective of restricting or manipulating a full and fair competition in the Bid process;

19.21 Compliance with Law:

Despite anything contained in this Agreement but without prejudice to Article 12, if any provision of this Agreement shall be in deviation or inconsistent with or repugnant to the provisions contained in the Electricity Act, 2003, or any rules and regulations made there under, such provision shall be deemed to be amended to the extent required to bring it into compliance with the aforesaid relevant provisions as amended from time to time.

Central Transmission Utility of India Limited

68







IN WITNESS WHEREOF, THE PARTIES HAVE CAUSED THIS AGREEMENT TO BE EXECUTED BY THEIR DULY AUTHORISED REPRESENTATIVES AS OF THE DATE AND PLACE SET FORTH ABOVE.

For and on behalf of TSP

		Cay!
		[Signature, Name, Designation and Address]
		Sanjay A. Johari
		Vice-President
,	2.	For and on behalf of
		about Juic An
		KAMAL KUMAR JAIN
		[Signature, Name, Designation and Address]
		CHATRAL TRANSMISSION UTILITY OF INDIA LIMITED (আৰু মিল ফার্টারের রাজ বুলিরা নিনিব্র কী বুলা খরনিক জাবনী) (A wholly owned subsidiary of POWERGRID) 35-18h Pine, Iron International Town-1, Fiol No-16,clor3, Gungam-(2003
WITN	ESSES:	
1.	For and on behalf of	
	: BPC	Rois
		[Signature]
		Aroiel Mierra's Possla, Chief Marrage
		RECPOCL, Glessigram
	[Insert	, Name, Designation and Address of the Witness]
2.	For and on behalf of	
	: Nodal Agency	[Signature]
	[Insert	Name, Designation and Address of the Witness
		, and the state of the vittless

Central Transmission Utility of India Limited

1.







SCHEDULES

Central Transmission Utility of India Limited







Schedule: 1

Project Description and Scope of Project

Scope of the Project:

Sl. No.	Scope of the Transmission Scheme	Scheduled COD in months from Effective Date	
1	Establishment 2x1500 MVA, 765/400 kV Substation near South of Kalamb with 2x330 MVAr, 765 kV bus reactor and 2x125 MVAr, 420 kV bus reactor • 765/400 kV, 1500 MVA ICT – 2 Nos. (7x500 MVA single phase units including one spare ICT Unit) • 765 kV ICT bays – 2 Nos. • 400 kV ICT bays – 2 Nos. • 765 kV Line bays – 4 Nos. • 330 MVAr, 765 kV Bus Reactor- 2 Nos. (7x110 MVAr single phase Reactors including one spare Unit for bus /line reactor) • 765 kV Bus reactor bay – 2 Nos. • 125 MVAr, 420 kV Reactor- 2 Nos. • 400 kV Reactor bay- 2 Nos. • 400 kV line bays - 2 Nos. (for interconnection of PSP)	01.01.2028	
	Future provision (space for):		
	 765/400 kV ICT along with bays- 10 Nos. (2 Nos. on Sec-I, 4 Nos. in Sec-II and 4 Nos. on Sec-III) 765 kV line bays along with switchable line reactors – 6 Nos. (4 Nos. on Sec-II and 2 Nos. on Sec-III) 765 kV Bus Reactor along with bay: 4 Nos. (2 Nos. on Sec-II and 2 No. on Sec-III) 765 kV Sectionaliser: 2 -sets 400 kV line bays along with switchable line reactors— 20 Nos. (6 Nos. on Sec-I, 6 Nos. on Sec-II and 8 Nos. on Sec-III) 400/220 kV ICT along with bays -4 Nos. (on 400 kV: Sec-III, 2 Nos. on 220 kV Sec-I and 2 Nos. on 220 kV Sec-II) 400 kV Bus Reactor along with bays: 4 Nos. (2 Nos. on Sec-II and 2 No. on Sec-III) 		

Central Transmission Utility of India Limited







Sl. No.	Scope of the Transmission Scheme	Scheduled COD in months from Effective Date
	 220 kV line bays: 8 Nos. (4 Nos. on Sec-I and 4 Nos. on Sec-II) 220 kV Sectionalization bay: 1 set 220 kV BC and TBC: 2 Nos. Establishment of 6000 MW, ± 800 kV South Kalamb (HVDC) [LCC] terminal station (4x1500 MW) along with associated interconnections with 400 kV HVAC Switchyard (2x1500 MW on 400 kV Sec-II) and all associated equipment (incl. filters)/bus extension, etc. 	
2	LILO of Pune-III – Boisar-II 765 kV D/C line at South Kalamb S/s with associated bays at South Kalamb S/s (The Pune-III – Boisar-II 765 kV D/C line is of Hexa Zebra configuration and LILO shall be of similar conductor configuration)	
3	Installation of 1x240 MVAr switchable line reactor on each ckt at South Kalamb end of Boisar-II — South Kalamb 765 kV D/C line (formed after above LILO) 1x240 MVAr, 765 kV switchable line reactor — 2 Nos. Switching equipment for 765 kV line reactor — 2 Nos. Spare Reactor (1-ph, 1x80 MVAr) unit at 765/400 kV South Kalamb S/s	

Project Description

Tata Power Company Limited has applied connectivity for Bhivpuri (1150 MW) PSP located at Bhivpuri, Raigad, Maharashtra and in-principle has been granted for the same by CTUIL. Further, Tata Power Company Limited is also planning Shirawata PSP of 1980MW in the same area.

Hence, a new substation in vicinity of Kalamb (nearby Mumbai) has been planned to cater to the Pumped storage potential envisaged nearby area. The substation shall also have sufficient space for feeding local demand of Mumbai/Ambernath area. The matter was discussed in a meeting held on 15.12.2023 amongst CEA, CTU, GRID-INDIA, MSETCL and TATA POWER as well as in the 24th CMETS-WR meeting held on 28.12.2023 wherein it

Central Transmission Utility of India Limited







was decided that the substation may be located at a suitable location in South of Kalamb so that it is located in vicinity of Neral (where 400 kV Padghe – Nagthane D/C, 400 kV Talegaon – Kharghar line and 400 kV Talegaon – Kalwa line are crossing), near TPC's PSPs as well as other upcoming PSPs north of Murbad (like Malshejghat PSP (1500MW) (AGEL) and Kengadi (1550MW), Jalond (2400MW) and Kalu (1150MW) PSPs of NHPC).

The subject scheme shall cater to evacuation of 1.5 GW PSP potential near Talegaon (Pune) through the establishment of 2x1500 MVA, 765/400 kV Substation near South of Kalamb and LILO of Pune-III – Boisar-II 765 kV D/C line at South Kalamb S/s.

The subject Transmission system was deliberated and approved in the 20th NCT meeting held on 25.06.2024. Ministry of Power vide Gazette notification dated 21.08.2024 has appointed RECPDCL as BPC for implementation of the subject transmission scheme through TBCB route with an implementation schedule of 01.01.2027 subject to minimum 24 months from the SPV transfer. Further the implementation schedule has been amended to 01.01.2028.

Central Transmission Utility of India Limited



73

SPECIFIC TECHNICAL REQUIREMENTS FOR TRANSMISSION LINE

The design, routing and construction of transmission lines shall be in accordance with Chapter V, Part A of CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022, as amended from time to time. Other CEA Regulations/guidelines as amended up to date and MoP guidelines, as applicable, shall also be followed.

- A.1.0 Selection of tower type shall be made as per CEA Regulations, however, in case lattice type towers are used, the following shall also be applicable:
- A.2.0 Steel section of grade E 250 and/or grade E 350 as per IS 2062, only are permitted for use in towers, extensions, gantry structures and stub setting templates. For towers in snowbound areas, steel sections shall conform to Grade-C of IS-2062.
- A.3.0 Towers shall be designed as per IS-802:2015, however the drag coefficient of the tower shall be as follows: -

Solidity Ratio	Drag Coefficient	
Up to 0.05	3.6	
0.1	3.4	
0.2	2.9	
0.3	2.5	
0.4	2.2	
0.5 and above	2.0	

- A.4.0 Transmission Service Provider (TSP) shall adopt any additional loading/ design criteria for ensuring the reliability of the line, if so desired and /or deemed necessary.
- A.5.0 Transmission line shall be designed considering wind zones as specified in the wind map given in National Building Code 2016, Vol.1. The developer shall also make his own assessment of local wind conditions and frequent occurrences of High Intensity Winds (HIW) due to thunderstorms, dust storms, downburst etc. along the line route and wherever required, higher wind zone than that given in wind map shall be considered for tower design for ensuring the reliability of the line. Further, for transmission line sections passing within a distance of 50 km from the boundary of two wind zones, the higher of the two wind zones shall be considered for design of towers located in such sections.
- A.6.0 Selection of reliability level for design of tower shall be as per CEA Regulation (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022, as amended from time to time.
- A.7.0 (A) Under crossing of the existing transmission line of same Voltage shall not be allowed. In the case where it is inevitable to under-cross the existing transmission line then TSP shall seek prior approval from Chief Electrical Inspector, CEA with detailed study ensuring that all statutory electrical clearances and Electric Field limit of 10 kV/m at 1 m and 1.8 m from ground level is not violated.

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

Now Delhi 110003





- (B) For power line crossing of 400 kV or above voltage level large angle and dead end towers (i.e. D/DD/QD) shall be used on either side of power line crossing.
- (C) For power line crossing of 132 kV and 220 kV (or 230 kV) voltage level, angle towers (B/C/D/DB/DC/DD/QB/QC/QD) shall be used on either side of power line crossing depending upon the merit of the prevailing site condition and line deviation requirement.
- (D) For power line crossing of 66 kV and below voltage level, suspension/tension towers shall be provided on either side of power line crossing depending upon the merit of the prevailing site condition and line deviation requirement.
- (E) For crossing of railways tracks, national highways and state highways, the rules/ regulations of appropriate authorities shall be followed.
- A.8.0 The relevant conductor configuration shall be as follows: -
 - (i) LILO of Pune-III Boisar-II 765 kV D/C line at South Kalamb S/s (Existing Conductor Configuration- Hexa Zebra)

Type of conductor: ACSR / AAAC / AL59


Basic Parameters:

Transmission Line	ACSR Conductor specified	Equivalent AAAC conductor based on 53.5% conductivity of Al Alloy	Equivalent minimum size of AL59 conductor based on 59% conductivity of Al Alloy*	
765 kV D/C	Zebra :	Stranding	Stranding	
(Hexa Bundle)	Stranding	Details:	Details:	
Transmission	54/3.18 mm-Al	61/3.19 mm,	61/3.08 mm,	
Lines	+ 7/3.18 mm-			
	Steel, 428 mm ² ,	487.5 mm ²	454 mm ²	457 mm
	Aluminium area,	Aluminium alloy	Aluminium alloy	
		area	area	
	28.62 mm	28.71 mm	27.72 mm	
	diameter	diameter	diameter	
	Maximum DC	Maximum DC	Maximum DC	
	Resistance at	Resistance at	Resistance at	
	20°C (Ω/km):	20°C (Ω/km):	20°C (Ω/km):	
	0.06868	0.06815	0.0653	
	Minimum UTS:	Minimum UTS:	Minimum UTS:	
	130.32 kN	135.6 kN	108 kN	

Note:

*To select any size above the minimum, the sizes mentioned in the Indian

Central Transmission Utility of India Limited







standard IS-398 (part-6) shall be followed.

- 2. The transmission lines shall have to be designed for a maximum operating conductor temperature of 85 °C.
- A.9.0 The required phase to phase spacing and horizontal spacing for 765 kV line shall be governed by the tower design as well as minimum live metal clearances for 765 kV voltage level under different insulator swing angles. However, the phase to phase spacing for 765 kV line shall not be less than 15 m.
- A.10.0 All electrical clearances including minimum live metal clearance, ground clearance and minimum mid span separation between earth wire and conductor as given below shall be considered:
 - I. Minimum live metal clearances for 765 kV line:
 - (a) (i) <u>Under stationary conditions</u>

From tower body:

For 765 kV D/C: 6.1 m

For 765 kV S/C: 5.6 m

(ii) Under swing conditions

Wind Pressure Condition		Minimum Electrical Clearance
(a)	Swing angle (25º)	4.4 m
(b)	Swing angle (55º)	1.3 m

- (b) Minimum ground clearance for 765 kV line: 18 m
- (c) Minimum mid span separation between earth-wire and conductor for 765 kV line: 9.0 m
- A.11.0 Shielding angle shall not exceed 10 deg for 765 kV D/C transmission line.
- A.12.0 The Fault current for design of line shall be 50 kA for 1 sec for 765 kV.
- A.13.0 In case of 400 kV and above voltage class lines, at least one out of two earth wires shall be OPGW and second earth wire, if not OPGW, shall be either of Galvanized Stranded Steel (GSS) or Aluminum Alloy Conductor Steel Reinforced (AACSR) conductor type or any other suitable conductor type depending upon span length and other technical consideration.
- A.14.0 Each tower shall be earthed such that tower footing impedance does not exceed 10 ohms. Pipe type or Counterpoise type earthing shall be provided in accordance with relevant IS. Additional earthing shall be provided on every 7 to 8 km distance for direct earthing of both shield wires. If site condition demands, multiple earthing or use of earthing enhancement compound shall be used.
- A.15.0 Pile type foundation shall be used for towers located in river or creek bed or on bank of river having scourable strata or in areas where river flow or change in river course is anticipated, based on detailed soil investigation and previous years' maximum flood discharge of the river, maximum velocity of water, highest flood level, scour depth and anticipated change in course of river based on river morphology data of at least past 20 years to ensure availability and reliability of the transmission line.

Central Transmission Utility of India Limited 76





- A.16.0 Transmission line route shall be finalized, in consultation with appropriate authorities so as to avoid the habitant zones of endangered species and other protected species. Bird diverters, wherever required, shall be provided on the line. In order to optimize the route, use of GATISHAKTI platform shall also be made.
- A.17.0 Wherever, transmission lines are passing through cyclone prone areas i.e., areas up to 60 km from coast following shall also be applicable:
 - a) Terrain category-I, with terrain roughness factor (K2) of 1.08 shall be considered for tower design for exposed open terrain with few or no obstruction, which also includes open sea coasts, open stretch of water, desert and flat treeless plains.
 - b) Importance factor for cyclonic region (K4) of 1.3 shall be considered for tower design.
 - c) The number of consecutive spans between the section points/ angle point shall not exceed 10 spans or 3 km instead of conventional practice of 15 spans or 5 km, in order to reduce the failure of such towers in coastal areas due to cascading effect. The section shall be terminated with tension tower/ angle tower and angle of deviation should be based on the site requirement.
- A.18.0 Wherever, transmission lines are passing through cyclone prone areas (i.e. areas up to 60 km from coast)/ creek regions/ aggressive soil areas following shall also be applicable:
 - The fabricated tower parts and stubs shall have a minimum overall zinc coating of 900 g/m² of surface area except for plates and sections below 5 mm which shall have a minimum overall zinc coating of 610 g/m² of surface area. The average zinc coating for all sections and plates 5 mm and above shall be maintained as 127 microns and that for plates and sections below 5 mm shall be maintained as 87 microns.
 - b) Ready mix concrete of M30 Grade shall be used to avoid use of locally available saline water. However, design mix concrete of M30 Grade conforming to IS 456 with potable water can be used at locations where transportation of ready-mix concrete is not feasible. Minimum cement content in any case shall not be less than 330 kg/m³.
 - c) The surface of the reinforced steel shall be treated with epoxy-based coating to enhance corrosion performance of foundation. Use of epoxy coated reinforcement in foundation shall be as per IS 13620. In addition, two (2) coats of bituminous painting of minimum 1.6 kg/m² per coat shall be applied on all exposed faces of foundation (i.e. pedestal and base slab).
 - d) Double coat 20 mm thick cement plaster shall be provided on all exposed concrete surface as well up to 300 mm below ground level to give protection to concrete surface from environmental and saline effect.
 - e) Before coping of chimney top portion, three coats of anti-corrosive paint of minimum 30-35 microns dry film thickness each shall be applied on the stub in the 50 mm coping portion as well as up to 350 mm above CL portion.
- A.19.0 The raised chimney foundation is to be provided in areas prone to flooding/water stagnation like paddy field /agricultural field and undulated areas to avoid direct contact

Central Transmission Utility of India Limited







of water with steel part of tower. The top of the chimney of foundation should be at least above HFL (High Flood Level) or the historical water stagnation/ logging level (based on locally available data) or above High Tide Level or 500 mm above Natural Ground level (whichever is higher).

- A.20.0 Routing of transmission line through protected areas of India shall be avoided to the extent possible. In case, it is not possible to avoid protected areas, the towers of the transmission line up to 400 kV level, which are installed in protected areas shall be designed for Multi-circuit (4 circuits) configuration of same voltage level considering reliability level of at least two (2). The top two circuits of these multi-circuit towers shall be used for stringing of the transmission line under present scope and the bottom two circuits shall be made available for stringing of any future transmission line of any transmission service providers/ State Transmission Utilities/Central Transmission Utilities passing through the same protected area. Further, the configuration and coordinates of such transmission towers shall be submitted to CEA, CTU and BPC by the TSP.
- A.21.0 The TSP shall abide by the Guidelines of CEA w.r.t. shifting of transmission lines for NHAI projects and other projects.
- A.22.0 Safety precautions in regard to gas/oil pipelines in vicinity of Transmission lines shall be taken in coordination with gas/ petroleum authorities.
- A.23.0 The stringing of the transmission line in forest area shall be carried out through drone.
- A.24.0 RoW width and Span in different terrain shall be as per Schedule VII of CEA (Technical Standards for Construction of Electrical plants and Electric Lines) Regulations 2022 and RoW guidelines issued vide CEA-PS-14-86/2/2019-PSETD Division dated 24.09.2024.

Central Transmission Utility of India Limited



78



SPECIFIC TECHNICAL REQUIREMENTS FOR SUBSTATION

The proposed **South Kalamb** substation shall be conventional Air Insulated Switchgear (AIS) type conforming to the requirements of CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022, as amended from time to time.

Other CEA Regulations/guidelines as amended up to date and MoP guidelines, as applicable, shall also be followed.

B.1.0 Salient features of Substation Equipment and Facilities

The design and specification of substation equipment are to be governed by the following factors:

B.1.1 Insulation Coordination

The system design parameters for substations/switchyards shall be as given below:

SI. No.	Description of parameters	765/400 kV South Kalamb S/s (AIS)		
		765 kV	400 kV	
		System	System	
1.	System Operating Voltage	765 kV	400 kV	
2.	Maximum voltage of the system (rms)	800 kV	420 kV	
3.	Rated Frequency	50 Hz	50 Hz	
4.	No. of Phases	3	3	
5.	Rated Insulation Levels			
i)	Lightning Impulse withstand voltage for (1.2/50 micro sec.) - for Equipment other than Transformer and Reactor	2100 kVp	1425 kVp	
	- for Insulator String	2100 kVp	1550 kVp	
ii)	Switching Impulse withstand voltage (250/2500 micro sec.) dry and wet	1550 kVp	1050 kVp	
iii)	One minute power frequency dry withstand voltage (rms)	830 kV	630 kV	
6.	Corona Extinction Voltage	508 kV	320 kV	

Central Transmission Utility of India Limited







SI. No.	Description of parameters	765/400 kV South Kalamb S/s (AIS)	
		765 kV System	400 kV System
7.	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz	2500 micro-volts at 508 kV rms	1000 micro-volts at 266 kV rms
8.	Minimum creepage distance for insulator string/longrod insulators/outdoor bushings	24800 mm (31 mm/kV)	13020 mm (31 mm/kV)
9.	Minimum creepage distance for switchyard equipment	20000 mm (25 mm/kV)	10500 mm (25 mm/kV)
10.	Max. Fault Current	50 kA	63 kA
11.	Duration of fault	1 sec	1 sec

B.1.2 Switching Scheme

The switching schemes, as mentioned below, shall be adopted at various voltage levels of substation/switchyard:

Substation	765 kV side	400 kV side
765/400 kV South Kalamb S/s (AIS)	One and Half breaker	One and Half breaker

Notes: -

- For one and half breaker switching scheme, any double circuit line consisting of two numbers of feeders and originating from the same transmission or generating switchyard shall not be terminated in one diameter.
- ii) Two transformers of same HV rating shall not be connected in the same diameter and similarly two bus reactors of same HV rating shall also not be connected in the same diameter.
- iii) A diameter in one and half breaker scheme is a set of 3 circuit breakers with associated isolators, earth switches, current transformers etc. for controlling 2 (two) numbers of feeders.
- iv) Connection arrangement of Switchable Line reactors shall be such that it can be used as Line reactor as well as Bus reactor with suitable NGR bypass arrangement. Further, Spare 1-phase Shunt Reactor unit along with required 1-phase circuit breaker shall be placed and connected in such a way that the spare unit can be utilized for all the bus and switchable line reactor banks (including future reactor banks) without its physical movement.

Central Transmission Utility of India Limited 80 WRNES Talegaon Power Transmission Limited





v) Space for 765 kV and 400 kV future line bays shall be kept considering provision of switchable line reactors.

vi) Provision for Bus Sectionalizer:

Space for One (1) set of future bus sectionalizer for 765 kV shall comprise Two (2) Nos. of bus sectionalizer bays with associated Circuit Breakers, Isolators and Current Transformers for both buses.

Space for One (1) set of future bus sectionalizer for 400 kV shall comprise Two (2) Nos. of bus sectionalizer bays with associated Circuit Breakers, Isolators and Current Transformers for both buses.

Space for One (1) set of bus sectionalizer for 220 kV shall comprise Two (2) Nos. of bus sectionalizer bays with associated Circuit Breakers, Isolators and Current Transformers for both buses.

- vii) TSP shall plan distribution of line and transformer feeders to bus bar in such a way that all power can be evacuated successfully without crossing thermal limit at any point of bus-bar.
- viii) For AIS type substation, TSP shall keep space provisions for future elements such that interconnection arrangement to the corresponding future bays can be done with overhead AIS type connection without any cable/ GIS duct.

ix) 765/400 kV South Kalamb S/s:

765 kV bay configurations (one and half breaker scheme) shall be as follows:

Configuration	Numbers
ICT-Tie-Bus Reactor	1 (one)
ICT- Tie- Line	1 (one)
Bus Reactor- Tie- Line	1 (one)
Future ICT-Tie-Line	2 (two)

400 kV bay configurations (one and half breaker scheme) shall be as follows:

Configuration	Numbers
ICT (400 kV side of 765/400 kV ICT)- Tie- Bus Reactor	1 (one)
ICT (400 kV side of 765/400 kV ICT)- Tie- Line	1 (one)
Bus Reactor - Tie- Line	1 (one)

x) 765/400 kV South Kalamb S/s:

(i) 765 kV Bus Sectionalization shall be with the following feeder distribution.

Central Transmission Utility of India Limited







7	65 kV Bus Section-1	765 kV Bus Section-2 (Future)		765 kV Bus Section-3 (Future)	
a)	4 Nos. of present 765 kV Line	a) 4 Nos. of future 765 kV line along with	a)	2 Nos. of future 765 kV line along with	
b)	2 Nos. of present 765/400 kV ICT	switchable line reactor b) 4 Nos. of future 765/400		switchable line reactor	
c)	2 Nos. of present 765 kV Bus Reactor	kV ICT c) 2 Nos. of future 765 kV	b)	4 Nos. of future 765/400 kV ICT	
d)	2 Nos. of future 765/400 kV ICT	Bus Reactor	c)	2 Nos. of future 765 kV Bus Reactor	

(ii) 400 kV Bus Sectionalization shall be with the following feeder distribution.

400 kV Bus Section-1	400 kV Bus Section-2 (Future)	400 kV Bus Section-3 (Future)
a) 2 Nos. of present 765/400 kV ICT b) 2 Nos. of present 400 kV Lines c) 2 Nos. of present 400 kV Bus Reactor d) 2 Nos. of Future 765/400 kV ICT e) 6 Nos. of Future 400 kV Lines f) 2 Nos. for interconnections for (2x1500 MW) for 6000 MW, ± 800 kV South Kalamb (HVDC) [LCC] terminal station	a) 4 Nos. of Future 765/400 kV ICT b) 6 Nos. of Future 400 kV Lines c) 2 Nos. of Future 400 kV Bus Reactor d) 2 Nos. for interconnections for (2x1500 MW) for 6000 MW, ± 800 kV South Kalamb (HVDC) [LCC] terminal station	a) 4 Nos. of Future 765/400 kV ICT b) 8 Nos. of Future 400 kV Lines c) 4 Nos. of Future 400/220 kV ICT d) 2 Nos. of Future 400 kV Bus Reactor

(iii) 220 kV Bus Sectionalization shall be with the following feeder distribution.

220 kV Bus Section-1 (Future)	220 kV Bus Section-2 (Future)	
a) 02 Nos. future 400/220 kV ICT.	a) 02 Nos. future 400/220 kV ICT.	
b) 04 Nos. future 220 kV Line.	b) 04 Nos. future 220 kV Line.	

B.2.0 Substation Equipment and Facilities (Voltage level as applicable):

The switchgear shall be designed and specified to withstand operating conditions and duty requirements. All equipment shall be designed considering the following capacity.

SI.No Description of bay 765/400 kV South Kalamb S/s
--

Central Transmission Utility of India Limited







		765 kV	400 kV 4000 A	
1.	Bus Bar	4000 A		
2.	Line bay	3150 A	3150 A	
3.	ICT bay	3150 A	3150 A	
4.	Reactor bay	3150 A	3150 A	

B.2.1 $(765/\sqrt{3})/(400/\sqrt{3})/33$ kV, Single Phase Autotransformer

500 MVA, $(765/\sqrt{3})/(400/\sqrt{3})/33$ kV, 1-phase Autotransformer (including arrangement for 3-phase bank formation of 1500 MVA) shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA's website.

Spare 1-phase Transformer unit shall be placed and connected in such a way that the spare unit can be utilized to replace any unit of any of the transformer banks (including for future transformer banks) without physically moving it.

B.2.2 (765/√3) kV, Single Phase Shunt Reactor

80 MVAr and 110 MVAr, 765/ $\sqrt{3}$ kV, 1-Phase Reactor (including arrangement for 3-phase bank formation of 240 MVAr and 330 MVAr, respectively) shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.

Spare 1-phase Shunt Reactor unit shall be placed and connected in such a way that the spare unit can be utilized for all the bus and **switchable** line reactor banks (including for future reactor banks) without its physical movement.

Neutral Grounding Reactor and Surge Arrester for 765 kV Switchable Line Reactors (as applicable):

The neutral of the switchable line reactors (wherever provided) shall be grounded through adequately rated Neutral Grounding Reactors (NGR) to facilitate single phase auto-reclosure, provided that the NGR shall be provided with suitable bypass arrangement so that the switchable line reactor can be used as bus reactor as and when required. The neutral of bus reactor shall be solidly grounded.

NGR shall be oil filled or dry type air core for outdoor application. NGR shall conform to CEA's "Standard Specifications and Technical Parameters of Transformers and Reactors (66 kV and above Voltage Class)", as amended up to date. Technical parameters of NGR shall be as specified in Annexure-A of above-mentioned document.

The surge arresters (rated voltage of arrester in co-ordination with ohmic value of NGR shall be decided by the TSP) shall be provided and physically located between the neutral of shunt reactor (brought out at 145 kV class bushing) and neutral grounding reactor. The surge arresters shall be of Station Medium (SM) class duty gapless Metal Oxide (ZnO) type conforming in general to IEC-60099-4. The Surge Arresters shall be hermetically sealed units, of self-supporting construction, suitable for mounting on structures.

Central Transmission Utility of India Limited







The Ohmic value of NGR for Line Reactors shall be as follows:

SI. No.	Line Name	Substation Name	NGR value (Ohm)
1.	Installation of 1x240 MVAr switchable line reactor on each ckt of Boisar-II — South Kalamb 765 kV D/C line at South Kalamb end (formed after LILO of Pune-III — Boisar-II 765 kV D/C line at South Kalamb S/s-)	South Kalamb S/s	500

B.2.3 420 kV, 3-Phase, Shunt Reactor

125 MVAr, 420 kV, 3-Phase Reactor shall conform to CEA's "Standard Specifications and Technical Parameters for Transformers and Reactors (66 kV and above voltage class)" as amended up to date available on CEA website.

B.2.4 765 kV and 400 kV AIS Substation equipment (as applicable)

B.2.4.1 Circuit Breakers (AIS)

The circuit breakers and accessories shall conform with IEC: 62271-100, IEC: 62271-1 and shall be of SF₆ Type. The circuit breakers shall be of class C2-M2 (as per IEC) with regard to restrike probability during capacitive current breaking and mechanical endurance. The rated break time shall not exceed 40 ms for 765 kV and 400 kV circuit breakers. The 765 kV and 400 kV circuit breakers shall be provided with single phase and three phase auto reclosing. Each breaker would have two sets of trip circuits, which would be connected to separate DC supplies for greater reliability. The circuit breakers controlling 765 kV lines shall be provided with pre-insertion closing resistor of about 450 ohm maximum with 9 ms insertion time or Controlled Switching Device. The circuit breakers controlling 400 kV lines shall be provided with pre insertion closing resistor of about 400 ohm with 8 ms insertion time or Controlled Switching Device (CSD) for lines longer than 200 km length. The short line fault capacity shall be same as the rated capacity and this is proposed to achieve without use of opening resistors. The controlled switching device shall be provided in circuit breakers of switchable line reactor bay and in Main and Tie bay circuit breakers of line with non-switchable line reactors, bus reactors and Transformers of voltage class 400 kV and above.

B.2.4.2 Isolators (AIS)

The isolators shall comply with IEC 62271-102 in general. 765 kV Isolator design shall be double break or vertical break or knee-type. 400 kV isolators shall be double break type. All isolators and earth switches shall be motor operated. Earth switches shall be provided at various locations to facilitate maintenance. Isolator shall be of extended mechanical endurance class – M2 as per IEC-62271-102. Main blades and earth blades

Central Transmission Utility of India Limited

34 WRNES Talegaon Power Transmission Limited

New Delhi 110003





shall be interlocked and interlock shall be fail safe type. The 765 kV and 400 kV earth switch for the line isolator shall be suitable for induced current switching duty as defined for Class-B.

B.2.4.3 Current Transformers (AIS)

Current Transformers shall comply with IEC 61869 in general. All ratios shall be obtained by secondary taps only. Generally, Current Transformers (CT) for 765 kV and 400 kV shall have six cores (four for protection and two for metering). The burden and knee point voltage shall be in accordance with the requirements of the system including possible feeds for telemetry. The accuracy class for the protection core shall be PX and for the metering core it shall be 0.2S. The rated burden of cores shall be closer to the maximum burden requirement of the metering and protection system (not more than 20 VA for metering core) for better sensitivity and accuracy. The instrument security factor shall be less than five (5) for CTs up to 400 kV and less than ten (10) for CTs of 765 kV voltage class.

B.2.4.4 Capacitive Voltage Transformers (AIS)

Capacitive Voltage Transformers shall comply with IEC 61869 in general. These shall have three secondaries out of which two shall be used for protection and one for metering. The Accuracy class for protection cores shall be 3P and for metering cores shall be 0.2. The Capacitive Voltage Transformers on lines shall be suitable for Carrier Coupling. The Capacitance of CVT for 400 kV shall be 4400/8800 pF depending on PLCC requirements whereas the Capacitance of CVT for 765 kV shall be 8800 pF. The rated burden of cores shall be closer to the maximum burden requirement of the metering and protection system (not more than 50 VA for metering core) for better sensitivity and accuracy.

B.2.4.5 Surge Arresters (AIS)

624 kV and 336 kV Station High (SH) duty gapless type Surge Arresters with thermal energy (Wth) of minimum 13 kJ/kV and 12 kJ/kV conforming to IEC 60099-4 in general shall be provided for 800 kV and 420 kV systems respectively. Other characteristics of Surge Arrester shall be chosen in accordance with system requirements. Surge Arresters shall be provided at line entrances, near transformers and reactors so as to achieve proper insulation coordination. Surge Arresters shall be provided with porcelain/polymer housing fitted with pressure relief devices. A leakage current monitor with surge counter shall be provided with each surge arrester.

B.2.5 Protection Relaying and Control System

The protective relaying system proposed to be provided for transmission lines, autotransformers, reactors and bus bars to minimize the damage to the equipment in the events of faults and abnormal conditions, is dealt in this section. All main protective relays shall be numerical type with IEC 61850 communication interface and should have interoperability during integration of numerical relays to communicate over IEC61850 protocol with RTU/SAS/IEDs of different OEMs. All numerical relays shall have built-in disturbance recording feature.

85

Central Transmission Utility of India Limited







The protection circuits and relays of the transformer and reactor shall be electrically and physically segregated into two groups each being independent and capable of providing uninterrupted protection even in the event of one of the protection groups failing, to obtain redundancy, and to take protection systems out for maintenance while the equipment remains in service.

A) TRANSMISSION LINES PROTECTION

765 kV and 400 kV lines shall have Main-I numerical three zone distance protection scheme with carrier aided inter-tripping feature. 765 kV and 400 kV lines shall also have Main-II numerical distance protection scheme like Main-I but from different make that of Main-I. The Main-I and Main-II protection relays of the same make may be provided only if they are ofdifferent hardware and manufacturing platform or different principle of operation.

However, Line Current Differential Relay (with back up distance protection feature) as Main–I and Main-II shall be considered at both ends for short lines (line length below 30 km) having Fibre Optic Communication Link. Differential relay at remote end shall be provided by the TSP. The associated power and control cabling and integration with SAS at remote end shall be provided by respective bay owners.

In case of loop in loop out of transmission lines, the existing protection scheme shall be studied and suitable up-gradation (if required) shall be carried out.

Further, all 765 kV and 400 kV lines shall be provided with single and three phase autoreclosing facility to allow reclosing of circuit breakers in case of transient faults. These lines shall also be provided with distance to fault locators to identify the location of fault on transmission lines.

All 765 kV and 400 kV lines shall also be provided with two stage over voltage protection. The over voltage protection and distance to fault locator may be provided as in-built feature of Main-I and Main-II protection relays. Auto reclose as built-in function of Bay Control Unit (BCU) is also acceptable.

The Main-I and Main-II protection relays shall be fed from separate DC sources and shall be mounted in separate panels.


For 765 kV and 400 kV transmission lines, directional IDMT earth fault relay should be provided as standalone unit or in-built feature of Main-I and Main-II feature.

B) AUTO TRANSFORMER PROTECTION

These shall have the following protections:

- (i) Numerical Differential Protection
- (ii) Numerical Restricted Earth Fault Protection
- (iii) Numerical Back-up Over-Current and Earth Fault Protection on High Voltage (HV) and Intermediate Voltage (IV) side
- (iv) Numerical Over Fluxing Protection on HV and IV side
- (v) Numerical Overload Alarm

Central Transmission Utility of India Limited









Further, Numerical Back-up Over-current and earth fault protection on HV and IV side of autotransformer shall not be combined with other protective functions in the main relays and shall be independent relays. Besides these, power transformers shall also be provided with Buchholz relay, Magnetic Oil Gauge (MOG) with low oil level alarm, protection against high oil and winding temperature and pressure relief device etc.

Suitable monitoring, control (operation of associated circuit breaker and isolator) and protection for LT auxiliary transformer connected to tertiary winding of auto-transformer for the purpose of auxiliary supply shall be provided. The over current and other necessary protection shall be provided for the auxiliary transformer. These protection and control may be provided as built-in feature either in the bay controller to be provided for the auxiliary system or in the control and protection IEDs to be provided for autotransformer.

C) 765 KV AND 400 KV REACTOR PROTECTION

Reactor shall be provided with the following protections:

- i) Numerical Differential Protection.
- ii) Numerical Restricted Earth Fault Protection
- iii) Numerical Back-up Impedance Protection

Besides these, reactors shall also be provided with Buchholz relay, Magnetic Oil Gauge (MOG) with low oil level alarm, protection against oil and winding temperatures and pressure relief device, etc.

D) BUS BAR PROTECTION

The high-speed low impedance type bus bar differential protection, which is essential to minimize the damage and maintain system stability at the time of bus bar faults, shall be provided for 765 kV and 400 kV buses. Duplicated bus bar protection is envisaged for 765 kV and 400 kV bus-bar protection. Bus bar protection scheme shall be such that it operates selectively for each bus and incorporate necessary features required for ensuring security. The scheme shall have complete bus bar protection for present as well as envisaged future bays i.e. input / output modules for future bays shall also be provided.

Bus Bar protection system for new substation shall be de-centralized (distributed) type.

The scheme shall have complete bus bar protection for present as well as envisaged future bays i.e. input/ output modules for future bays for the bus sections under present scope and PUs shall be provided by the respective bay owners. In case, the bus section is provided, then each side of bus section shall have separate set of bus bar protection schemes.

For existing substations, the existing bus bar protection shall be augmented as per requirement.

87

E) LOCAL BREAKER BACK UP PROTECTION

Central Transmission Utility of India Limited





This shall be provided for each 765 kV and 400 kV circuit breakers and will be connected to de-energize the affected stuck breaker from both sides.

Notes:

- 1. LBB and REF relays shall be provided separately from transformer differential relay.
- 2. LBB relay may also be provided as built-in protection function of distributed bus bar protection scheme; however in such case separate LBB relay shall be provided for tie bays (in case of One and Half breaker scheme).
- Over fluxing and overload protection can be provided as built-in feature of differential relay.
- 4. In 765 kV and 400 kV switchyard, if spare bay of half diameter is identified as future, Tie CB relay panel shall be with Auto-reclosure feature.

B.2.6 Substation Automation System

a) For all the new substations, state of art Substation Automation System (SAS) conforming to IEC-61850 shall be provided. The distributed architecture shall be used for Substation Automation System, where the controls shall be provided through Bay Control Units. The Bay Control Unit is to be provided bay wise for voltage level 220 kV and above. All Bay Control Units as well as protection units are normally connected through an Optical fibre high speed network. The control and monitoring of circuit breaker, dis-connector, re-setting of relays etc. can be done from Human Machine Interface (HMI) from the Control Room.

The functions of control, annunciation, disturbance recording, event logging and measurement of electrical parameters shall be integrated in the Substation Automation System (SAS).

At new substations, the Substation Automation System (SAS) shall be suitable for the operation and monitoring of the complete substation including proposed future bays/elements.

In the existing substations with a Substation Automation System (SAS), augmentation of existing SAS shall be done for bays under the present scope.

In the existing Substations where Substation automation is not provided, control functions shall be done through control panels.

Necessary gateway and modems (as required) shall be provided to send data to RLDC/SLDC as per their requirement and shall be provisioned with 2+2 redundancy i.e. 2 channels for Main Control Centre and 2 channels for Backup Control Centre. In order to meet this requirement, suitable redundancy at port and card level need to be ensured by the TSP to avoid any single point of failure which may lead to interruption in real-time grid operation. Accordingly, all the hardware for communication services of the station as stated above shall support dual redundancy for data transmission of station to respective main and backup RLDCs. Any augmentation work at RLDC/SLDC is excluded

Central Transmission Utility of India Limited







from TSP's scope. However, all the configuration work at substation end required to send data to RLDC/SLDC shall be in the scope of TSP.

b) Time Synchronization Equipment

Time Synchronization Equipment complete in all respect including antenna, cable, processing equipment required to receive time signal through GPS or from National Physical Laboratory (NPL) through INSAT shall be provided at new substations. This equipment shall be used to synchronize SAS and IEDs etc.

B.3.0 Substation Support Facilities

Certain facilities required for the operation and maintenance of substations as described below shall be provided at the new substation. In existing substation, these facilities have already been provided and will be extended/ augmented as per requirement.

B.3.1 AC and DC power supplies

For catering the requirements of three phase and single phase AC supply and DC supply for various substation equipment (for present and future scope), the following arrangement is envisaged:-

i) For LT Supply at each new Substation, two (2) Nos. of LT Transformers (minimum 800 kVA for substations with highest voltage rating as 765 kV) shall be provided which shall be fed from two independent sources as per the CEA (Technical Standards for Connectivity to the Grid) Regulations, 2007.

Metering arrangement with Special Energy Meters (SEMs) shall be provided by TSP at 33 kV tertiary of Transformer for drawing auxiliary supply at new substation. Such SEMs shall be provided by CTU at the cost of the TSP. Accounting of such energy drawn by the TSP shall be done by RLDC/RPC as part of Regional Energy Accounting.

Additionally, Active Energy Meters may be provided at the same point in the 33 kV tertiary of Transformer by local SEB/DISCOM for energy accounting.

ii) 2 sets of 220 V battery banks for control and protection and 2 sets of 48 V battery banks for PLCC/ communication equipment shall be provided at each new Substation. Each battery bank shall have a float-cum-boost charger.

At new substation, sizing of 220 V battery and battery charger shall be done based on the number of bays specified (including future bays) as per CEA Regulations and relevant IS. 2 sets of 48 V battery banks for PLCC and communication equipment for present and future scope shall be provided at each new Substation with at least 10-hour battery backup and extended backup, if required. 48 V DC can be achieved from 220 V DC battery bank using adapter, if so desired by TSP, without compromising backup time.

iii) Suitable AC and DC distribution boards and associated LT Switchgear shall be provided at new substation.

For new substation, following switch boards shall be considered with duplicate supply with bus coupler/ sectionalizer and duplicate outgoing feeders except for Emergency lighting distribution board which shall have only one incoming feeder:

- (a) 415 V Main Switch board 1 No.
- (b) AC distribution board 1 No.

Central Transmission Utility of India Limited









- (c) Main lighting distribution board 1 No.
- (d) Emergency lighting distribution board 1 No.
- (e) 220 Volt DC distribution board 2 Nos.
- (f) 48 Volt DC distribution board 2 Nos.

Sizing of LT Switchgear shall be suitable to cater the requirement for all present and future bays. AC and DC distribution boards shall have equipped modules for all the feeders (including future as specified).

- iv) At new Substation, one No. of DG set (minimum 500 kVA for substations with highest voltage rating as 765 kV) shall be provided for emergency applications.
- v) For substation extensions, existing facilities shall be augmented as required.

B.3.2 Fire Fighting System

Fire-fighting system for substation including Transformer and Reactor shall conform to CEA (Measures Relating to Safety and Electric Supply) Regulations, 2023 as amended from time to time.

Further, adequate water hydrants and portable fire extinguishers shall be provided in the substations. The main header of the firefighting system shall be suitable for extension to bays covered under the future scope; necessary piping interface in this regard shall be provided.

At existing substations, the fire-fighting systems as available shall be extended to meet the additional requirements.

B.3.3 Oil Evacuating, Filtering, Testing and Filling apparatus

To monitor the quality of oil for satisfactory performance of transformers, shunt reactors and for periodical maintenance necessary oil evacuating, filtering, testing and filling apparatus would be provided at new substations. Oil storage tanks of adequate capacities for storage of transformer oil would be provided.

Online Transformer Oil Drying Out System shall be provided in line with the provisions of Standard Specification and Technical Parameters for Transformers and Reactors (66 kV and above Voltage Class) as amended up to date available on CEA website.

B.3.4 Illumination

Normal and emergency AC and DC illumination shall be provided adequately in the control room and other buildings of the substation. The switchyard shall also be provided with adequate illumination.

The lighting of the entire control room building, fire-fighting pump house, other building (if any) and switchyard shall be done by LED based low power consumption luminaries.

B.3.5 Control Room

For the new substation, substation control room shall be provided to house substation work stations for station level control (SAS) along with its peripheral and recording equipment, AC and DC distribution boards, DC batteries and associated battery chargers, Fire Protection panels, Telecommunication panels and other panels as per

Central Transmission Utility of India Limited 90 WRNES Talegaon Power Transmission Limited







requirements. Air conditioning shall be provided in the building as functional requirements. Main cable trenches from the control room shall have adequate space provision for laying of cables from the control room for all the future bays.

At existing substations, the adequacy of size of control room shall be ascertained and the same shall be augmented as per requirement.

B.3.6 Control Concept

All the EHV circuit breakers in substation/switching stations shall be controlled and synchronized from the switchyard control room/remote control center. All the isolators shall have control from remote/local whereas the earth switches shall have local control only.

B.3.7 Visual Monitoring System (VMS) for watch and ward of substation premises:

Visual Monitoring System for effective watch and ward of substation premises shall cover all the transformers and reactors, all other major AIS Equipment (such as CB, isolators, CT, CVT, SA etc. as applicable), panel room, all the gates of switchyard and all entry and exit points of control room building and accordingly the location of cameras shall be decided. In addition to the gates of the switchyard, the cameras shall also be located around the boundaries at suitable locations. The camera shall be high-definition color CCD camera with night vision feature. The VMS data partly/completely shall be recorded (minimum for 15 days) at least @25fps (or better) and stored on network video recorder. The system shall use video signals from various cameras installed at different locations, process them for viewing on workstations/monitors in the control room and simultaneously record all the cameras. The VMS data should go only to the intended personnel/facility and not to the remote server of the Camera (VMS supplier).

Mouse/keyboard controllers shall be used for pan, tilt, zoom and other functions of the desired camera. The Visual Monitoring System shall have provision of WAN connectivity for remote monitoring.

All camera recordings shall have Camera ID and location/area of recording as well as date/time stamp. The equipment should generally conform to Electromagnetic compatibility requirement for outdoor equipment in EHV substation.

At existing substations, the Visual Monitoring System if available shall be augmented as per existing or better specification as required.

B.4 General Facilities

- a) Line Gantry/Towers are envisaged for bays under the present scope only. However, for the adjacent future line bay, gantry/tower shall be designed for extension (considering Quad conductors for 765 kV and 400 kV future lines and Twin conductor for 220 kV future lines) wherever applicable.
- b) Bay extension works at existing substation shall be executed by TSP in accordance with the requirements/provisions mentioned above. However, interface points shall be considered keeping in view the existing design/arrangement at the substation.

Central Transmission Utility of India Limited 91 WRNES Talegaon Power Transmission Limited

New Delhi 110003





atmo

- c) TSP has to arrange for construction power and water on its own.
- d) All outdoor steel structures including anchor/foundation bolts shall be fully galvanized. The weight of the zinc coating shall be at least 610 g/m², however, for coastal/creek regions it shall be at least 900 g/m². (if applicable)
- e) In 765 kV and 400 kV switchyard, if spare bay of half diameter is identified as future, all the equipment for Tie and Future bay shall be designed considering the current rating of line bay i.e. 3150 A.
- f) Boundary wall shall be brick masonry wall with RCC frame or Stone masonry wall or Precast RCC wall under present scope along the property line of the complete substation area including future switchyard area to prevent encroachment and unauthorized access. Minimum height of the boundary wall shall be of 1.8 m from Finished Ground Level (FGL).
- g) All electrical equipment shall be installed above the Highest Flood Level (HFL) and where such equipment is not possible to be installed above Highest Flood Level, it shall be ensured that there is no seepage or leakage or logging of water.
- h) As per CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations 2022 and CEA Manual on Transmissions Planning criteria 2023, line approaching substation shall normally be perpendicular to the substation boundary for a stretch of 2-3 km. Accordingly, TSP shall ensure that line terminations at substations are arranged in a manner to avoid hindrance to future line terminations at the substations.

Central Transmission Utility of India Limited

92







SPECIFIC TECHNICAL REQUIREMENTS FOR COMMUNICATION

The communication requirement shall be in accordance to CEA (Technical Standards for Communication System in Power System Operations) Regulations, 2020, CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022, CERC (Communication System for inter-State transmission of electricity) Regulations, 2017, CEA (Cyber Security in Power Sector) Guidelines, 2021, and CERC Guidelines on "Interface Requirements" 2024 all above documents as amended from time to time.

The complete ISTS communication system commissioned by TSP under the RFP shall be the asset of ISTS and shall be available for usage of ISTS requirements as suggested by CTU from time to time.

The communication services viz. SCADA, VoIP, PMU, AGC and AMR (wherever applicable) have been identified as critical services and therefore shall be provisioned with 2+2 redundancy i.e. 2 channels for Main Control Centre and 2 channels for Backup Control Centre. In order to meet this requirement, suitable redundancy at port and card level need to be ensured by the TSP to avoid any single point of failure which may lead to interruption in real-time grid operation.

PMU to PDC communication (wherever required) shall be through 2 channels to the PDC (main) as there is no backup PDC at present.

Accordingly, all the hardware for communication services of station as stated above shall support dual redundancy for data transmission of station to respective main and backup RLDCs.

In order to meet the requirement for grid management and operation of substations, Transmission Service Provider (TSP) shall provide the following:

- C.1.0 Establishment 2x1500 MVA, 765/400 kV Substation near South of Kalamb with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor.
 - (I) TSP shall supply, install and commission One or more Nos. of FODP (120F or higher) alongwith panel and required Approach Cable (24F) with all associated hardware fittings from gantry tower to Control Room for all the incoming lines envisaged under the present scope.
 - (II) TSP shall supply, install and commission One or more STM-16 (FOTE) equipment alongwith panel/s supporting minimum Five (5) directions with MSP (Multiplex Section Protection 1+1). These directions shall exclude protected (1+1) local patching among equipment (if any). Communication Equipment shall be provided with necessary interfaces to meet the voice and data communication requirement among Boisar-II, Pune-III and PSP S/s. The suitable DC Power Supply and backup to be provided for communication equipment.

Central Transmission Utility of India Limited





- (III) FODP and FOTE equipment with panels shall be provided in Control Room of South Kalamb S/s. FOTE and FODP Eq can be accommodated in same panel to optimize space.
- (IV) The new communication equipment under the present scope shall be compatible for integration with existing regional level centralized NMS. The local configuration of the new communication equipment shall be the responsibility of TSP. The configuration work in the existing centralized NMS for integration of new Communication equipment shall be done by Regional ULDC Team, however all the necessary support in this regard shall be ensured by TSP.
- (V) TSP shall supply, install and commission Firewall in redundant mode (1+1) in line with the specification attached at Annexure F.1.
- (VI) The maintenance of all the communication equipment and software thereof including FOTE, FODP, approach cable, PMU, DCPS alongwith Battery Bank and Firewall shall be the responsibility of TSP.

C.2.0 LILO of Pune-III – Boisar-II 765 kV D/C line at South Kalamb S/s with associated bays at South Kalamb S/s.

On LILO of Pune-III – Boisar-II 765 kV D/C line at South Kalamb S/s, TSP shall supply, install and commission OPGW and earthwire as per Tower Configurations:

- (I) For Multi Circuit Tower Configuration: Two (2) No. OPGW cable containing 24 Fibres (24F) to be installed and commissioned by the TSP on both the Earthwire peaks
- (II) For Double Circuit Tower configuration (for both Loop In and Loop Out portion): One (1) No. OPGW cable containing 24 Fibres (24 F) on one earthwire peak and conventional earthwire on other E/W peak for both Loop In and Loop Out Lines.

The TSP shall install OPGW cables from gantry of South Kalamb S/s up to the LILO tower with all associated hardware including Vibration Dampers, mid-way and gantry Joint Boxes (called OPGW Hardware hereafter) and finally terminate in Joint Boxes at South Kalamb S/s. The LILO line length is 40 kms (approx.). After LILO, if fiber length for links South Kalamb to Boisar-II and South Kalamb to Pune-III is above 225 km then repeater shall be envisaged, otherwise line can be managed as a repeater less link.

TSP shall finalize the location of repeater station depending upon the actual site conditions. Further TSP shall comply to the requirements mentioned as per Appendix-F.1

Central Transmission Utility of India Limited

94







Maintenance of OPGW Cable, OPGW Hardware and repeater equipment and items associated with repeater shelter shall be responsibility of TSP.

C.3.0 Specific Requirement for Phasor Measurement Units (PMUs)

TSP shall supply, install and commission required No. of Phasor Measurement Units (PMUs) PMUs at all the locations under the scope of TSP under this RFP as per CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022 (alongwith all amendments if any), and all the other applicable Regulations, Standards, Guidelines issued time to time. The signal list shall be as per the Annexure-I Part-B of CERC Guidelines on "Interface Requirements" 2024. These PMUs shall be provided with GPS clock and LAN switch and shall connect with LAN switch of control room of respective substations/ generating stations with Fibre Optic cable. These PMUs shall be connected with the FOTE at Substation/ generating stations for onwards data transmission to the PDC (Phasor Data Concentrator) located at respective RLDC. Configuration work in existing PDC at RLDC for new PMU integration shall be done by respective RLDC, however all the necessary support in this regard shall be ensured by TSP. The maintenance of all the PMUs and associated equipment shall be the responsibility of TSP.

Note: Existing Station owner/s to provide necessary support to integrate different equipment and applications of new extended bays with the existing substation e.g. Communication (through FOTE), Voice etc. for smooth operation and monitoring of new added grid elements.

Solver Lisure Annual Control of the Control of the

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

New Delhi 110003

95

Appendix-F.1

Repeater Requirements

• If the repeater location is finalized in the Control Room of a nearby substation, TSP shall provide 1 No. OPGW (48F) on a single Earthwire peak with OPGW Hardware and mid-way Joint Boxes etc. of the line crossing the main line and 1 No. Approach Cable (48F) with all associated hardware fittings, to establish connectivity between crossing point of main transmission line up to the repeater equipment in substation control room.

TSP shall co-ordinate for Space and DC power supply sharing for repeater equipment.

TSP shall provide FODP, FOTE (with STM-16 capacity) with suitable interfaces required for link budget of respective link.

OR

• If the repeater location is finalized in the nearby substation premises, the TSP shall identify the Space for repeater shelter in consultation with station owner. Further TSP shall provide 1 No. OPGW (48F) on a single Earthwire peak with OPGW Hardware and mid-way Joint Boxes etc. of the line crossing the main line and 1 No. Approach Cable (48F) / UGFO (48F) with all associated hardware fittings, to establish connectivity between crossing point of main transmission line up to the substation where the repeater shelter is to be housed.

TSP shall provide repeater shelter along with FODP, FOTE (with STM-16 capacity) with suitable interfaces require for link budget of respective link, reliable power supply provisioning for AC and DC supply, battery bank, Air Conditioner and other associated systems.

OR

If the repeater location is finalized on land near the transmission tower. TSP shall
make the provisions for Land at nearby tower for repeater shelter. Further TSP shall
provide 1 No. Approach Cable (48F) / UGFO (48F) with all associated hardware
fittings to establish connectivity up to the location of repeater shelter.

TSP shall provide repeater shelter along with FODP, FOTE (with STM-16 capacity) with suitable interfaces require for link budget of respective link, reliable power supply provisioning for AC and DC supply, battery bank, Air Conditioner and other associated systems

Maintenance of OPGW Cable and **OPGW Hardware**, repeater equipment and items associated with repeater shelter shall be the responsibility of TSP.

Central Transmission Utility of India Limited







Transmission Service Agreement

Proposed Communication for Network Expansion scheme in Western Region to cater to Pumped storage potential near Pune-III S/S LILO of Pune-III - Boisar-II 765kV D/c Line (40km) with OPGW 765/400kV South Kalamb S/S Under Present Scope --Upcoming
Existing Legends: Approach Cable Upcoming 400kV PSP line, Optical interface Properties of Control Room Boisar-II S/S Talegaon (Pune)



Central Transmission Utility of India Limited

Annexure-F.1

Next Generation Firewall (NGFW)

TSP shall provide 2 NGFW one in Main and another in Standby mode having electrical ethernet interfaces/ports and placed between FOTE and SAS gateway/s at the substation. All ethernet based applications shall be terminated in the firewall ports directly (e.g. PMU, AMR, VOIP, SAS/SCADA etc.). Each port of firewall shall work as a separate zone. Firewall shall be hardware based with features of Block/Allow/drop and IPSec VPN (network encryption).

The number of ports/interfaces in each firewall (i.e. Main and Standby) shall be minimum 16 Nos. TSP shall provide either single firewall or multiple firewalls to meet this interfaces requirement, each for main as well as standby firewall. Minimum throughput of firewall shall be 300 Mbps.

The Firewall shall be managed/ configured as standalone at present and shall also have compatibility to manage/configure through Centralized Management Console (CMC) remotely in future.

Firewall shall be tested and certified for ISO15408 Common Criteria for least EAL4+. Further, the OEM must certify that it conforms to Secure Product Development Life Cycle requirements as per IEC62443-4-1. The firewall shall generate reports for NERC-CIP Compliance.

The specifications for the firewalls are given at **Annexure-F.2** and schematic diagram showing firewall placement given at **Figure F.2**.

Central Transmission Utility of India Limited







Annexure F.2

Specifications of Next Generation Firewall (NGFW)

- NGFW shall have following features including but not limited to:
 Encryption through IPSec VPN (Virtual Private Network), Deep Packet Inspection
 (DPI), Denial of service (DoS) and Distributed Denial of Service (DDoS) prevention,
 Port Block/ Allow, rules/ policies for block/allow, IP (Internet Protocol) and Media
 Access Control (MAC) spoofing protection, threat detection, Intrusion Prevention
 System (IPS), Anti-Virus, Anti-Spyware, Man In The Middle (MITM) attack prevention.
- 2. The proposed firewall shall be able to handle (alert, block or allow) unknown /unidentified applications e.g. unknown TCP and UDP packets. It shall have the provision to define application control list based on application group and/or list.
- 3. Firewall shall have feature and also have capability to update the definition/ Signatures of Anti-Virus online as well as offline. Firewall shall also be compatible to update the definitions/signatures through CMC. There shall be a defined process for security patching and firmware up-gradation. There shall be a feature to field validate firmware checksum. The same shall also be validated before using the OEM provided file/binary in the process of firmware up-gradation and security patching
- 4. Firewall shall have Management Console port to configure remotely.
- 5. Firewall shall be EMI/EMC compliant in Substation environment as per IEC 61850-3.
- 6. Firewall shall be rack mounted in existing standard equipment cabinets.
- Firewall shall have support of SCADA applications (IEC-60870-5-104), ICCP, PMU (IEEE C37.118), Sub-Station Automation System (IEC 61850), Ethernet and other substation environment protocols.
- 8. Client based Encryption/ VPN must support different Operating System platforms e.g. Windows, Linux and Mac.
- 9. The solution must have content and comprehensive file detection policies, blocking the files as function of their types, protocols and directions.
- 10. Firewall shall have logging facility as per standard logs/events format. Firewall shall have features to export the generated/stored logs/events in csv (Comma Separated Value) and also any other standard formats for offline usage, analysis and compliance. Firewall shall have suitable memory architecture and solution to store and be enable to export all logs/events for a period of last 90 days at any given time.
- 11. Firewall shall have features and be compatible with local as well as central authentication system (RADIUS, LDAP, or TACACS+) for user account and access right management. It shall also have Role Based User management feature.
- 12. Firewall shall have the capability to configure sufficient number of VLANs.
- 13. Firewall shall have the capability to support sufficient number of sessions.
- 14. Firewall shall have provision to configure multiple IP Sec VPNs, at least 100 Nos., (one-to-many or many-to-one). Shall support redundant operation with a similar router after creation of all the IP Sec VPN. IPSec VPN shall support encryption protocols as AES128, AES256 and hashing algorithms as MD5 and SHA1. IPSec VPN throughput shall support at least 300 Mbps
- 15. Firewall shall be capable of SNMP v3 for monitoring from Network Management system. It shall also have SNMPv3 encrypted authentication and access security

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

New Delhi 110003



- 16. Firewall shall support in Active/Passive or Active-Active mode with High Availability features like load balancing, failover for firewall and IPsec VPN without losing the session connectivity.
- 17. Firewall should have integrated traffic shaping (bandwidth, allocation, prioritisation, etc.) functionality
- 18. Shall support simultaneous operation with both IPv4 and IPv6 traffic
- 19. Firewall shall be compatible with SNTP/NTP or any other standards for clock synchronization
- 20. Firewall shall have the features of port as well as MAC based security
- 21. Firewall shall support exporting of logs to a centralized log management system (e.g. syslog) for security event and information management.
- 22. Firewall time shall be kept synchronised to official Indian Timekeeping agency, time.nplindia.org.
- 23. Firewall product shall be provided with all applicable updates at least until 36 months since the applicable date of product shipping to the concerned utility.


Central Transmission Utility of India Limited







Transmission Service Agreement

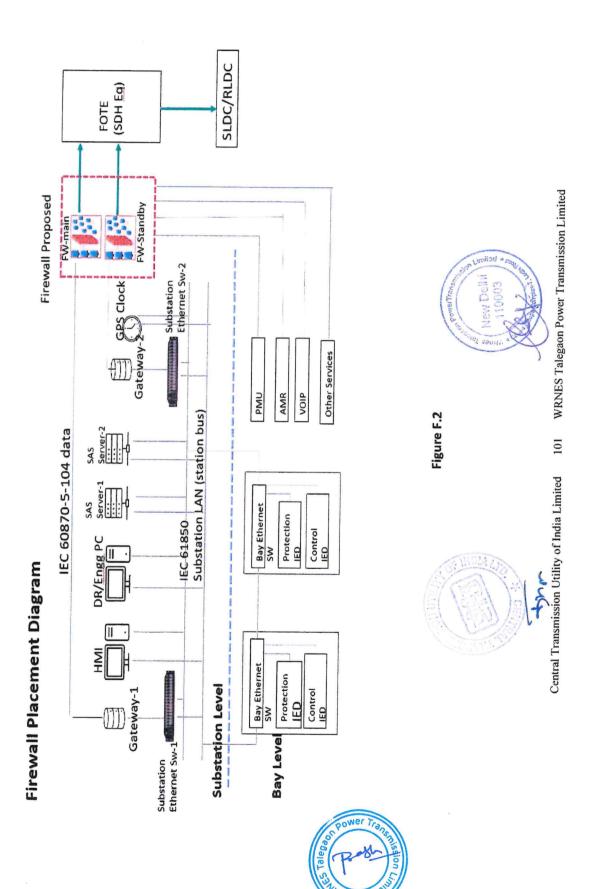

C.4.0 PLCC and PABX:

Power line carrier communication (PLCC) equipment complete for speech, teleprotection commands and data channels shall be provided on each transmission line. The PLCC equipment shall in brief include the following: -

- Coupling device, Coupling filters line traps, carrier terminals, protection couplers, HF cables, PABX (if applicable) and maintenance and testing instruments.
- At new substation, a telephone exchange (PABX) of 24 lines shall be provided at as means of effective communication among various buildings of the substation, remote end substations and with control centres (RLDC/ SLDC) etc.
- Coupling devices shall be suitable for phase-to-phase coupling for 400 kV
 Transmission lines. The pass band of coupling devices shall have sufficient margin for
 adding communication channel in future if required. Necessary protection devices
 for safety of personnel and low voltage part against power frequency voltages and
 transient over voltage shall also be provided.
- The line traps shall be broad band tuned suitable for blocking the complete range of carrier frequencies. Line Trap shall have necessary protective devices such as lightning arresters for the protection of tuning device. Decoupling network consisting of line traps and coupling capacitors may also be required at certain substation in case of extreme frequency congestion.
- The carrier terminals shall be of single side-band (SSB) amplitude modulation (AM) type and shall have 4 kHz band width. PLCC Carrier terminals and Protection couplers shall be considered for both ends of the line.
- CVT and Wave trap for all 765 kV and 400 kV line bays under present scope shall be provided by TSP.
- TSP shall provide/undertake necessary addition/ modification/ shifting/ recommissioning etc. of PLCC equipment due to LILO of transmission lines (wherever applicable).

SI. No	Line name	PLCC configuration
1.(a)	Pune-III - South Kalamb 765 kV	Existing PLCC panels (1 set Analog PLCC + 1
	D/C line [formed after LILO]	set Digital Protection Coupler) of Pune III-
		Boisar II D/C line shall be utilized.
1.(b)	Boisar-II- South Kalamb 765 kV	1 set Analog PLCC + 1 set Digital Protection
	D/C line [formed after LILO]	Coupler at each end after LILO.

- All other associated equipment like cabling, coupling device and HF cable shall also be provided by the TSP.
- Two (2) sets of 48 V battery banks for PLCC and communication equipment shall be provided at each new Substation with at least 10-hour battery backup and extended backup, if required.

Central Transmission Utility of India Limited 102 WRNES Talegaon Power Transmission Limited





Annexure - E

<u>SPECIFIC TECHNICAL REQUIREMENTS FOR INTEGRATION OF COMMUNICATION EQUIPMENT WITH REGIONAL LEVEL NMS / REGIONAL UNMS:</u>

The new communication equipment/ system for all the substations under the present scope shall be compatible for integration with existing regional level NMS system/ Centralized Supervision and Monitoring System (CSMS) i.e. Regional UNMS. The local configuration of the new communication equipment at the station end shall be the responsibility of TSP as per Annexure E.1. The configuration work in the existing centralized NMS/ CSMS at Control center end, for integration of new Communication equipment/ system shall be done by Regional ULDC Team/ NMT, however all the necessary support in this regard shall be ensured by TSP.

Central Transmission Utility of India Limited

103

anner (



Annexure E.1

Requirement for integration of Communication Equipment with Regional UNMS:

- TSP shall ensure that NMS/EMS/NE supplied by them is NBI compliant and all FCAPS functionality is supported in the NBI such as NE Inventory, Hardware Inventory Shelf/Slot/Card/SFP/Port, Topology, Protections, Alarms, Performance- real time and periodic, Performance KPI parameters (E-1, STM, Ethernet), Remote Configuration, Cross Connects, Trails and Circuits, Services Provisioning (NE), E-1, STM, Ethernet, TX and RS Trace, loop back and details are published in the NBI guide for the configuration parameters.
- TSP shall be obliged to provide/share all necessary documentations such as NBI Guide/MIB/IDL/WSDL/API files/ etc. for onward integration of their NMS/EMS/NE with regional UNMS.
- 3. The following support shall be provided by TSP for integration of their supplied equipment with regional UNMS:
 - Enabling and activating NBI license in their EMS/NMS and providing NBI login access along with User credentials
 - Assist in verifying NBI Connectivity with UNMS vendor for the successful communication and retrieval of data.
 - Assist in troubleshooting (if required) for NBI connectivity along with UNMS vendor for the communication and retrieval of data.
- 4. For standalone NE which is not integrated with any EMS/NMS, TSP shall provide modality of complete FCAPS data acquisition as above through industry standard programmatic methods and provide the CLI command manual.

Central Transmission Utility of India Limited

104







Frequently Asked Queries:

1.0 Transmission Line:

1.1 Please clarify that whether shutdowns for crossing of existing transmission lines of POWERGRID/STUs/ Power Evacuation Lines from Generation Plants/ Any other Transmission Licensee will be given to TSP on chargeable basis or free of cost.

Reply: Shutdowns for crossing of existing transmission lines of POWERGRID/ STUs/ Power Evacuation Lines from Generation Plants/ Any other Transmission Licensee will be given to TSP by the concerned owner of the lines as per their own terms and conditions. As far as shutdown of ISTS lines are concerned the same can be availed by approaching respective Regional Power Committee.

We understand that the suggested swing angle criteria are applicable for Suspension Insulator in Suspension Tower. Further, you are requested to provide similar swing angle and clearance criteria for Pilot Insulator with Jumper and Jumper.

Reply: It is clarified that the swing angle criteria (as mentioned in RFP) for transmission lines is applicable for Suspension Insulator in Suspension Tower. Further, as per Clause 3.0 of Specific Technical Requirements for transmission lines, Transmission service Provider (TSP) shall adopt any additional loading/design criteria for ensuring reliability of the line, if so desired and /or deemed necessary.

1.3 We request you to kindly allow that use of diamond configuration at Power line crossings and the existing owner of the lines may be directed to allow the same for the successful bidders.

Reply: Power line crossing including Diamond configuration is responsibility of the TSP. TSP shall formally submit the profile of the crossing section to the owner of the existing line suggesting proposed crossing alternatives. The crossing will have to be carried out as per approval of owner of the existing line.

1.4 It is requested you to kindly provide present status of Forest Clearances if any transmission line corridor area falling in wildlife forest / reserve forest/ mangroves.

Reply: Based on the preliminary route survey, the process of initiation of forest clearance for the forest stretches, if any, enroute the proposed line alignment will be initiated by way of writing letters to the concerned authority (ies). However, it may be noted that it will be the responsibility of TSP for obtaining forest clearance for the forest stretches as provided in the survey report and also for any forest area encountered during detailed survey.

1.5 For transmission line, no special requirement is specified for type of Insulator and creepage in RFP document. Hence it is understood that bidder can decide the type of insulator along with creepage requirement based on general CEA regulations and relevant standards. Kindly confirm.

Central Transmission Utility of India Limited 105 WRNES Talegaon Power Transmission Limited







Reply: The minimum specific creepage distances shall be decided for the pollution condition in the area of installation. It shall be as per CEA regulations and relevant standards.

2.0 Substation

2.1 We understand that space for storage of O&M spare shall be provided by existing owner within the station boundary without any cost. Kindly confirm.

Reply: Space for storage of O&M spares shall be arranged by TSP on its own.

2.2 We presume that the O&M for the end Termination bays will be in the scope of the TSP and TSP shall not be liable for any payment towards O&M to the existing owner of the substation. Kindly confirm.

Reply: Operation and maintenance of the bays is solely responsibility of the TSP. Further, Operation and maintenance of the bays is solely responsibility of the TSP. TSP shall follow CEA's "Operation and Maintenance (O&M) guidelines and Standard Format for Memorandum of Understating between New TSP and Existing TSP" issued by CEA vide its letter No. I/28514/2023 dated 22.06.2023. Copy of the guideline is available on CEA website at following link:

https://cea.nic.in/wp-content/uploads/pse td/2023/06/om guidelines.pdf With reference to subject scheme of existing sub-station, we assumed following scope of work:

- (a) We assumed internal road is available and need not to consider in the present scope of work.
- (b) Drainage is available and need not to consider in the present scope of work.
- (c) Cable trench extension in adjacent to Main cable trench only under present scope of work.
- (d) Levelled area being provided by developer for bay extension.

Reply: Regarding requirement of internal road, drainage, cable trench, leveling of the bay extension area, bidder is advised to visit site and acquaint themselves with the provisions/facilities available at substation.

2.3 Kindly provide the soil investigation report of soil parameters of existing substation.

Reply: Bidder is advised to visit the substation site and ascertain the requisite parameters.

2.4 Kindly confirm, energy accounting of aux. power consumption. Whether it will be on chargeable basis or part of transmission loss.

Reply: It will be on chargeable basis.

Central Transmission Utility of India Limited 106 WRNES Talegaon Power Transmission Limited







2.5 We understand that VMS requirement is for unmanned stations only. For Manned stations VMS is not compulsory.

Reply: VMS shall be provided in line with requirements of RfP document.

2.6 It is understood that Construction water and power shall be provided free of cost to TSP by respective substation owner for construction of new bays.

Reply: Arrangement of construction power and water is in the scope of TSP.

2.7 It is understood that existing fire hydrant system shall be extended by the TSP for bay extension.

Reply: Existing fire hydrant system shall be extended from existing system (if required)

2.8 Please clarify that Status of land acquisition for Substations. Whether the lands have been acquired by BPC and will be transferred to TSP.

Reply: The acquisition of land for substation is in the scope of TSP.

2.9 We understood that no any dedicated metering CT and CVT required for Line/feeders. Further, we understood that requisite Energy meters for various 765 kV, 400 kV and 220 kV Feeders shall be provided and installed by CTU free of cost to TSP.

Reply: Dedicated metering CT and CVT are not required for line/feeders. Metering core of existing CT/CVT can be used provided accuracy class is matching with metering requirement. Requisite Special Energy Meters shall be provided and installed by CTU at the cost of TSP in C&P panel subject to space availability, else, in separate metering panel (to be provided by TSP at its cost).

2.10 A draft copy of the Connection Agreement may be furnished. A draft copy of the Connection Agreement may be furnished.

Reply: Web page link https://www.ctuil.in/formats gna transition

2.11 Please clarify whether the spare 765 kV single phase Reactor unit for Bus reactor shall be provided with 1ph 765 kV CB.

Reply: As per RfP, the spare 1-Ph reactor unit shall be utilized for all the bus and switchable line reactor banks (including for future reactor banks). Hence, 1ph 765 kV CB shall also be provided with spare 1-Ph reactor for utilizing with bus reactor as well as switchable line reactor.

2.12 It is understood that existing busbar protection have provision for future bays and also PUs are available for future bays. BPC to confirm availability of CU and PU for bays under present scope of work at existing substations. BPC may kindly confirm availability of communication ports for integrating new PUs with the existing CUs at existing substations.

Reply: Bus Bar Protection with Central Unit (CU) is required for new bus section as specified in RfP. Peripheral Units (PUs) shall be provided by the respective bay owner. Further, augmentation/replacement of existing CU, if required, to meet the

Central Transmission Utility of India Limited 107 WRNES Talegaon Power Transmission Limited



system requirement shall also be provided for proper functioning of bus bar protection.

2.13 For SCADA, it is understood that necessary process I/O shall be available for future bays and accordingly license for same. BPC to confirm.

Reply: Necessary process I/O along with license shall be in the scope of the successful bidder.

2.14 No separate FF system is envisaged under the present scope of work for existing substation. BPC to confirm.

Reply: Existing fire-fighting systems shall be extended to meet the additional requirements under present scope.

2.15 PLCC for 220 kV Lines are not under the scope of TSP. BPC to Confirm.It is requested to provide Type of Coupling for 220 kV Transmission Lines under present scope.

Reply: PLCC for 220 kV line is in the scope of developer of the line. Inter circuit coupling for 220 kV D/C and phase to phase coupling for 220 kV S/C shall be applicable for PLCC.

2.16 BPC is requested to confirm the availability of space in the existing control rooms at existing substation for execution of extension work under current project.

Reply: Switchyard Panel Rooms are generally required for AIS type substation and relay room are required for GIS type substation. Further, if needed, control room shall be augmented as per requirement.

3.0 Communication

3.1 What are the usage of OPGW, FOTE, PMU etc. under communication requirement of RFP?

Reply: User shall be responsible for providing compatible equipment along with appropriate interface for uninterrupted communication with the concerned control center and shall be responsible for successful integration with the communication system provided by CTU.

Communication systems e.g. OPGW, FOTE etc. and PMU are required for grid operation through RLDC/SLDC, speech communication, tele-protection and telemetering.

3.2 Is space for installation of communication panels are provided to TSP in existing Substations incase new bays are in the scope of TSP?

Reply: The space related issues are deliberated in the RFP itself. TSP to install FOTE/FODP panels in the new Bay Kiosk (Switchyard Panel Room (SPR)) / Bay Kisok/ Relay Panel Room (in case of GIS S/s). Further, TSP to connect and integrate the proposed FOTE with the existing FOTE in the control room to complete communication path upto RLDC.

Central Transmission Utility of India Limited 108 WRNES Talegaon Power Transmission Limited







In Case 132 kV Substation TSP shall accommodate the said panels either by extension of existing control room or other arrangements.

3.3 How is the OPGW laying done in case of LILO lines?

Reply: In case LILO lines are on same towers (e.g. both Line in and Line Out portion are on same towers, generally done LILO of S/C lines). Then 2x24F OPGW shall be required to install by TSP on both earthwire peak on 400 kV and 765 kV lines where two E/W peaks are available. On 220 kV and 132 kV lines where only one E/W peak is available TSP to install one No. 48F OPGW.

Incase LILO lines are on different towers (e.g. both Line In and Line Out portion are on different towers, generally done LILO of D/C lines). Then 1x24F OPGW shall be required to install by TSP on one earthwire peak and conventional earthwire on second earthwire peak, on both Line In and Line Out portion towers of 400 kV and 765 kV lines. On 220 kV and 132 kV lines where only one E/W peak is available TSP to install one No. 24F OPGW in place of conventional earthwire.

3.4 How is the OPGW laying done in case Multi circuit Towers?

Reply: In case two different lines are using common multi circuit portion for some distance (originating from different stations, may be terminating on same or on different stations). Two No. 24F OPGW to be installed on both E/W peaks for common M/C portion of 765 kV and 400 kV lines.

Incase 220/132 kV lines using multi circuit portion where single E/W peak is available one No. 48F may be installed for common multi circuit portion.

3.5 How PMUs are integrated for new bays at existing Substations?

Reply: PMU data of new bays to be provided in the ethernet port of switch at control room and thereafter to be connected with existing FOTE of existing substation to send data to PDC of RLDC by TSP. These PMUs shall be provided with GPS clock and LAN switch and shall connect with LAN switch of control room of respective substations with Fibre Optic cable

3.6 Is Spare direction available in existing FOTE for integration with new bay kiosk FOTE

Reply: The FOTE under present scope shall be integrated by TSP with the existing FOTE at control room of substation for onwards data transmission.

In case spare optical direction is not available in the existing FOTE at the control room, the TSP shall coordinate with station owner to reconfigure the directions in existing FOTE at control room.

3.7 What is the distance from LILO point to proposed substation for feasibility of repeater station?

Reply: Tentative Location of LILO point shall be as per survey report of BPC however exact location to be ascertained after detailed survey by TSP.

3.8 What is the make and model of existing OPGW in case LILO of main line at new

109

Central Transmission Utility of India Limited





substation?

Reply: All OPGW(alongwith optical fibers) meet Central Electricity Authority (Technical Standards for Communication System in Power System Operations) Regulations, 2020 and bidder shall install OPGW accordingly.

3.9 In case of LILO of existing line at new substation who shall provide PMUs at existing substation bays?

Reply: TSP to provide PMUs for all bays under their scope of RFP.

4.0 Planning:

4.1 Whether the Project/ Elements are eligible for early commissioning incentive as per MoP, GoI order dated 15.07.2015.?

Reply: Commissioning is to be done as per the timeline mentioned in RfP. However, early commissioning shall be treated as per applicable CERC Regulations/orders.

Central Transmission Utility of India Limited

110







Scheduled COD

[Note: As referred to in the definition of "Element", "Scheduled COD", and in Articles 3.1.3 (c), 4.1 (b) and 4.3 (a) of this Agreement]

SI. No.	Scope of the Transmission Scheme	Scheduled COD	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre- required for declaring the commercial operation (COD) of the respective Element
1.	Establishment 2x1500 MVA, 765/400 kV Substation near South of Kalamb with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor	01.01.2028	100%	All Elements are required to be commissioned simultaneously as their utilization is dependent on
2.	LILO of Pune-III — Boisar-II 765 kV D/C line at South Kalamb S/s with associated bays at South Kalamb S/s			commissioning of each other.
3.	Installation of 1x240 MVAr switchable line reactor on each ckt at South Kalamb end of Boisar-II – South Kalamb 765 kV D/C line (formed after above LILO)			

The payment of Transmission Charges for any Element, irrespective of its successful commissioning on or before its Scheduled COD, shall only be considered after successful commissioning of the Element(s), which are pre-required for declaring the commercial operation of such Element as mentioned in the above table.

Scheduled COD for the Project is: 01.01.2028.

[Note: List of Element(s) along with the critical Element(s) to be provided by CEA]

Central Transmission Utility of India Limited







Safety Rules and Procedures

[Note: As referred to in Articles 5.6 of this Agreement]

1: Site Regulations and Safety:

The TSP shall establish Site regulations within sixty (60) days from fulfilment of conditions subsequent, as per Prudent Utility Practices setting out the rules to be observed till expiry of the Agreement at the Site and shall comply therewith.

Such Site regulations shall include, but shall not be limited to, rules in respect of security, safety of the Project, gate control, sanitation, medical care, and fire prevention, public health, environment protection, security of public life, etc.

Copies of such Site regulations shall be provided to the Nodal Agency and the CEA for the purpose of monitoring of the Project.

2: Emergency Work:

In cases of any emergency, the TSP shall carry out all necessary remedial work as may be necessary.

If the work done or caused to be done by any entity, other than the TSP, the TSP shall, reimburse the actual costs incurred, to the other Party carrying out such remedial works.

3: Site Clearance:

In the course of execution of the Agreement, the TSP shall keep the Site reasonably free from all unnecessary obstruction, storage, remove any surplus materials, clear away any wreckage, rubbish and temporary works from the Site, and remove any equipment no longer required for execution of the Agreement. After completion of all Elements of the Project, the TSP shall clear away and remove all wreckage, rubbish and debris of any kind from the Site, and shall leave the Site clean and safe.

4: Watching and Lighting:

The TSP shall provide and maintain at its own expense all lighting, fencing, and watching when and where necessary for the proper construction, operation, maintenance / repair of any of the Elements of the Project, or for the safety of the owners and occupiers of adjacent property and for the safety of the public, during such maintenance / repair.

Central Transmission Utility of India Limited







Computation of Transmission Charges

1.1 General

The Monthly Transmission Charges to be paid to the TSP for providing Transmission Service for any Contract Year during the term of the Agreement shall be computed in accordance with this Schedule and paid as per Sharing Regulations.

Illustration regarding payment of Transmission Charges under various scenarios (considering definitions of Contract Year, Expiry Date & Monthly Transmission Charges above) is as below: -

Illustration-1: In case the Project Elements achieve COD as per Schedule

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	28	1-Feb-2018	1-Feb-2018	25%
Element 2	38	1-Dec-2018	1-Dec-2018	75%

113

Tariff Payable as follows:

Central Transmission Utility of India Limited







Transmiss	Transmission Charges for Element 1		Transmissio	on Charges for Eler	nent 2
1-Feb-18 to	140 X 25% X	5.65			0.00
31-Mar-18	((28+31)/365)				
1-Apr-18 to	140 X 25% X	23.39			0.00
30-Nov-18	(244/365)				
1-Dec-18 to		140 X 1009	% X (121/365)		46.41
31-Mar-19					
2		140 X 100% X 1			
3		140 X	100% X 1		140
4		140 X	100% X 1		140
5		140 X	100% X 1		140
		PO TO DO 1500 DO 100 DO			
36		140 X 1009	6 X (244/365)		93.59
(1-Apr to 30-					
Nov)					

<u>Illustration-2: In case of extension of Scheduled COD as per Article 4.4.1 & 4.4.2 of this Agreement</u>

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the
				Element
Element 1	20	1-Feb-2018	1-Jul-2018	25%
Element 2	28	1-Oct-2018	1-Dec-2018	75%

Tariff Payable as follows:

Transmission Charges for Element 1			Transmission (Charges for Elen	nent 2
1-Feb-18 to 31-Mar-18		0.00			0.00
1-Apr-18 to 30-Jun-18		0.00			0.00

Central Transmission Utility of India Limited 114 WRNES Talegaon Power Transmission Limited







Transmission Service Agreement

1-Jul-18 to	140 X 25% X	14.67			0.00	
30-Nov-18	(153/365)					
1-Dec-18 to		140 X 100% X (121/365)				
31-Mar-19						
2		140 X	100% X 1		140	
3		140 X	100% X 1		140	
4		140 X 100% X 1				
5		140 X 100% X 1				
36		140 X 1009	6 X (244/365)		93.59	
(1-Apr to 30-						
Nov)						

Illustration-3: In case of delay in achieving COD of Project & all individual Elements (COD of the Project achieved in Contract Year 1)

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion	Scheduled	Actual CoD of	% Charges
	Schedule in	CoD of the	the Element	recoverable on
	Months	Element		Scheduled CoD of
				the
				Element
Element 1	20	1-Feb-2018	1-Dec-2018	25%
Element 2	28	1-Oct-2018	1-Dec-2018	75%

Tariff Payable as follows:

Transmission Charges for Element 1	Transmission Charges for Element 2
L	

Central Transmission Utility of India Limited 115





Transmission Service Agreement

1-Feb-18 to	~~	0.00			0.00	
31-Mar-18						
1-Apr-18 to		0.00		~~	0.00	
30-Sept-18		v				
1-Oct-18 to		0.00	1-Oct-18 to		0.00	
30-Nov-18			30-Nov-18			
1-Dec-18 to		140 X 100%	X (121/365)		46.41	
31-Mar-19						
2		140 X 100% X 1				
3		140 X 100% X 1				
4	140 X 100% X 1					
5		140 X 1	L00% X 1		140	
				*		
36	140 X 100% X (244/365)					
(1-Apr to 30-						
Nov)						

Central Transmission Utility of India Limited

WRNES Talegaon Power Transmission Limited

116







Illustration-4: In case of delay in achieving COD of Project & all individual Elements (COD of the Project achieved in Contract Year other than Contact Year 1)

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion	Scheduled	Actual CoD of	% Charges
	Schedule in	CoD of the	the Element	recoverable on
	Months	Element		Scheduled CoD of
				the
				Element
Element 1	38	1-Oct-2019	1-May-2020	25%
Element 2	38	1-Oct-2019	1-May-2020	75%

Tariff Payment to be paid as:

Transmiss	Transmission Charges for Element 1		Transmission Charges for Elem		ment 2	
1-Oct-19 to		0.00	1-Oct-19 to		0.00	
31-Mar-20			31-Mar-20			
1-Apr-20 to	-	0.00	1-Apr-20 to	-	0.00	
30-Apr-20			30-Apr-20			
1-May-20 to		140 X 100% X (335/365)				
31-Mar-21						
2		140 X 100% X 1				
3		140 X	100% X 1		140	
4		140 X	100% X 1		140	
5		140 X	100% X 1		140	
36		140 X 100	% X (30/ 365)	X X	11.51	
(1-Apr to 30-						
Apr)						

Central Transmission Utility of India Limited

117







Illustration-5: In case of delay in achieving COD of Element but Project COD achieved on time

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the
				Element
Element 1	20	1-Feb-2018	1-Jul-2018	25%
Element 2	30	1-Dec-2018	1-Dec-2018	75%

Tariff Payable as follows:

Transmission Charges for Element 1		Transmissio	on Charges for Elen	nent 2	
1-Feb-18 to		0.00			0.00
31-Mar-18					
1-Apr-18 to		0.00			0.00
30-Jun-18					
1-Jul-18 to	140 X 25% X	14.67			0.00
30-Nov-18	(153/365)				
1-Dec-18 to	140 X 100% X (121/365)			46.41	
31-Mar-19					
2	140 X 100% X 1			140	
3	140 X 100% X 1			140	
4	140 X 100% X 1			140	
5		140 X	100% X 1		140
36		140 X 100%	6 X (244/365)		93.59
(1-Apr to 30-					
Nov)					

118

Central Transmission Utility of India Limited







Illustration-6: In case of early commissioning of Project

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	38	1-Oct-2019	1-Jul-2019	25%
Element 2	38	1-Oct-2019	1-Jul-2019	75%

Tariff Payment to be paid as:

Transmission Charges for Element 1		Transmission Charges for Element 2	
1-July-19 to 31-Mar-20	140 X 1009	% X (274/365)	105.09
2	140 X	100% X 1	140
3	140 X	140 X 100% X 1	
4	140 X 100% X 1		140
5	140 X 100% X 1		140
************			_
36	140 X 1009	% X (91/365)	34.91
(1-Apr to 30- Jun)			

Central Transmission Utility of India Limited 119







Illustration-7: In case of early commissioning of an element

Quoted Transmission Charges: Rs. 140 Million

Completion Schedule:

Element No.	Completion Schedule in Months	Scheduled CoD of the Element	Actual CoD of the Element	% Charges recoverable on Scheduled CoD of the Element
Element 1	38	1-Oct-2019	1-Apr-2019	25%
Element 2	38	1-Jul-2019	1-Jul-2019	75%

Tariff Payment to be paid as:

Transmissio	on Charges for Elem	ent 1	Transmission	Charges for Eler	ment 2
1-Apr-2019	140 X 25% X	8.72	1-Apr-2019 to		0.00
to 30-Jun-19	(91/365)		30-Jun-19		
1-July-19 to	1	140 X 100%	6 X (274/ 365)		105.09
31-Mar-20					
2	140 X 100% X 1			140	
3	140 X 100% X 1			140	
4	140 X 100% X 1			140	
5	140 X 100% X 1			140	
36	140 X 100% X (91/365)			34.91	
(1-Apr-30-					
Jun)					

The Transmission Charges shall be payable on monthly basis as computed above.

1.2 Computation of Monthly Transmission Charges

The Monthly Transmission Charges for any month m in a Contract Year n shall be calculated as below:

For AC System:

a. If Actual Transmission System Availability for the month m of contract year n is greater than or equal to 98% and less than or equal to 98.5%;

120

Central Transmission Utility of India Limited







Monthly Transmission Charges MTC(m) = Tmn *1

a. If Actual Transmission System Availability for the month m of contract year n exceeds 98.5% and less than or equal to 99.75%;

Monthly Transmission Charges MTC(m) = Tmn * (AA/ 98.5%)

If Actual Transmission System Availability for the month m of contract year n is greater than 99.75%;

Monthly Transmission Charges MTC(m) = Tmn * (99.75% / 98.5%)

d. If Actual Transmission System Availability for the month m of contract year n is less than 98% and greater than or equal to 95.00%;

Monthly Transmission Charges MTC(m) = Tmn * (AA/ 98%)

If Actual Transmission System Availability for the month m of contract year falls below 95%:

Monthly Transmission Charges MTC(m) = Tmn * (AA/98%) - 0.02 * (Tmn * (AA/95%)

For DC System:

a. If Actual Transmission System Availability for the month m of contract year n is greater than or equal to 95% and less than or equal to 96%;

Monthly Transmission Charges MTC(m) = Tmn *1

b. If Actual Transmission System Availability for the month m of contract year n exceeds 96% and less than or equal to 99.75%;

Monthly Transmission Charges MTC(m) = Tmn * (AA/ 96%)

If Actual Transmission System Availability for the month m of contract year n is greater than 99.75%;

Monthly Transmission Charges MTC(m) = Tmn * (99.75% / 96%)

If Actual Transmission System Availability for the month m of contract year n is less than 95% and greater than or equal to 92.00%;

Monthly Transmission Charges MTC(m) = Tmn * (AA/ 95%)

If Actual Transmission System Availability for the month m of contract year falls e. below 92%:

Monthly Transmission Charges MTC(m) = Tmn * (AA/95%) - 0.02 * (Tmn * (AA/92%)

where:

Central Transmission Utility of India Limited

121







- AA is the actual Availability, as certified by RPC, as per procedure provided in Schedule 6.
- m is the month in Contract Year 'n'
- Tmn= Transmission Charges for the month 'm' in Contract Year 'n' = (=Transmission Charge/ no. of days in the Year n)* no. of days in month m

Provided, no Transmission Charges shall be paid during the period for which the RLDC has not allowed the operation of the Element/Project due to the failure of the TSP to operate it as per the provisions of the Grid Code.

1.3 RLDC Fee & Charges

The payment of RLDC fee & charges, in accordance with relevant regulations of CERC, shall be the responsibility of the TSP.

122

Central Transmission Utility of India Limited



Quoted Transmission Charges

[Quoted Transmission Charges from Annexure - 21 of the RFP of the Selected Bidder to be inserted here]

[To be incorporated from the Bid of the Selected Bidder submitted during the e-reverse auction after its selection]

Quoted Annual Transmission Charges: Rs. 2214.45 Million

Proportionate Transmission Charges payable for each Element of the Project:

SI. No.	Scope of the Transmission Scheme	Percentage of Quoted Transmission Charges recoverable on Scheduled COD of the Element of the Project	Element(s) which are pre-required for declaring the commercial operation (COD) of the respective Element
1.	Establishment 2x1500 MVA, 765/400 kV Substation near South of Kalamb with 2x330 MVAR, 765 kV bus reactor and 2x125 MVAR, 420 kV bus reactor	100%	All Elements are required to be commissioned simultaneously as their utilization is dependent on
2.	LILO of Pune-III – Boisar-II 765 kV D/C line at South Kalamb S/s with associated bays at South Kalamb S/s		commissioning of each other.
3.	Installation of 1x240 MVAr switchable line reactor on each ckt at South Kalamb end of Boisar-II – South Kalamb 765 kV D/C line (formed after above LILO)		

Central Transmission Utility of India Limited

123 V







<u>Appendix –IV to Central Electricity Regulatory Commission (Terms and Conditions of</u> Tariff) Regulations, 2024

Procedure for Calculation of Transmission System Availability Factor for a Month

- 1. Transmission system availability factor for nth calendar month ("TAFPn") shall be calculated by the respective transmission licensee, verified by the concerned Regional Load Dispatch Centre (RLDC) and certified by the Member-Secretary, Regional Power Committee of the region concerned, separately for each AC and HVDC transmission system and grouped according to sharing of transmission charges. In the case of the AC system, transmission System Availability shall be calculated separately for each Regional Transmission System and inter-regional transmission system. In the case of the HVDC system, transmission System Availability shall be calculated on a consolidated basis for all inter-state HVDC systems.
- 2. Transmission system availability factor for nth calendar month ("TAFPn") shall be calculated by considering the following:
 - AC transmission lines: Each circuit of AC transmission line shall be considered as one element;
 - ii) Inter-Connecting Transformers (ICTs): Each ICT bank (three single-phase transformers together) shall form one element;
 - Static VAR Compensator (SVC): SVC, along with SVC transformer, shall form one element;
 - iv) **Bus Reactors or Switchable line reactors:** Each Bus Reactors or Switchable line reactors shall be considered as one element:
 - v) **HVDC Bi-pole links:** Each pole of the HVDC link, along with associated equipment at both ends, shall be considered as one element;
 - vi) HVDC back-to-back station: Each block of the HVDC back-to-back station shall be considered as one element. If the associated AC line (necessary for the transfer of inter-regional power through the HVDC back-to-back station) is not available, the HVDC back-to-back station block shall also be considered unavailable;
 - vii) Static Synchronous Compensation ("STATCOM"): Each STATCOM shall be considered as a separate element.
- 3. The Availability of the AC and HVDC portion of the Transmission system shall be calculated

Central Transmission Utility of India Limited



Transmission Service Agreement

by considering each category of transmission elements as under:

TAFPn (in %) for AC system:

Where,

o = Total number of AC lines.

AVo = Availability of o number of AC lines

Total number of bus reactors/switchable line reactors

AVp = Availability of p number of bus reactors/switchable line reactors

q1 = Total number of ICTs

AVq = Availability of q number of ICTs

r = Total number of SVCs

AVr = Availability of r number of SVCs

u = Total number of STATCOM

AVu = Availability of u number of STATCOM

TAFMn (in %) for HVDC System:

$$\sum\nolimits_{x=1}^{n} \mathsf{Exbp} \, (\mathsf{act}) \, \mathsf{X} \, \mathsf{AVxbp} + \sum\nolimits_{y=1}^{n} \mathsf{Ey} \, (\mathsf{act}) \mathsf{btb} \, \mathsf{X} \, \mathsf{AVybtb}$$

$$\sum\nolimits_{y=1}^{n}Cxhp+\sum\nolimits_{y=1}^{n}Cy\,hib$$

Where

Cxbp(act) = Total actual operated capacity of xth HVDC pole

Cxbp = Total rated capacity of x^{th} HVDC pole

AVxbp = Availability of xth HVDC pole

Cybtb(act) = Total actual operated capacity of yth HVDC back-to-back station block

Cybtb = Total rated capacity of yth HVDC back-to-back station block

AVybtb = Availability of yth HVDC back-to-back station block

s = Total no of HVDC poles

t = Total no of HVDC Back to Back blocks







- 4. The availability for each category of transmission elements shall be calculated based on the weightage factor, total hours under consideration and non-available hours for each element of that category. The formulae for calculation of the Availability of each category of the transmission elements are as per Appendix-V. The weightage factor for each category of transmission elements shall be considered as under:
 - (a) For each circuit of the AC line The number of sub-conductors in the line multiplied by ckt-km;
 - (b) For each HVDC pole- The rated MW capacity x ckt-km;
 - (c) For each ICT bank The rated MVA capacity;
 - (d) For SVC- The rated MVAR capacity (inductive and capacitive);
 - (e) For Bus Reactor/switchable line reactors The rated MVAR capacity;
 - (f) For HVDC back-to-back stations connecting two Regional grids- Rated MW capacity of each block; and
 - (g) For STATCOM Total rated MVAR Capacity.
- 5. The transmission elements under outage due to the following reasons shall be deemed to be available:
 - i. Shut down availed for maintenance of another transmission scheme or construction of new element or renovation/upgradation/additional capitalization in an existing system approved by the Commission. If the other transmission scheme belongs to the transmission licensee, the Member Secretary, RPC may restrict the deemed availability period to that considered reasonable by him for the work involved. In case of a dispute regarding deemed availability, the matter may be referred to the Chairperson, CEA, within 30 days.
 - ii. Switching off of a transmission line to restrict over-voltage and manual tripping of switched reactors as per the directions of the concerned RLDC.
 - iii. Shut down of a transmission line due to the Project(s) of NHAI, Railways and Border Road Organization, including for shifting or modification of such transmission line or any other infrastructure project approved by Ministry of Power. Member Secretary, RPC may restrict the deemed availability period to that considered reasonable by him for the work involved; Provided that apart from the deemed availability, any other costs involved in the process of such shutdown of transmission line shall not be borne by the DICs.

Provided that such deemed availability shall be considered only for the period for which DICs are not affected by the shutdown of such transmission line.

Complax.1

Central Transmission Utility of India Limited 126 WRNES Talegaon Power Transmission Limited





- 6. For the following contingencies, the outage period of transmission elements, as certified by the Member Secretary, RPC, shall be excluded from the total time of the element under the period of consideration for the following contingencies:
 - i) Outage of elements due to force majeure events beyond the control of the transmission licensee. However, whether the same outage is due to force majeure (not design failure) will be verified by the Member Secretary, RPC. A reasonable restoration time for the element shall be considered by the Member Secretary, RPC, and any additional time taken by the transmission licensee for restoration of the element beyond the reasonable time shall be treated as outage time attributable to the transmission licensee. Member Secretary, RPC may consult the transmission licensee or any expert for estimation of reasonable restoration time. Circuits restored through ERS (Emergency Restoration System) shall be considered as available;
 - ii) Outage caused by grid incident/disturbance not attributable to the transmission licensee, e.g. faults in a substation or bays owned by another agency causing an outage of the transmission licensee's elements, and tripping of lines, ICTs, HVDC, etc., due to grid disturbance. However, if the element is not restored on receipt of direction from RLDC while normalizing the system following grid incident/disturbance within reasonable time, the element will be considered not available for the period of outage after issuance of RLDC's direction for restoration;
 - iii) The outage period which can be excluded for the purpose of sub-clause (i) and (ii) of this clause shall be declared as under:
 - a. Maximum up to one month by the Member Secretary, RPC;
 - b. Beyond one month and up to three months after the decision at RPC;
 - c. Beyond three months by the Commission for which the transmission license shall approach the Commission along with reasons and steps taken to mitigate the outage and restoration timeline.
- 7. Time frame for certification of transmission system availability: (1) The following schedule shall be followed for certification of availability by the Member Secretary of the concerned RPC:
 - Submission of outage data along with documentary proof (if any) and TAFPn calculation by Transmission Licensees to RLDC/ constituents
 - By the 5th of the following month;
 - Review of the outage data by RLDC / constituents and forward the same to respective RPC – by 20th of the month;
 - Issue of availability certificate by respective RPC by the 3rd of the next month.

Central Transmission Utility of India Limited

127





Appendix-V

FORMULAE FOR CALCULATION OF AVAILABILITY OF EACH CATEGORY OF TRANSMISSION ELEMENTS

For AC transmission system

AVo(Availability of o no. of AC lines) =
$$\frac{\sum_{i=1}^{n} W_i(T_i - T_i)A_i/T_i}{\sum_{i=1}^{n} w_i}$$

AVq(Availability of q no. of ICTs)
$$= \sum_{\substack{k=1 \\ k=1}}^{q} \frac{Wk(Tk-TNAk)^{k}}{\sum_{k=1}^{q} Wk}$$

$$AVr(Availability of r no. of SVCs) = \frac{\sum_{i=1}^{n-1} Wi(Ti-Ti)Ai) \cdot Ti}{\sum_{i=1}^{n} Wi}$$

AVp(Availability of p no. of Switched Bus reactors) =
$$\frac{\sum_{n=1}^{7} W_{m}(T_{m} \cdot T_{N}A_{m}) \cdot T_{m}}{\sum_{n=1}^{8} W_{m}}$$

AVu(Availability of u no. of STATCOMs) =
$$\begin{array}{c} \sum^u \ \text{Wa(Tx-TNAn)/Tn} \\ \\ \sum^u \ \text{Wa(Tx-TNAn)/Tn} \\ \\ \sum^u \ \text{Wa} \\ \\ n=1 \end{array}$$

$$AV_{xbp}(Availability of an individual HVDC pole) = \frac{(Tx - TN)}{Tx}$$

AVybib (Availability of an individual HVDC

128

Central Transmission Utility of India Limited



For the HVDC transmission system

For the new HVDC commissioned but not completed twelve months:

For first 12 months: [(AVxbp or AVybtb)x95%/85%], subject to a ceiling of 95%.

Where.		
o	=	Total number of AC lines;
AVo	=	Availability of o number of AC lines;
p	=	Total number of bus reactors/switchable line reactors;
AVp	=	Availability of p number of bus reactors/switchable line reactors;
q	=	Total number of ICTs;
AVq	=	Availability of q number of ICTs:
r	=	Total number of SVCs;
AVr	=	Availability of r number of SVCs:.
U	=	Total number of STATCOM:
AVu	=	Availability of u number of STATCOMs;
Wi	=	Weightage factor for ith transmission line:
Wk	=	Weightage factor for kth ICT:
Wi	=	Weightage factors for inductive & capacitive operation of Ith SVC:
Wm	=	Weightage factor for mth bus reactor;
Wn	=	Weightage factor for nth STATCOM.
$T_{\ell, \cdot}, T_{k, T_{\ell, \cdot}}$	•	The total hours of ith AC line, kth ICT, Ith SVC, m^{th} Switched Bus Reactor
Tm , Tn , Tx , Ty $T_{NA}J$, $T_{NA}k$		& n th STATCOM, x th HVDC pole, y th HVDC back-to-back blocks during the period under consideration (excluding time period for outages not attributed to transmission licensee for the reasons given in Para 5 of the procedure) The non-availability hours (excluding the time period for outages not TNAI, TNAM, attributable to transmission licensee taken as deemed
		availability as T _{MA} n, T _{MA} n, T _{MA} n, T _{MA} n per Para 5 of the procedure) for ith AC line, kth ICT, Ith SVC, mth Switched Bus Reactor, nth STATCOM, xth HVDC pole and yth HVDC back-to-back block.

129

Central Transmission Utility of India Limited







Entire Bid (both financial bid and technical bid) of the Selected Bidder to be attached here

Bid dated 07.03.2025 and 19.03.2025 shall be an integral part of this agreement.





WRNES Talegaon Power Transmission Limited

Central Transmission Utility of India Limited

Contract Performance Guarantee

(To be on non-judicial stamp paper of appropriate value as per Stamp Act relevant to place of execution. Foreign entities submitting Bids are required to follow the applicable law in their country.)

	In consideration of the
	This guarantee shall be valid and binding on the Guarantor Bank up to and includingand shall not be terminable by notice or any change in the constitution of the Bank or the term of the Transmission Service Agreement or by any other reasons whatsoever and our liability hereunder shall not be impaired or discharged by any extension of time or variations or alternations made, given, or agreed with or without our knowledge or consent, by or between parties to the respective agreement.
	Our liability under this Guarantee is restricted to Rs
	The Guarantor Bank hereby expressly agrees that it shall not require any proof in addition to the written demand from (in its roles as the Nodal Agency),
ı	al Transmission Utility of India Limited 131 WRNES Talegaon Power Transmission Limited

Central Transmission Utility of India Limited





made in any format, raised at the above mentioned address of the Guarantor Bar	nk.
in order to make the said payment to Nodal Agency.	,

THIS BANK GUARANTEE shall be interpreted in accordance with the laws of India.

The Guarantor Bank represents that this BANK GUARANTEE has been established in such form and with such content that it is fully enforceable in accordance with its terms as against the Guarantor Bank in the manner provided herein.

THIS BANK GUARANTEE shall not be affected in any manner by reason of merger, amalgamation, restructuring, liquidation, winding up, dissolution or any other change in the constitution of the Guarantor Bank.

The Guarantor Bank acknowledges that this BANK GUARANTEE is not personal to Nodal Agency and may be assigned, in whole or in part, (whether absolutely or by way of security) by Nodal Agency to any entity to whom the Nodal Agency is entitled to assign its rights and obligations under the Transmission Service Agreement.

The Guarantor Bank hereby agrees and acknowledges that Nodal Agency shall have a right to invoke this Bank Guarantee either in part or in full, as it may deem fit.

132

Central Transmission Utility of India Limited





Transmission Service Agreement

liable to pay the guaranteed amount or any part thereof under this Bank Guarantee only if Nodal Agency serves upon us a written claim or demand.

In witness where of:
Signature
Name:
Power of attorney No.:
For:
[Insert Name of the Bank]
Banker's Seal and Full Address, including mailing address of the Head Office

Central Transmission Utility of India Limited





Methodology for determining the Relief Under Force Majeure Event & Change in Law during Construction Period

The relief in the form of revision in tariff due to Force Majeure Event leading to extension of Scheduled COD for a period beyond one hundred eighty (180) days and/ or Change in Law during the construction period shall be as under:

 $\Delta T = [(P \times d)] \div [1-(1+d)^{(-n)}]$

Where,

ΔT = Change in Transmission Charges for each year

P = Sum of cumulative increase or decrease in the cost of the Project due to Change in Law and interest cost during construction corresponding to the period exceeding one hundred eighty (180) due to Force Majeure Event leading to extension of Scheduled COD for a period beyond one hundred eighty (180) days

n = number of years over which the Transmission Charges has to be paid

d = Discount rate as notified by the CERC, applicable on the Bid Deadline

The increase in Transmission Charges as stated above shall be applicable only if the value of increase in Transmission Charges as calculated above exceeds 0.30% (zero point three percent) of the quoted Transmission Charges of the TSP.

134

Central Transmission Utility of India Limited

and the second s





Annexure A10

Form-I

Application Form for Grant of Transmission licence

1. Particulars of the Applicant

S	Particulars	Details
No		
i.	Name of the Applicant	WRNES Talegaon Power
		Transmission Limited
ii.	Status	Public Limited Company
iii.	Address	C 105, Anand Niketan, New Delhi
		110021
iv.	Name, Designation & Address of the Contact	Shri Prashant Kumar,
	Person	Head-Regulaory,
		WRNES Talegaon Power
		Transmission Limited,
		C/o KP Epitome, Nr. Dav
		International School, Makarba,
		Ahmedabad 380 051
v.	Contact Telephone No	9810866555
vi.	Fax No	079-25550779
vii.	Email ID	prashant.kumarl@adani.com
viii.	Place of Incorporation/ Registration	New Delhi
ix.	Year of Incorporation/ Registration	2024
X.	Following documents are to be enclosed	4
	a) Certificate of Registration	Annexure A2
	b) Copy of Board Resolution	Annexure A11

2. Particulars of the Project for which licence is being sought:

a) Transmission Lines:

S No	Name (end-points Location)	Voltage Class (kV)	Length* (km)	Type (S/c or D/c)
2	LILO of Pune – III – Boisar -II 765 kV D/C line at South Kalamb S/s with associated bays at South Kalamb S/s	765	70	D/c

^{*}As per survey report

b) Sub-stations:

S No	Name (Locatio n)	Voltage Level (s) (kV)	Transforme r (Nos. and MVA capacity)	Reactive/Capacitive compensation (device with MVAR Capacity)	No. of bays
1	South	765/400	2x1500	• 2x330 MVAR, 765 kV	• 2 No. of 765 kV



S No	Name (Locatio n)	Voltage Level (s) (kV)	Transforme r (Nos. and MVA capacity)	Reactive/Capacitive compensation (device with MVAR Capacity)	No. of bays
	Kalamb S/s	kV	MVA,	Bus Reactor, 2x125 MVAR, 420 kV Bus Reactor 2x240 MVAR, 765kV switchable line reactor 1x80 MVAR, Spare reactor	ICT Bays 2 no. of 400 kV ICT Bays 4 no. of 765 kV Line bays 2 no. of 765kV Bus Reactor Bays 2 no. of 400 kV Reactor Bays 2 no. of 400 kV Line bays (for interconnection of PSP)

C) Commissioning Schedule:

Sr. No.	Name of the Transmission Element	Scheduled COD
1	Establishment of 2x1500 MVA, 765/400 kV substation near South of	
	Kalamb with 2X330 MVAR, 420 kV bus reactor and 2X125 MVAR,	
	420 kV bus reactor	
2	LILO of Pune – III – Boisar -II 765 kV D/C line at South Kalamb	01.01.2028
	S/s with associated bays at South Kalamb S/s	
3	Installation of 1X240 MVAr switchable line reactor on each ckt at	
	South Kalamb end of Boisar - II South Kalamb 765 kV D/C line	
	(Formed after above LILO)	

- d) Identified Long-Term transmission customers of the Project:
 - 1. Central Transmission Utility of India Limited (Nodal Agency)
- e) Any other relevant information: Nil
- 3. Levelised transmission charges in case of project selected through the transparent process of competitive bidding and estimated completion cost of the project in other cases: **Rs 2214.45** million per annum



- 4. In case applicant has been selected in accordance with the guidelines for competitive bidding, enclose:
 - (a) Recommendation of selection by the Empowered Committee
 - (b) Evaluation report made public by the Bid Process Coordinator

Bid Evaluation Committee Certificate as furnished by BPC is enclosed as Annexure A5

5. List of documents enclosed:

Name of the Document

- a) Certificate of Registration, MOA & A0A: Annexure A3
- b) Copy of Board Resolution: Annexure A11
- c) Bid Evaluation Committee Certificate as furnished by BPC: Annexure A5

Sind A bear its of the control of th

(Signature of the Applicant)

Date: 05.06.2025

Place: Ahmedabad

adani **Energy Solutions**

Annexure A11

CERTIFIED TRUE COPY OF RESOLUTION PASSED BY THE BOARD OF DIRECTORS OF WRNES TALEGAON POWER TRANSMISSION LIMITED AT ITS MEETING HELD ON 30TH MAY, 2025 AT 06.30 PM

"RESOLVED THAT Mr. M.R. Krishna Rao, Mr. Vivek Gautam, Mr. Molay Kumar Maitra, Mr. Tanmay Vyas, Mr. Narendra Ojha, Mr. Bhavesh Kundalia, Mr. Prashant Kumar, Mr. Naresh Desai, Mr. Afak Pothiawala, Mr. Hiteshkumar Vaghasiya, Mr. Hareshkumar Vaghasiya, Mr. Atul Kumar Singh, Mr. Sanjay Johari, Mr. Rajesh Sirigirisetty, Mr. Harsh Rana, Ms. Afrin Mankad (hereinafter referred to as Authorised Signatories) be and are hereby severally Authorised to sign and submit petitions, affidavits, agreements, declarations, undertakings, deeds, Bills, submission of details of Bank Accounts or change of Bank Accounts and other documents in connection therewith or incidental thereto before Central Electricity Regulatory Commission (CERC), Appellate Tribunal for Electricity (APTEL), Power Grid Corporation of India Limited (PGCIL), Central Transmission Utility of India Ltd (CTUIL), Power System Operation Corporation Limited (POSOCO), Regional Power Committees and Regional Load Dispatch Centres and other regulatory authorities for and on behalf of the Company.

RESOLVED FURTHER THAT Authorised Signatories be and are hereby severally authorised:

- (a) to issue notices, affidavit and other documents, communications to Long Term Transmission Customers and other Parties / agencies, including Central Transmission Utility of India Limited. and WRLDC/SRLDC:
- (b) to file Petition, Affidavit, Notices and other documents before Regulatory Commission or other Electricity body, Appellate Tribunal for Electricity and Supreme Court for issues arising out of Transmission Service Agreement and Bulk Power Transmission Agreement;
- (c) to engage, appoint or remove any pleaders or advocates, and sign vakalatnamas, power of attorney for such engagement or appointment; and
- (d) to file appeal and defend the interest of the Company."

Certified True Copy

For WRNES Talegaon Power Transmission Limited ATI II

ATUL ATUL KUMAR KUMAR SINGH

Date: 2025.06.04 SINGH 18:53:41 +05'30' Atul Kumar Singh

Director

DIN: 11002417



WRNES Talegaon Power Transmission Limited Adani Corporate House Shantigram, Near Vaishno Devi Circle, S G Highway, Khodiyar, Ahmedabad 382 421 Gujarat, India

CIN: U42202DL2024G0I438750

Tel +91 79 2555 7555 Fax +91 79 2555 7177 info@adani.com www.adanienergysolutions.com